


NOISE IMPACT ASSESSMENT

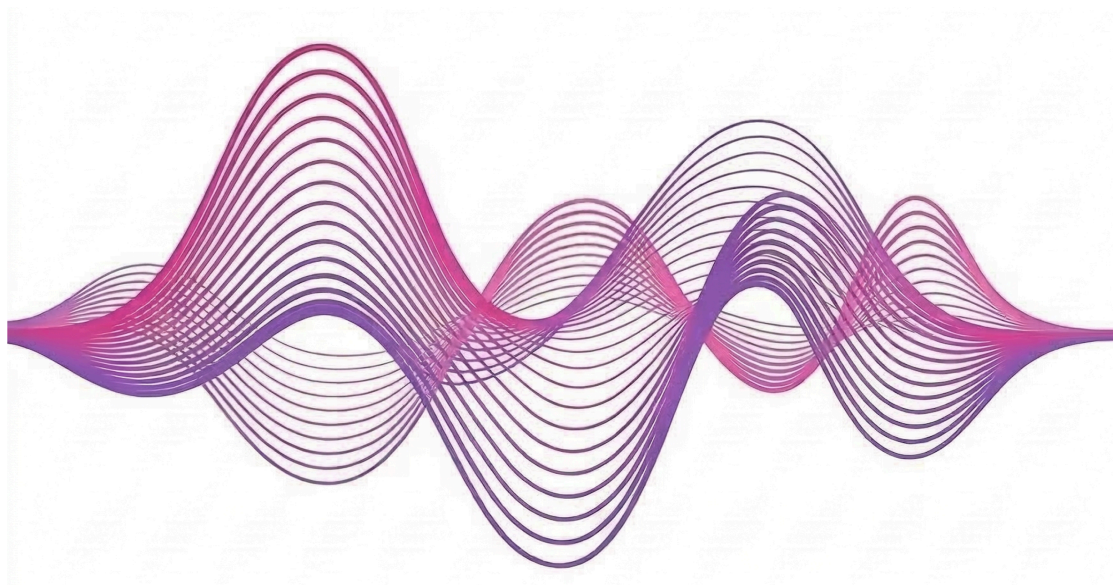

Project: Residential Heat Pump Installation – 41 Simonswood Lane

Subject: Technical Methodology and Results Analysis for Planning Application

Date: 28th September 2026

Author: Samuel Wall

Contents

NOISE IMPACT ASSESSMENT	0
Author: Samuel Wall	0
1. INTRODUCTION AND EXECUTIVE SUMMARY	2
2. REGULATORY FRAMEWORK AND NATIONAL POLICY CONTEXT	3
2.1. National Planning Policy Framework (NPPF) (2024)	3
2.2. British Standard BS 8233:2014	3
2.3. British Standard BS 4142	3
3.1. Data Selection	4
3.2. Sound Power Verification	4
3.3. Spectral Analysis	4
4. COMPUTATIONAL MODELING METHODOLOGY	7
5. PREDICTED RESULTS AND ANALYSIS	8
5.1. External Assessment	8
5.2. Internal Noise Level Calculation	8
6. CONTEXTUAL ASSESSMENT AND AMBIENT ENVIRONMENT	10
DEFRA Daytime Noise Modeling:	11
DEFRA Nighttime Noise Modeling:	11
7. CONCLUSION	12
APPENDIX A: TECHNICAL REFERENCES AND MODELING DATA	13
A.1. SOURCE NOISE DATA SPECIFICATION	13
A.2. LEGISLATIVE AND STANDARDS FRAMEWORK	13
A.3. COMPUTATIONAL MODELING ASSUMPTIONS (ISO 9613-2)	13
A.4. GLOSSARY OF ACOUSTIC TERMS	13

1. INTRODUCTION AND EXECUTIVE SUMMARY

1.1. This Technical Note has been prepared to support a planning application regarding the installation of a **Cosy 6** Air Source Heat Pump (ASHP) at **41 Simonswood Lane**. The primary objective of this assessment is to quantify, using a robust and conservative estimation, the potential acoustic impact of the proposed unit on the surrounding residential amenity through rigorous computational modeling.

1.2. The assessment utilizes the internationally recognized **ISO 9613-2:1996** standard for sound propagation. To ensure the robustness of the application, the model employs a highly conservative "worst-case" scenario approach. This includes the use of hard ground assumptions and high facade reflection coefficients to ensure the predicted levels represent a definitive upper limit of potential noise impact.

1.3. Comprehensive modeling confirms that the predicted external **Rating Noise Level (L_{Ar,Tr})** at the critical neighboring assessment position 43 Simonswood Lane is **37 dB(A)**.

1.4. These results demonstrate that the proposed installation achieves an external noise level that remains 3-18 dB below the prevailing ambient daytime noise climate (40-55 dB) and within the prevailing ambient nighttime noise climate (35-45dB) indicated by DEFRA strategic mapping. Furthermore, the internal noise level in the nearest bedroom is calculated at 27 dB(A), which is below the BS 8233:2014 target of 30 dB for sleeping conditions. Consequently, the proposal preserves residential amenity and complies with National Planning Policy.

2. REGULATORY FRAMEWORK AND NATIONAL POLICY CONTEXT

The assessment has been conducted with strict adherence to national planning policies and recognized acoustic standards. Detailed definitions of these policies are provided in Appendix A.2.

2.1. National Planning Policy Framework (NPPF) (2024)

Paragraph 198 mandates that planning decisions must "mitigate and reduce to a minimum potential adverse impact resulting from noise from new development". This report demonstrates compliance by proving the unit operates below the background noise floor and within acceptable internal limits.

2.2. British Standard BS 8233:2014

This standard establishes internal ambient noise level targets to safeguard rest and sleep. The relevant criterion for this application is:

- **Sleeping (Bedrooms):** 30 dB LAeq, 8hr

2.3. British Standard BS 4142

This standard provides methods for rating and assessing industrial and commercial sound. It introduces the concept of the Rating Level (L_{Ar,Tr}), which is the specific sound level of the source corrected for acoustic features such as tonality, impulsivity, or intermittency.

3. SOURCE NOISE DATA SPECIFICATION

3.1. Data Selection

To provide a technically defensible assessment, this report utilizes the manufacturer's certified sound power data. Specifically, we have selected the data for a water outlet temperature of **55°C** (Test No. HV324-107), which represents the most accurate operational condition for the proposed system design.

3.2. Sound Power Verification

Unlike "nominal" pressure data which requires geometric conversion, the data utilized here is provided as **Sound Power Level (L_W)**. This eliminates uncertainty regarding measurement distance or hemispherical conversion. To ensure robustness, the total Sound Power (LWA) of **58.1 dB(A)** has been used directly in the propagation model.


3.3. Spectral Analysis

Full octave band data (125Hz – 8kHz) has been input into the model to accurately predict the propagation of different frequencies over distance.

Table 1: Cosy 6 Sound Power Spectral Data (55°C Flow)

Cosy 6 Spectral Data							
Frequency Hz	125	250	500	1000	2000	4000	8000
dB Level	55.1	56.4	57.6	53.7	44.1	44.5	38.4
Total	62.1						
A-weighted dB Level	39	47.8	54.4	53.7	45.3	45.5	37.3
Total	58.1						

Cosy 6 octave bands

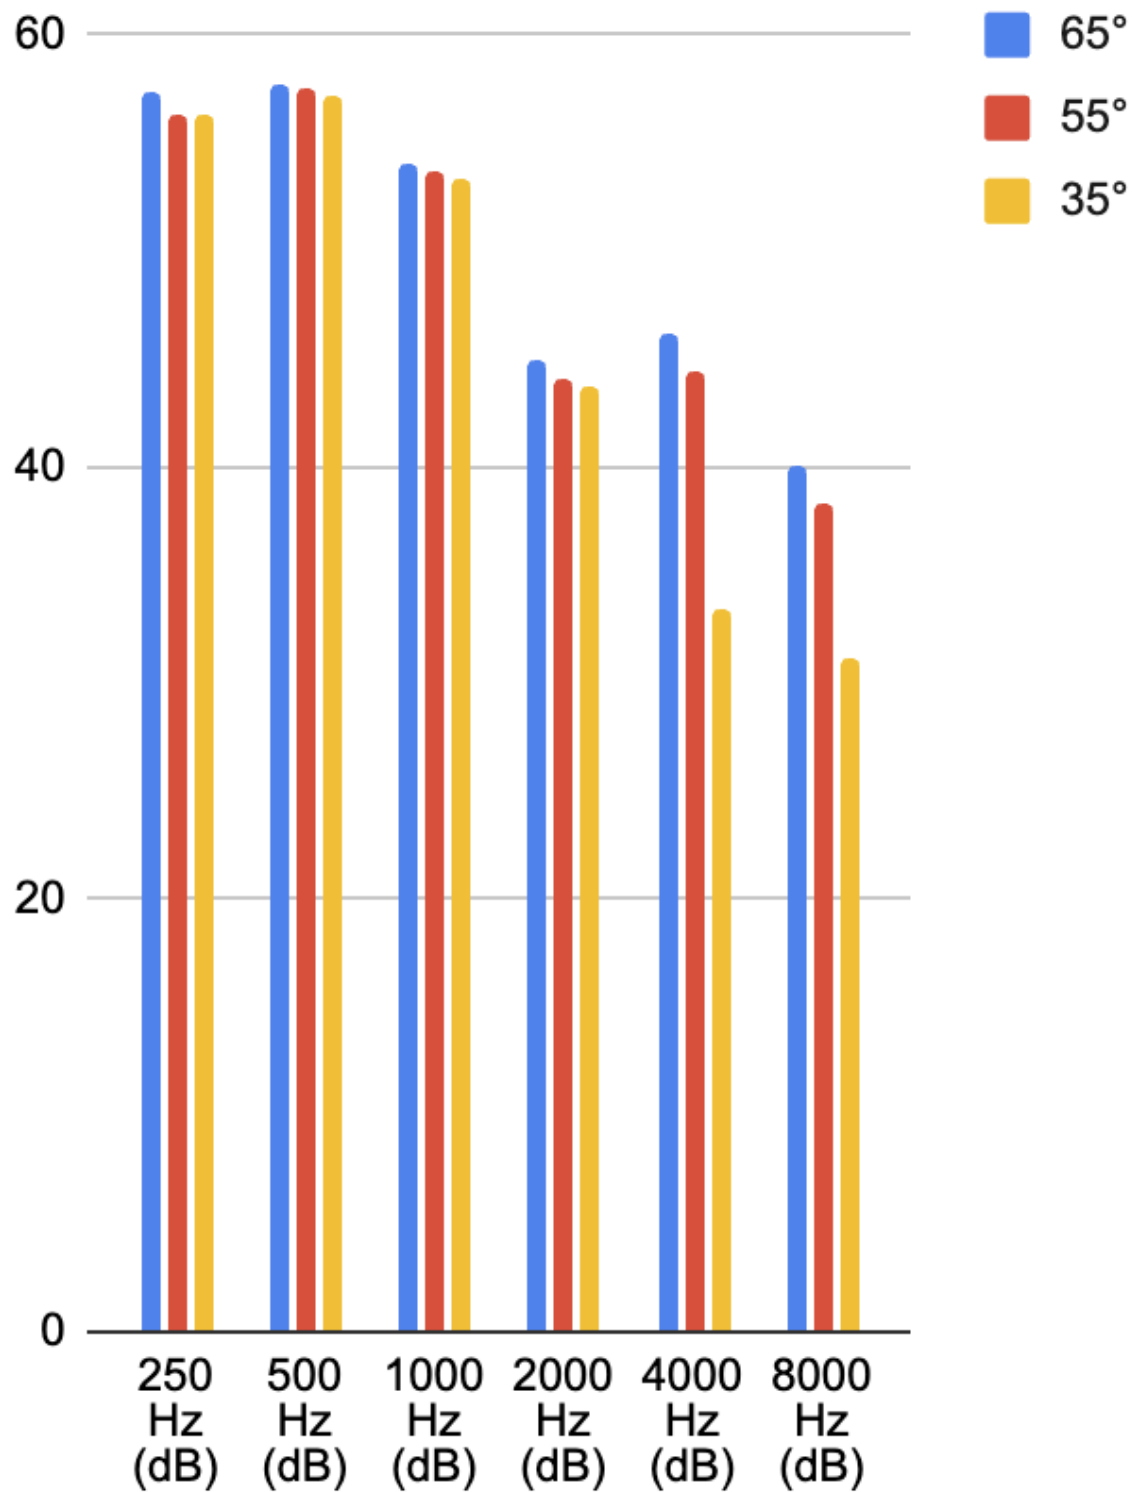

Sound power (Lw) octave band centre...

4. COMPUTATIONAL MODELING

METHODOLOGY

The noise map and propagation calculations were generated utilizing the ISO 9613-2:1996 standard.

4.1. Facade Reflection (Coefficient 0.982):

A reflection coefficient of 0.982 was strictly applied to all vertical surfaces (brickwork/glazing). This assumes 98.2% of sound energy is reflected back into the environment, effectively modeling the building envelope as a near-perfect acoustic mirror.

4.2. Ground Factor (G=0):

A global Ground Factor of G=0 (Hard Ground) was applied to the entire propagation path. This treats the ground as reflective, negating attenuation provided by garden turf.

4.3. Directivity (Q=4):

Hemispherical radiation (Q=4) is assumed to account for source directivity resulting from installation in close proximity (250mm) to the reflective host facade as well as the ground.

4.4. Acoustic Feature Correction:

In accordance with BS 4142, a dB tonal correction has been applied to the specific sound level to derive the Rating Level (L_{Ar},Tr). In accordance with the joint CIEH and IOA guidance on heat pump installations, a +2dB correction has been applied to account for tonality. As tonal intermittency is proven to be low, this minimal correction is considered appropriate for the character of the sound.

5. PREDICTED RESULTS AND ANALYSIS

The noise predictions have been calculated for the critical receiver locations. All presented values represent the **Rating Level (L_{Ar,Tr})**, which incorporates a mandatory **+2 dB** tonal correction. This Rating Level accounts for the total predicted noise at the assessment points, combining the output of the proposed Air Source Heat Pump with any existing on-site noise sources.

Property Address	Assessment Position	Ground Floor	First Floor
43 Simonswood Lane	Position 1	29 dB(A)	-
	Position 2	-	37 dB(A)
	Position 3	-	33 dB(A)
39 Simonswood Lane	Position 4	-	36 dB(A)
	Position 5	31 dB(A)	-
	Position 6	-	29 dB(A)
	Position 7	24 dB(A)	-

5.1. External Assessment

Critical Receptors: 39 and 43 Simonswood Lane

Worst Case Predicted Rating Level (L_{Ar,Tr}):

5.2. Internal Noise Level Calculation

It is standard acoustic practice (accepted by the World Health Organization and BS 8233) to assume that a partially open window provides **10-15 dB** of attenuation from external noise sources. A conservative attenuation factor of **10 dB** has been adopted to ensure a robust assessment.

Internal Level = External Rating Level - Open Window
Attenuation

Internal Level = 37dB(A) - 10dB


Internal Level = 27dB(A)

Compliance: The calculated internal level of **27 dB(A)** is **3 dB lower** than the BS 8233 target of 30 dB. There is no risk of sleep disturbance.

ISO 9613-2 First-Floor Assessment Points:



ISO 9613-2 Ground-Floor Assessment Points:

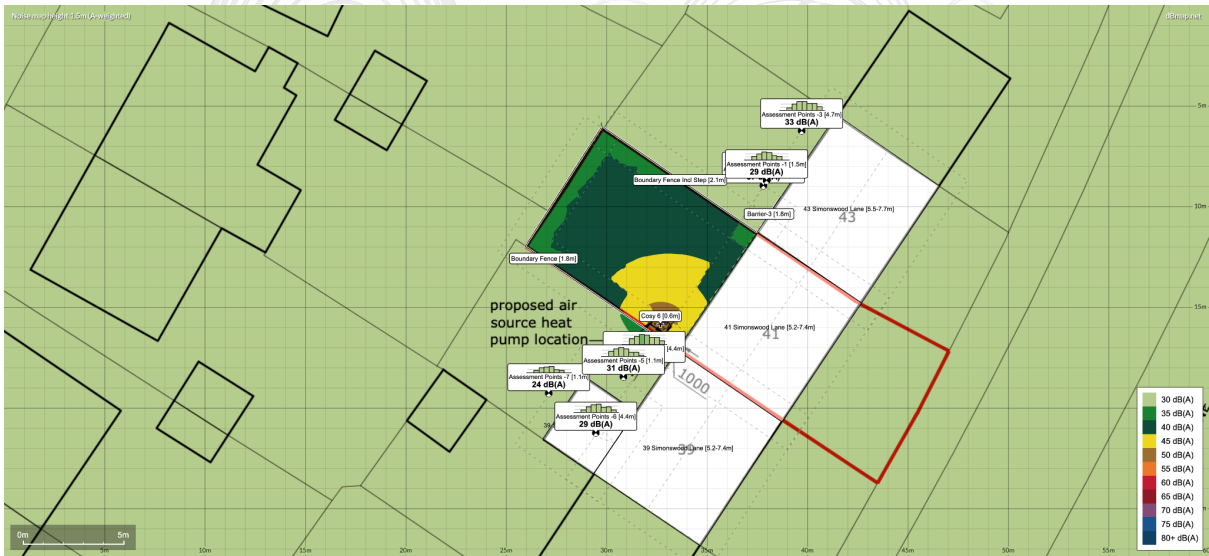

6. CONTEXTUAL ASSESSMENT AND AMBIENT ENVIRONMENT

6.1. Ambient Noise Climate:

Strategic noise data from **DEFRA** identifies the ambient daytime noise baseline for this location falling within the **40 to 55 dB** bands, and the ambient nighttime noise baseline for this location falling within the **35 to 45 dB** bands.


6.2. Assessment of Impact:

- Prevailing Ambient Daytime Noise Climate: 40-55dB(A).
- Plant Rating Level: 37 dB(A).
- Differential: **3 to 18 dB**.
- Prevailing Ambient Nighttime Noise Climate: 35–45 dB(A).
- Plant Rating Level: 37 dB(A).
- Differential: **Within the noise baseline**


6.3. Discussion:

The phenomenon of Acoustic Masking dictates that the broadband noise of the environment will mask the lower-level sound of the new source. When a source's rating level falls **below** the prevailing ambient noise floor, it is fundamentally rendered acoustically indistinguishable from the background. When the rating level is **within** the ambient floor, the principle of Acoustic Masking ensures the specific noise remains contained by the existing environmental noise climate. In both scenarios, the source is prevented from introducing a new, significant noise character or adverse impact on residential amenity.

DEFRA Daytime Noise Modeling:

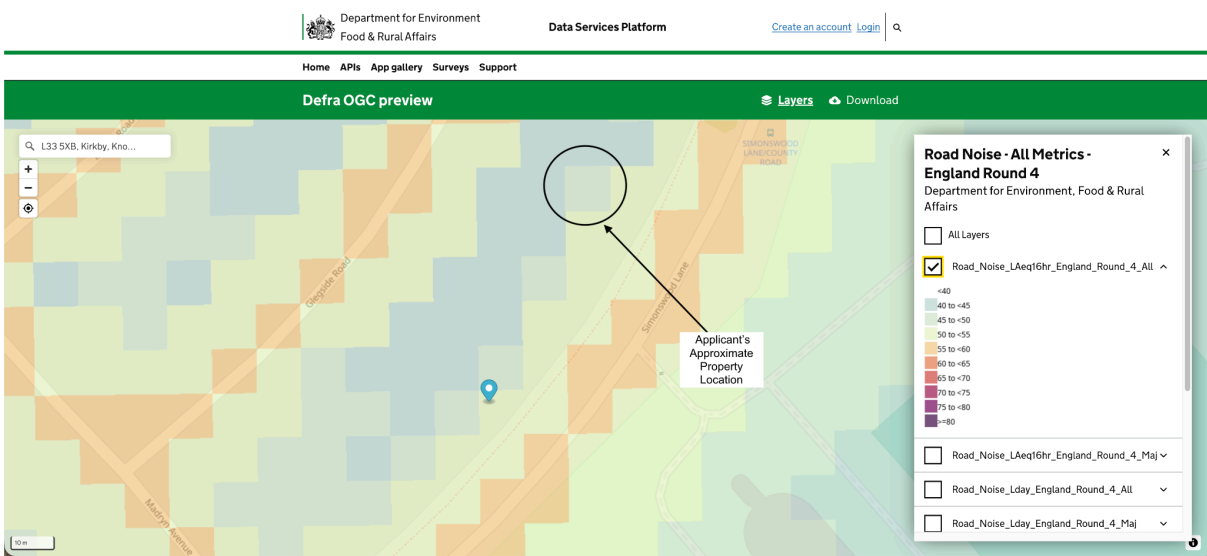

DEFRA Nighttime Noise Modeling:

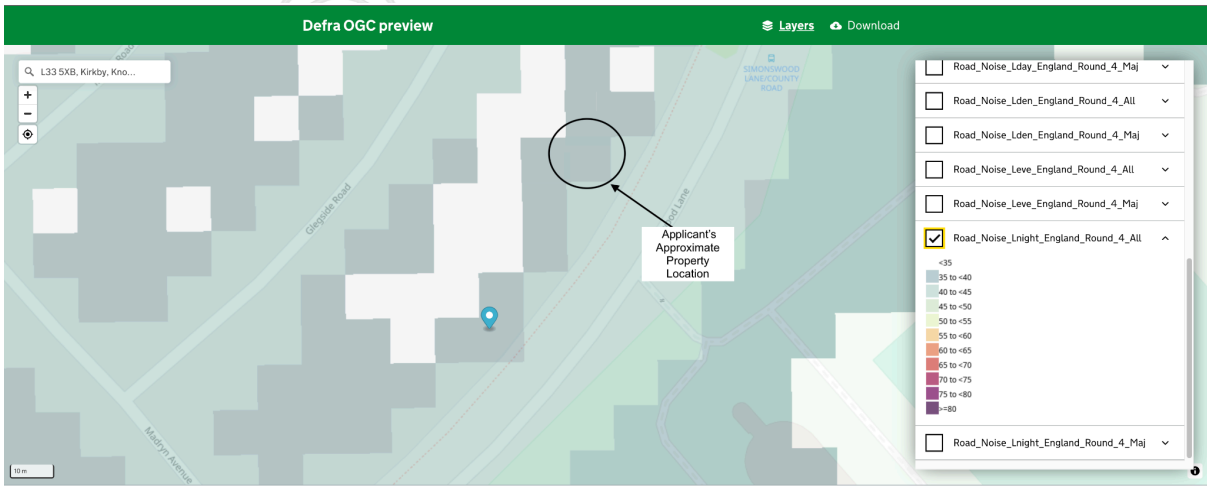

7. CONCLUSION

7.1. This comprehensive computational assessment demonstrates that the proposed installation of the Cosy 6 at 41 Slmonswood Lane complies with all relevant national planning policies regarding noise.


7.2. External Impact:

The worst-case Rating Level (37 dB) is lower than the prevailing ambient daytime noise levels (40–55 dB), and within the prevailing ambient nighttime noise levels (35-45 dB).

7.3. Internal Amenity:

The indoor noise level (27 dB) is well within the **BS 8233** sleep protection limit (30 dB).

7.4. The proposal preserves residential amenity and should be considered acceptable for planning approval.

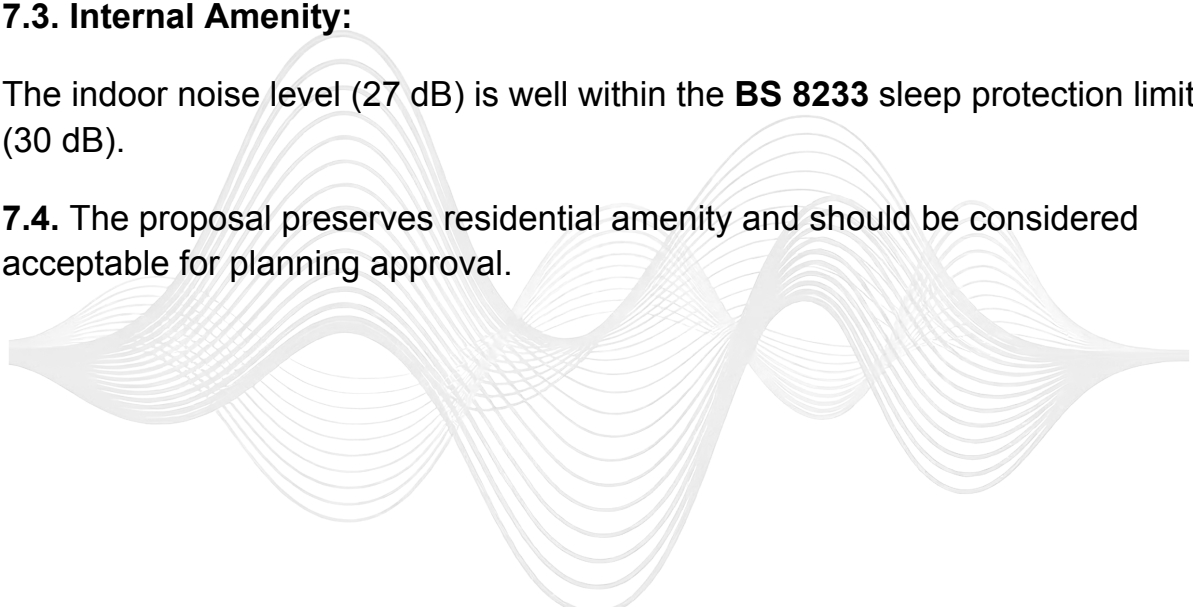

APPENDIX A: TECHNICAL REFERENCES AND MODELING DATA

A.1. SOURCE NOISE DATA SPECIFICATION

- **Unit Model:** Cosy 6 Air Source Heat Pump.
- **Spectral Data:** Full octave band data (125Hz - 8kHz) has been utilized for the calculation rather than a single weighted figure to ensure low-frequency content is accurately propagated.
- **Reference Pressure:** 0 dB = 20μPa.

A.2. LEGISLATIVE AND STANDARDS FRAMEWORK

- **NPPF (2024):** Paragraph 198 mandates that planning decisions must "mitigate and reduce to a minimum potential adverse impacts resulting from noise from new development".
- **NPSE:** Defines NOAEL (No Observed Adverse Effect Level); results place this development within this acceptable range where no significant adverse impact occurs.
- **BS 8233:2014:** Recommends a criterion of 30dB LAeq,8hr for sleeping conditions in bedrooms.
- **BS 4142:2014:** Methodology for rating and assessing industrial and commercial sound.


A.3. COMPUTATIONAL MODELING ASSUMPTIONS (ISO 9613-2)


- **Reflection Coefficient (0.982):** Applied to all vertical surfaces, assuming 98.2% of sound energy is reflected back into the environment.
- **Ground Factor (G=0):** Hard ground applied to the entire propagation path to negate soft ground attenuation, ensuring the predicted levels are conservative.
- **Directivity (Q=4):** Hemispherical radiation (Q=4) is assumed to account for source directivity resulting from installation in close proximity (250mm) to the reflective host facade as well as the ground.
- **Atmospheric Absorption:** Standard ISO conditions (10°C, 70%RH) applied.

A.4. GLOSSARY OF ACOUSTIC TERMS

- **dB(A):** A-weighted decibels; a logarithmic scale reflecting the frequency response of the human ear.

- **L_{Aeq,T}**: The "Equivalent Continuous Sound Level" over a specified time period "T".
- **Rating Level (L_{Ar}, Tr)**: The specific noise level of the source plus any adjustment for characteristic features.
- **Sound Power Level (L_W)**: The total sound energy radiated by a source per unit of time.

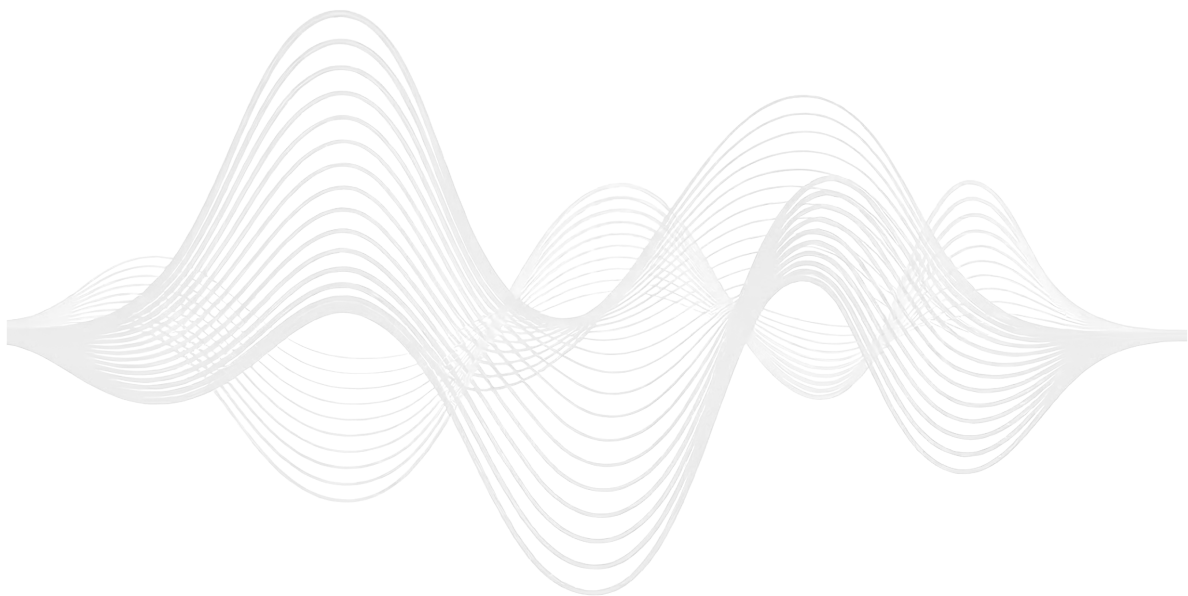








L33 5XB, Kirkby, Kno...

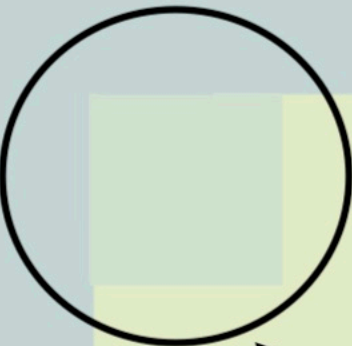

Applicant's
Approximate
Property
Location

Road Noise - All Metrics -
England Round 4

Department for Environment, Food & Rural
Affairs

☐ All Layers

☒ Road_Noise_LAeq16hr_England_Round_4_All ^


- <40
- 40 to <45
- 45 to <50
- 50 to <55
- 55 to <60
- 60 to <65
- 65 to <70
- 70 to <75
- 75 to <80
- >=80

☐ Road_Noise_LAeq16hr_England_Round_4_Maj v

☐ Road_Noise_Lday_England_Round_4_All v

☐ Road_Noise_Lday_England_Round_4_Maj v

 L33 5XB, Kirkby, Kno...

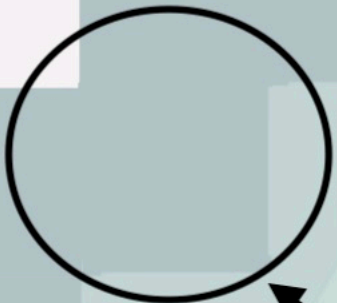

Applicant's
Approximate
Property
Location

☐ Road_Noise_Lday_England_Round_4_Maj 


☐ Road_Noise_Lden_England_Round_4_All 

☐ Road_Noise_Lden_England_Round_4_Maj 

☐ Road_Noise_Leve_England_Round_4_All 

☐ Road_Noise_Leve_England_Round_4_Maj 

☒ Road_Noise_Lnight_England_Round_4_All 

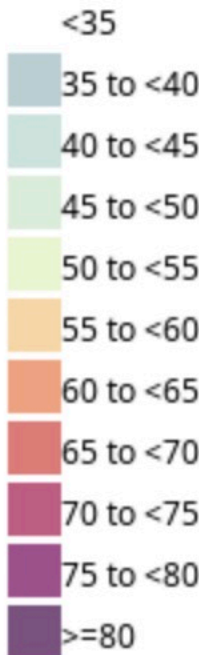

☐ Road_Noise_Lnight_England_Round_4_Maj 

10 m

Noise Mapping Results																		
--- Receiver Results - Summary ---																		
Receiver Name	Height (m)	Total dB(A)		63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz							
Assessment Points -1		1.5	28.58		11.59	19.07	25.26	24	13.94	11.27	-0.59							
Assessment Points -2		4.7	37.01		13.19	24.52	32.94	33.25	24.8	24.82	15.94							
Assessment Points -3		4.7	32.63		7.07	20.54	28.9	28.16	21.24	21.2	12.1							
Assessment Points -4		4.4	35.55		17.29	25.86	32.09	30.88	21.87	21.38	12.22							
Assessment Points -7		1.1	23.67		8.93	15.25	18.95	19.84	9.72	7.98	-2.37							
Assessment Points -6		4.4	28.96		8.46	18.62	23.31	25.78	16.71	17.84	8.21							
Assessment Points -5		1.1	30.64		16.51	23.14	27.41	24.87	14.17	13.3	4.3							
--- Receiver Results - Sources Analysis ---																		
Receiver Name	Height (m)	Total dB(A)		Cosy 6														
Assessment Points -1		1.5	28.58	28.58														
Assessment Points -2		4.7	37.01	37.01														
Assessment Points -3		4.7	32.63	32.63														
Assessment Points -4		4.4	35.55	35.55														
Assessment Points -7		1.1	23.67	23.67														
Assessment Points -6		4.4	28.96	28.96														
Assessment Points -5		1.1	30.64	30.64														
--- Receiver Results - Full Detail ---																		
Receiver Name	Source Name	Distance to source (m)	Height including ground level (m)	Source height including ground level (m)	Frequency (Hz)	Lw	Ad	Aa	Ag	Ab (total)	Ab (top edge)	Ab (lateral 1)	Ab (lateral 2)	Adjustment	Weighting	Lp		
Assessment Points -1	Cosy 6	8.9	1.5	0.6	500	57.6	-29.99	-0.02	2.9	-7.17	-9.45	-11.07		2	-3.2	22.12		
Assessment Points -1	Cosy 6 (reflected by 41 Simonswood Lane)	9.24	1.5	0.6	500	57.51	-30.32	-0.02	2.91	-9.34	-9.34			2	-3.2	19.55		
Assessment Points -1	Cosy 6	8.9	1.5	0.6	1000	53.7	-29.99	-0.04	2.9	-9.48	-11.65	-13.54		2	0	19.1		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence)	10.1	1.5	0.6	500	57.51	-31.08	-0.02	2.93	-9.13	-9.13			2	-3.2	19.01		
Assessment Points -1	Cosy 6	8.9	1.5	0.6	250	56.4	-29.99	-0.01	2.9	-5.29	-7.71	-8.97		2	-8.6	17.42		
Assessment Points -1	Cosy 6 (reflected by 41 Simonswood Lane)	9.24	1.5	0.6	1000	53.61	-30.32	-0.04	2.91	-11.51	-11.51			2	0	16.66		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence)	10.1	1.5	0.6	1000	53.61	-31.08	-0.04	2.93	-11.26	-11.26			2	0	16.16		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence + 41 Simonswood Lane)	10.4	1.5	0.6	1000	53.52	-31.34	-0.04	2.93	-11.15	-11.15			2	0	15.92		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence)	10.1	1.5	0.6	250	56.31	-31.08	-0.01	2.93	-7.47	-7.47			2	-8.6	14.07		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence)	18.39	1.5	0.6	1000	53.61	-36.29	-0.07	2.98	-9.18	-9.18			2	0	13.05		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence + Boundary Fence)	18.97	1.5	0.6	1000	53.52	-36.56	-0.08	2.98	-9.14	-9.14			2	0	12.73		
Assessment Points -1	Cosy 6	8.9	1.5	0.6	125	55.1	-29.99	0	2.9	-3.89	-6.48	-7.36		2	-16.1	10.02		
Assessment Points -1	Cosy 6	8.9	1.5	0.6	2000	44.1	-29.99	-0.08	2.9	-12.09	-14.19	-16.25		2	1.2	8.05		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence)	10.1	1.5	0.6	125	55.01	-31.08	0	2.93	-6.33	-6.33			2	-16.1	6.42		
Assessment Points -1	Cosy 6 (reflected by 41 Simonswood Lane)	9.24	1.5	0.6	2000	44.01	-30.32	-0.08	2.91	-14.04	-14.04			2	1.2	5.69		
Assessment Points -1	Cosy 6	8.9	1.5	0.6	4000	44.5	-29.99	-0.23	2.9	-14.88	-16.94	-19.1		2	1	5.3		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence)	10.1	1.5	0.6	2000	44.01	-31.08	-0.09	2.93	-13.75	-13.75			2	1.2	5.22		
Assessment Points -1	Cosy 6 (reflected by 39 Simonswood Cnsv)	17.47	1.5	0.6	500	57.51	-35.85	-0.04	2.97	-18.21	-18.21			2	-3.2	5.19		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence + 41 Simonswood Lane)	10.4	1.5	0.6	2000	43.92	-31.34	-0.09	2.93	-13.63	-13.63			2	1.2	4.99		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence Incl Step + 39 Simonswood Cnsv)	30.4	1.5	0.6	1000	53.52	-40.66	-0.12	2.99	-13.28	-13.28			2	0	4.46		
Assessment Points -1	Cosy 6 (reflected by 41 Simonswood Lane)	9.24	1.5	0.6	4000	44.41	-30.32	-0.24	2.91	-16.78	-16.78			2	1	2.98		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence)	10.1	1.5	0.6	4000	44.41	-31.08	-0.27	2.93	-16.48	-16.48			2	1	2.51		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence)	18.39	1.5	0.6	2000	44.01	-36.29	-0.16	2.98	-11.32	-11.32			2	1.2	2.42		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence + 41 Simonswood Lane)	10.4	1.5	0.6	4000	44.32	-31.34	-0.27	2.93	-16.35	-16.35			2	1	2.29		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence + Boundary Fence)	18.97	1.5	0.6	2000	43.92	-36.56	-0.16	2.98	-11.27	-11.27			2	1.2	2.11		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence + Barrier-3)	20.18	1.5	0.6	2000	43.92	-37.1	-0.17	2.98	-10.93	-10.93			2	1.2	1.9		
Assessment Points -1	Cosy 6 (reflected by 41 Simonswood Lane + Boundary Fence)	20.95	1.5	0.6	2000	43.92	-37.43	-0.18	2.98	-10.79	-10.79			2	1.2	1.71		
Assessment Points -1	Cosy 6 (reflected by 39 Simonswood Cnsv)	17.47	1.5	0.6	1000	53.61	-35.85	-0.07	2.97	-21.43	-21.43			2	0	1.25		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence Incl Step + Boundary Fence)	23.01	1.5	0.6	2000	43.92	-38.24	-0.2	2.99	-11.8	-11.8			2	1.2	-0.13		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence)	18.39	1.5	0.6	4000	44.41	-36.29	-0.48	2.98	-13.83	-13.83			2	1	-0.21		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence + Boundary Fence)	18.97	1.5	0.6	4000	44.32	-36.56	-0.5	2.98	-13.77	-13.77			2	1	-0.52		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence + Barrier-3)	20.18	1.5	0.6	4000	44.32	-37.1	-0.53	2.98	-13.38	-13.38			2	1	-0.71		
Assessment Points -1	Cosy 6 (reflected by 41 Simonswood Lane + Boundary Fence)	20.95	1.5	0.6	4000	44.32	-37.43	-0.55	2.98	-13.22	-13.22			2	1	-0.89		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence + 43 Simonswood Lane)	20.23	1.5	0.6	2000	43.92	-37.12	-0.17	2.98	-15.48	-15.48			2	1.2	-2.67		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence Incl Step + Boundary Fence)	23.01	1.5	0.6	4000	44.32	-38.24	-0.6	2.99	-14.36	-14.36			2	1	-2.89		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence + 43 Simonswood Lane)	20.23	1.5	0.6	4000	44.32	-37.12	-0.53	2.98	-18.54	-18.54			2	1	-5.89		
Assessment Points -1	Cosy 6	8.9	1.5	0.6	8000	38.4	-29.99	-0.83	2.9	-17.77	-19.82	-22.03		2	-1.1	-6.39		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence Incl Step + 39 Simonswood Cnsv)	30.4	1.5	0.6	2000	43.92	-40.66	-0.26	2.99	-16.05	-16.05			2	1.2	-6.86		
Assessment Points -1	Cosy 6 (reflected by 41 Simonswood Lane)	9.24	1.5	0.6	8000	38.31	-30.32	-0.87	2.91	-19.66	-19.66			2	-1.1	-8.71		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence)	10.1	1.5	0.6	8000	38.31	-31.08	-0.94	2.93	-19.34	-19.34			2	-1.1	-9.23		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence + 41 Simonswood Lane)	10.4	1.5	0.6	8000	38.22	-31.34	-0.97	2.93	-19.21	-19.21			2	-1.1	-9.47		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence Incl Step + 39 Simonswood Cnsv)	30.4	1.5	0.6	4000	44.32	-40.66	-0.8	2.99	-18.92	-18.92			2	1	-10.06		
Assessment Points -1	Cosy 6 (reflected by 39 Simonswood Cnsv)	17.47	1.5	0.6	2000	44.01	-35.85	-0.15	2.97	-24.48	-24.48			2	1.2	-10.28		
Assessment Points -1	Cosy 6 (reflected by 39 Simonswood Cnsv)	17.47	1.5	0.6	4000	44.41	-35.85	-0.46	2.97	-25	-25			2	1	-10.92		
Assessment Points -1	Cosy 6 (reflected by 39 Simonswood Cnsv + 41 Simonswood Lane)	17.66	1.5	0.6	4000	44.32	-35.94	-0.46	2.98	-25	-25			2	1	-11.1		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence)	18.39	1.5	0.6	8000	38.31	-36.29	-1.72	2.98	-16.56	-16.56			2	-1.1	-12.38		
Assessment Points -1	Cosy 6 (reflected by Boundary Fence + Boundary Fence)	18.97																

Assessment Points -3	Cosy 6 (reflected by Boundary Fence + 41 Simonswood Lane)	13.92	4.7	0.6	2000	43.92	-33.88	-0.12	2.88	0	0					2	1.2	16.01
Assessment Points -3	Cosy 6 (reflected by Boundary Fence + 41 Simonswood Lane)	13.92	4.7	0.6	4000	44.32	-33.88	-0.37	2.88	0	0					2	1	15.96
Assessment Points -3	Cosy 6 (reflected by 39 Simonswood Cnsv)	20.88	4.7	0.6	500	57.51	-37.39	-0.05	2.95	-12.76	-12.76					2	-3.2	9.06
Assessment Points -3	Cosy 6	12.57	4.7	0.6	8000	38.4	-32.99	-1.18	2.85	0	0					2	-1.1	7.99
Assessment Points -3	Cosy 6	12.57	4.7	0.6	125	55.1	-32.99	0	2.85	-3.8	-3.8					2	-16.1	7.07
Assessment Points -3	Cosy 6 (reflected by Boundary Fence)	13.71	4.7	0.6	8000	38.31	-33.74	-1.28	2.88	0	0					2	-1.1	7.06
Assessment Points -3	Cosy 6 (reflected by Boundary Fence + 41 Simonswood Lane)	13.92	4.7	0.6	8000	38.22	-33.88	-1.3	2.88	0	0					2	-1.1	6.83
Assessment Points -3	Cosy 6 (reflected by 39 Simonswood Cnsv)	20.88	4.7	0.6	1000	53.61	-37.39	-0.08	2.95	-15.41	-15.41					2	0	5.67
Assessment Points -3	Cosy 6 (reflected by 39 Simonswood Cnsv)	20.88	4.7	0.6	2000	44.01	-37.39	-0.18	2.95	-18.23	-18.23					2	1.2	-5.64
Assessment Points -3	Cosy 6 (reflected by 39 Simonswood Cnsv)	20.88	4.7	0.6	4000	44.41	-37.39	-0.55	2.95	-20	-20					2	1	-7.59
Assessment Points -3	Cosy 6 (reflected by 39 Simonswood Cnsv)	20.88	4.7	0.6	8000	38.31	-37.39	-1.95	2.95	-20	-20					2	-1.1	-17.19
Assessment Points -3	Cosy 6 (reflected by 39 Simonswood Cnsv + 41 Simonswood Lane)	21.03	4.7	0.6	8000	38.22	-37.46	-1.97	2.95	-20	-20					2	-1.1	-17.35
Assessment Points -4	Cosy 6	4.38	4.4	0.6	500	57.6	-23.83	-0.01	2.15	-2.63	-4.82	-6.65				2	-3.2	32.09
Assessment Points -4	Cosy 6	4.38	4.4	0.6	1000	53.7	-23.83	-0.02	2.15	-3.13	-4.86	-7.95				2	0	30.88
Assessment Points -4	Cosy 6	4.38	4.4	0.6	250	56.4	-23.83	0	2.15	-2.26	-4.79	-5.81				2	-8.6	25.86
Assessment Points -4	Cosy 6	4.38	4.4	0.6	2000	44.1	-23.83	-0.04	2.15	-3.72	-4.95	-9.77				2	1.2	21.87
Assessment Points -4	Cosy 6	4.38	4.4	0.6	4000	44.5	-23.83	-0.12	2.15	-4.33	-5.14	-12.04				2	1	21.38
Assessment Points -4	Cosy 6	4.38	4.4	0.6	125	55.1	-23.83	0	2.15	-2.03	-4.78	-5.32				2	-16.1	17.29
Assessment Points -4	Cosy 6	4.38	4.4	0.6	8000	38.4	-23.83	-0.41	2.15	-4.99	-5.49	-14.62				2	-1.1	12.22
Assessment Points -7	Cosy 6	6.55	1.1	0.6	500	57.6	-27.33	-0.01	2.87	-13.9	-13.9					2	-3.2	18.03
Assessment Points -7	Cosy 6	6.55	1.1	0.6	1000	53.7	-27.33	-0.03	2.87	-16.63	-16.63					2	0	14.58
Assessment Points -7	Cosy 6	6.55	1.1	0.6	250	56.4	-27.33	-0.01	2.87	-11.39	-11.39					2	-8.6	13.95
Assessment Points -7	Cosy 6 (reflected by Boundary Fence Incl Step)	19.11	1.1	0.6	1000	53.61	-36.62	-0.08	2.98	-8.93	-8.93					2	0	12.97
Assessment Points -7	Cosy 6 (reflected by 41 Simonswood Lane + Boundary Fence Incl Step)	19.71	1.1	0.6	1000	53.52	-36.89	-0.08	2.99	-8.82	-8.82					2	0	12.71
Assessment Points -7	Cosy 6 (reflected by Boundary Fence + Boundary Fence Incl Step)	20.29	1.1	0.6	1000	53.52	-37.15	-0.08	2.99	-8.78	-8.78					2	0	12.5
Assessment Points -7	Cosy 6 (reflected by 39 Simonswood Lane)	8.13	1.1	0.6	500	57.51	-29.2	-0.02	2.92	-18.23	-18.23					2	-3.2	11.78
Assessment Points -7	Cosy 6 (reflected by 39 Simonswood Lane)	8.13	1.1	0.6	250	56.31	-29.2	-0.01	2.92	-14.02	-14.02					2	-8.6	9.39
Assessment Points -7	Cosy 6 (reflected by 39 Simonswood Cnsv + Boundary Fence)	13.62	1.1	0.6	1000	53.52	-33.68	-0.05	2.97	-16.68	-16.68					2	0	8.08
Assessment Points -7	Cosy 6	6.55	1.1	0.6	125	55.1	-27.33	0	2.87	-9.23	-9.23					2	-16.1	7.31
Assessment Points -7	Cosy 6 (reflected by 39 Simonswood Lane)	8.13	1.1	0.6	1000	53.61	-29.2	-0.03	2.92	-22.26	-22.26					2	0	7.03
Assessment Points -7	Cosy 6 (reflected by 39 Simonswood Lane)	8.13	1.1	0.6	125	55.01	-29.2	0	2.92	-10.75	-10.75					2	-16.1	3.87
Assessment Points -7	Cosy 6	6.55	1.1	0.6	2000	44.1	-27.33	-0.06	2.87	-19.5	-19.5					2	1.2	3.28
Assessment Points -7	Cosy 6	6.55	1.1	0.6	4000	44.5	-27.33	-0.17	2.87	-20	-20					2	1	2.87
Assessment Points -7	Cosy 6 (reflected by Boundary Fence Incl Step)	19.11	1.1	0.6	2000	44.01	-36.62	-0.16	2.98	-11.02	-11.02					2	1.2	2.39
Assessment Points -7	Cosy 6 (reflected by 41 Simonswood Lane + Boundary Fence Incl Step)	19.71	1.1	0.6	2000	43.92	-36.89	-0.17	2.99	-10.89	-10.89					2	1.2	2.16
Assessment Points -7	Cosy 6 (reflected by Boundary Fence + Boundary Fence Incl Step)	20.29	1.1	0.6	2000	43.92	-37.15	-0.18	2.99	-10.83	-10.83					2	1.2	1.95
Assessment Points -7	Cosy 6 (reflected by Boundary Fence Incl Step + Boundary Fence)	22.92	1.1	0.6	2000	43.92	-38.2	-0.2	2.99	-10.21	-10.21					2	1.2	1.5
Assessment Points -7	Cosy 6 (reflected by Boundary Fence Incl Step)	19.11	1.1	0.6	4000	44.41	-36.62	-0.5	2.98	-13.48	-13.48					2	1	-0.21
Assessment Points -7	Cosy 6 (reflected by 41 Simonswood Lane + Boundary Fence Incl Step)	19.71	1.1	0.6	4000	44.32	-36.89	-0.52	2.99	-13.33	-13.33					2	1	-0.43
Assessment Points -7	Cosy 6 (reflected by Boundary Fence + Boundary Fence Incl Step)	20.29	1.1	0.6	4000	44.32	-37.15	-0.53	2.99	-13.27	-13.27					2	1	-0.64
Assessment Points -7	Cosy 6 (reflected by Boundary Fence Incl Step + Boundary Fence)	22.92	1.1	0.6	4000	44.32	-38.2	-0.6	2.99	-12.56	-12.56					2	1	-1.05
Assessment Points -7	Cosy 6 (reflected by 39 Simonswood Cnsv + Boundary Fence)	13.62	1.1	0.6	2000	43.92	-33.68	-0.12	2.97	-19.54	-19.54					2	1.2	-3.25
Assessment Points -7	Cosy 6 (reflected by 39 Simonswood Cnsv + Boundary Fence)	13.62	1.1	0.6	4000	44.32	-33.68	-0.36	2.97	-20	-20					2	1	-3.74
Assessment Points -7	Cosy 6 (reflected by 39 Simonswood Lane)	8.13	1.1	0.6	4000	44.41	-29.2	-0.21	2.92	-25	-25					2	1	-4.09
Assessment Points -7	Cosy 6 (reflected by 39 Simonswood Lane)	8.13	1.1	0.6	2000	44.01	-29.2	-0.07	2.92	-25	-25					2	1.2	-4.15
Assessment Points -7	Cosy 6	6.55	1.1	0.6	8000	38.4	-27.33	-0.61	2.87	-20	-20					2	-1.1	-5.77
Assessment Points -7	Cosy 6 (reflected by Boundary Fence Incl Step)	19.11	1.1	0.6	8000	38.31	-36.62	-1.79	2.98	-16.19	-16.19					2	-1.1	-12.4
Assessment Points -7	Cosy 6 (reflected by 41 Simonswood Lane + Boundary Fence Incl Step)	19.71	1.1	0.6	8000	38.22	-36.89	-1.84	2.99	-16.03	-16.03					2	-1.1	-12.66
Assessment Points -7	Cosy 6 (reflected by 39 Simonswood Lane)	8.13	1.1	0.6	8000	38.31	-29.2	-0.76	2.92	-25	-25					2	-1.1	-12.84
Assessment Points -7	Cosy 6 (reflected by 39 Simonswood Cnsv + Boundary Fence)	13.62	1.1	0.6	8000	38.22	-33.68	-1.27	2.97	-20	-20					2	-1.1	-12.86
Assessment Points -7	Cosy 6 (reflected by Boundary Fence + Boundary Fence Incl Step)	20.29	1.1	0.6	8000	38.22	-37.15	-1.9	2.99	-15.97	-15.97					2	-1.1	-12.9
Assessment Points -7	Cosy 6 (reflected by Boundary Fence Incl Step + Boundary Fence)	22.92	1.1	0.6	8000	38.22	-38.2	-2.15	2.99	-15.19	-15.19					2	-1.1	-13.43
Assessment Points -7	Cosy 6 (reflected by 39 Simonswood Cnsv + Boundary Fence Incl Step)	27.63	1.1	0.6	2000	43.92	-39.83	-0.24	2.99	-24.39	-24.39					2	1.2	-14.34
Assessment Points -7	Cosy 6 (reflected by 39 Simonswood Cnsv + Boundary Fence Incl Step)	27.63	1.1	0.6	4000	44.32	-39.83	-0.73	2.99	-25	-25					2	1	-15.24
Assessment Points -7	Cosy 6 (reflected by 39 Simonswood Cnsv + Boundary Fence Incl Step)	27.63	1.1	0.6	8000	38.22	-39.83	-2.59	2.99	-25	-25					2	-1.1	-25.3
Assessment Points -6	Cosy 6 (reflected by Boundary Fence Incl Step)	19.61	4.4	0.6	1000	53.61	-36.85	-0.08	2.94	0	0					2	0	21.83
Assessment Points -6	Cosy 6 (reflected by Boundary Fence + Boundary Fence Incl Step)	20.79	4.4	0.6	1000	53.52	-37.36	-0.08	2.95	0	0					2	0	21.03
Assessment Points -6	Cosy 6	7.36	4.4	0.6	500	57.6	-28.34	-0.02	2.63	-10.11	-10.11					2	-3.2	20.56
Assessment Points -6	Cosy 6 (reflected by 39 Simonswood Lane)	7.75	4.4	0.6	500	57.51	-28.79	-0.02	2.66	-10.15	-10.15					2	-3.2	20.02
Assessment Points -6	Cosy 6	7.36	4.4	0.6	1000	53.7	-28.34	-0.03	2.63	-12.44	-12.44					2	0	17.53
Assessment Points -6	Cosy 6 (reflected by 39 Simonswood Lane)	7.75	4.4	0.6	1000	53.61	-28.79	-0.03	2.66	-12.48	-12.48					2	0	16.97
Assessment Points -6	Cosy 6	7.36	4.4	0.6	250	56.4	-28.34	-0.01	2.63	-8.22	-8.22					2	-8.6	15.87
Assessment Points -6	Cosy 6 (reflected by 39 Simonswood Lane)	7.75	4.4	0.6	250	56.31	-28.79	-0.01	2.66	-8.25	-8.25					2	-8.6	15.33
Assessment Points -6	Cosy 6 (reflected by Boundary Fence Incl Step)	19.61	4.4	0.6	2000	44.01	-36.85	-0.17	2.94	0	0					2	1.2	13.14
Assessment Points -6	Cosy 6 (reflected by Boundary Fence Incl Step)	19.61	4.4	0.6	4000	44.41	-36.85	-0.52	2.94	0	0					2	1	12.99
Assessment Points -6	Cosy 6 (reflected by Boundary Fence Incl Step + 41 Simonswood Lane)	19.76	4.4	0.6	4000	44.32	-36.92	-0.52	2.94	0	0					2	1	12.83
Assessment Points -6	Cosy 6 (reflected by Boundary Fence + Boundary Fence Incl Step)	20.79	4.4	0.6	2000	43.92	-37.36	-0.18	2.95	0	0					2	1.2	12.54
Assessment Points -6	Cosy 6 (reflected by Boundary Fence + Boundary Fence Incl Step)	20.79	4.4	0.6	4000	44.32	-37.36	-0.55	2.95	0	0					2	1	12.37
Assessment Points -6	Cosy 6	7.36	4.4	0.6	125	55.1	-28.34	0	2.63	-6.83	-6.83					2	-16.1	8.46
Assessment Points -6	Cosy 6	7.36	4.4	0.6	2000	44.1	-28.34	-0.06	2.63	-15.06	-15.06					2	1.2	6.47
Assessment Points -6	Cosy 6 (reflected by 39 Simonswood Lane)	7.75	4.4	0.6	2000	44.01	-28.79	-0.07	2.66	-15.11	-15.11					2	1.2	5.91
Assessment Points -6	Cosy 6	7.36	4.4	0.6	4000	44.5	-28.34	-0.19	2.63	-17.86	-17.86					2	1	3.74
Assessment Points -6	Cosy 6 (reflected by Boundary Fence Incl Step)	19.61	4.4	0.6	8000	38.31	-36.85	-1.84	2.94	0	0					2	-1.1	3.47
Assessment Points -6	Cosy 6 (reflected by Boundary Fence Incl Step + 41 Simonswood Lane)	19.76	4.4	0.6	8000	38.22	-36.92	-1.85	2.94	0	0					2	-1.1	3.3
Assessment Points -6	Cosy 6 (reflected by 39 Simonswood Lane)	7.75	4.4	0.6	4000	44.41	-28.79	-0.2	2.66	-17.91	-17.91					2	1	3.17
Assessment Points -6	Cosy 6 (reflected by Boundary Fence + Boundary Fence Incl Step)	20.79	4.4	0.6	8000	38.22	-37.36	-1.95	2.95	0	0					2	-1.1	2.77
Assessment Points -6	Cosy 6	7.36	4.4	0.6	8000	38.4	-28.34	-0.69	2.63	-20	-20					2	-1.1	-7.1
Assessment Points -6	Cosy 6 (reflected by 39 Simonswood Lane)	7.75	4.4	0.6	8000	38.31	-											

Assessment Points -5	Cosy 6 (reflected by 39 Simonswood Cnsv + Boundary Fence Incl Step)	24.75	1.1	0.6	1000	53.52	-38.87	-0.1	2.99	-21.65	-21.65					2	0	-2.1
Assessment Points -5	Cosy 6 (reflected by 39 Simonswood Lane)	4.35	1.1	0.6	8000	38.31	-23.76	-0.41	2.73	-20	-20					2	-1.1	-2.23
Assessment Points -5	Cosy 6 (reflected by 39 Simonswood Cnsv)	5.4	1.1	0.6	8000	38.31	-25.66	-0.51	2.82	-20	-20					2	-1.1	-4.13
Assessment Points -5	Cosy 6 (reflected by 39 Simonswood Lane + 39 Simonswood Cnsv)	6.14	1.1	0.6	8000	38.22	-26.77	-0.57	2.86	-20	-20					2	-1.1	-5.36
Assessment Points -5	Cosy 6 (reflected by 39 Simonswood Cnsv + Boundary Fence)	10.61	1.1	0.6	8000	38.22	-31.52	-0.99	2.95	-20	-20					2	-1.1	-10.43
Assessment Points -5	Cosy 6 (reflected by Boundary Fence Incl Step + 39 Simonswood Cnsv)	18.33	1.1	0.6	8000	38.22	-36.26	-1.72	2.98	-16.52	-16.52					2	-1.1	-12.39
Assessment Points -5	Cosy 6 (reflected by Boundary Fence Incl Step)	16.16	1.1	0.6	8000	38.31	-35.17	-1.51	2.98	-18.13	-18.13					2	-1.1	-12.61
Assessment Points -5	Cosy 6 (reflected by Boundary Fence Incl Step + 41 Simonswood Lane)	16.42	1.1	0.6	8000	38.22	-35.31	-1.54	2.98	-18.05	-18.05					2	-1.1	-12.79
Assessment Points -5	Cosy 6 (reflected by Boundary Fence + Boundary Fence Incl Step)	17.36	1.1	0.6	8000	38.22	-35.79	-1.62	2.98	-17.99	-17.99					2	-1.1	-13.3
Assessment Points -5	Cosy 6 (reflected by 39 Simonswood Cnsv + Boundary Fence Incl Step)	24.75	1.1	0.6	2000	43.92	-38.87	-0.21	2.99	-24.66	-24.66					2	1.2	-13.62
Assessment Points -5	Cosy 6 (reflected by 39 Simonswood Cnsv + Boundary Fence Incl Step)	24.75	1.1	0.6	4000	44.32	-38.87	-0.65	2.99	-25	-25					2	1	-14.2
Assessment Points -5	Cosy 6 (reflected by Boundary Fence Incl Step + Boundary Fence)	22.54	1.1	0.6	8000	38.22	-38.06	-2.11	2.99	-16.48	-16.48					2	-1.1	-14.53
Assessment Points -5	Cosy 6 (reflected by 39 Simonswood Cnsv + Boundary Fence Incl Step)	24.75	1.1	0.6	8000	38.22	-38.87	-2.32	2.99	-25	-25					2	-1.1	-24.07
---	---																	
---	---																	
---	---																	
Source Name	Height (m)	Total dB(A)	63 Hz	125 Hz	250 Hz	500 Hz	1 kHz	2 kHz	4 kHz	8 kHz								
Cosy 6		0.6	60.15		57.1	58.4	59.6	55.7	46.1	46.5	40.4							
---	---																	
---	---																	
Receivers	x	y	Height															
Assessment Points -1		67.53	37.17	1.5														
Assessment Points -2		67.39	37.41	4.7														
Assessment Points -3		69.28	34.7	4.7														
Assessment Points -4		61.44	46.3	4.4														
Assessment Points -7		56.7	47.73	1.1														
Assessment Points -6		59.03	49.7	4.4														
Assessment Points -5		60.41	46.91	1.1														
Point Sources	x	y	Height	Lw	Hz	Adjust Level												
Cosy 6		62.25	44.28	0.6	-	63	2											
-	-	-	-		55.1	125												
-	-	-	-		56.4	250												
-	-	-	-		57.6	500												
-	-	-	-		53.7	1000												
-	-	-	-		44.1	2000												
-	-	-	-		44.5	4000												
-	-	-	-		38.4	8000												
Barriers	x	y	Height	Reflection Coefficient	Hz													
Boundary Fence Incl Step		67.02	39.7	2.1	0.98	63												
-		59.41	34.52	-	0.98	125												
-	-	-	-		0.98	250												
-	-	-	-		0.98	500												
-	-	-	-		0.98	1000												
-	-	-	-		0.98	2000												
-	-	-	-		0.98	4000												
-	-	-	-		0.98	8000												
Boundary Fence		59.31	34.52	1.8	0.98	63												
-		55.52	40.41	-	0.98	125												
-		63.10938	45.59375	-	0.98	250												
-	-	-	-		0.98	500												
-	-	-	-		0.98	1000												
-	-	-	-		0.98	2000												
-	-	-	-		0.98	4000												
-	-	-	-		0.98	8000												
Barrier-3		67.08	39.7	1.8	0.98	63												
-		68.23	37.95	-	0.98	125												
-	-	-	-		0.98	250												
-	-	-	-		0.98	500												
-	-	-	-		0.98	1000												
-	-	-	-		0.98	2000												
-	-	-	-		0.98	4000												
-	-	-	-		0.98	8000												
Buildings	x	y	Height	Reflection Coefficient	Hz													
41 Simonswood Lane		72.25	43.23	5.2	0.98	63												
-		67.08	39.75	7.4	0.98	125												
-		63.08	45.58	-	0.98	250												
-		68.3	49.14	-	0.98	500												
-	-	-	-		0.98	1000												
-	-	-	-		0.98	2000												
-	-	-	-		0.98	4000												
-	-	-	-		0.98	8000												
39 Simonswood Lane		58.92	51.71	5.2	0.98	63												
-		64.24	55.3	7.4	0.98	125												
-		68.26	49.12	-	0.98	250												
-		63.08	45.59	-	0.98	500												
-	-	-	-		0.98	1000												
-	-	-	-		0.98	2000												
-	-	-	-		0.98	4000												
-	-	-	-		0.98	8000												
43 Simonswood Lane		76.15	37.42	5.5	0.98	63												
-		71.02	33.9	7.7	0.98	125												
-		67.08	39.71	-	0.98	250												
-		72.28	43.23	-	0.98	500												
-	-	-	-		0.98	1000												
-	-	-	-		0.98	2000												
-	-	-	-		0.98	4000												
-	-	-	-		0.98	8000												
39 Simonswood Cnsv		56.4	49.99	2.3	0.98	63												
-		58.91	51.73	2.9	0.98	125												
-		61	48.65	-	0.98	250												
-		58.49	46.89	-	0.98	500												
-	-	-	-		0.98	1000												
-	-	-	-		0.98	2000												
-	-	-	-		0.98	4000												
-	-	-	-		0.98	8000												
---	---																	
---	---																	
General Calculation Method: ISO9613-2:2024																		
Hard Ground (Ground Factor = 0)																		
15.0°C Temperature																		
70% Humidity																		
Results are A-weighted																		
Second order reflections are included																		
Vertical edges (lateral paths) are included. Limited to convex paths. Lateral paths have distance limit applied (ISO17534-3)																		
---	---																	
---	---																	
Lw	Sound Power Level (dB)																	
Lp	Sound Pressure Level (dB)																	
Ad	Distance attenuation																	
Ab	Barrier attenuation																	
Ag	Ground effect																	
Aa	Air absorption																	