


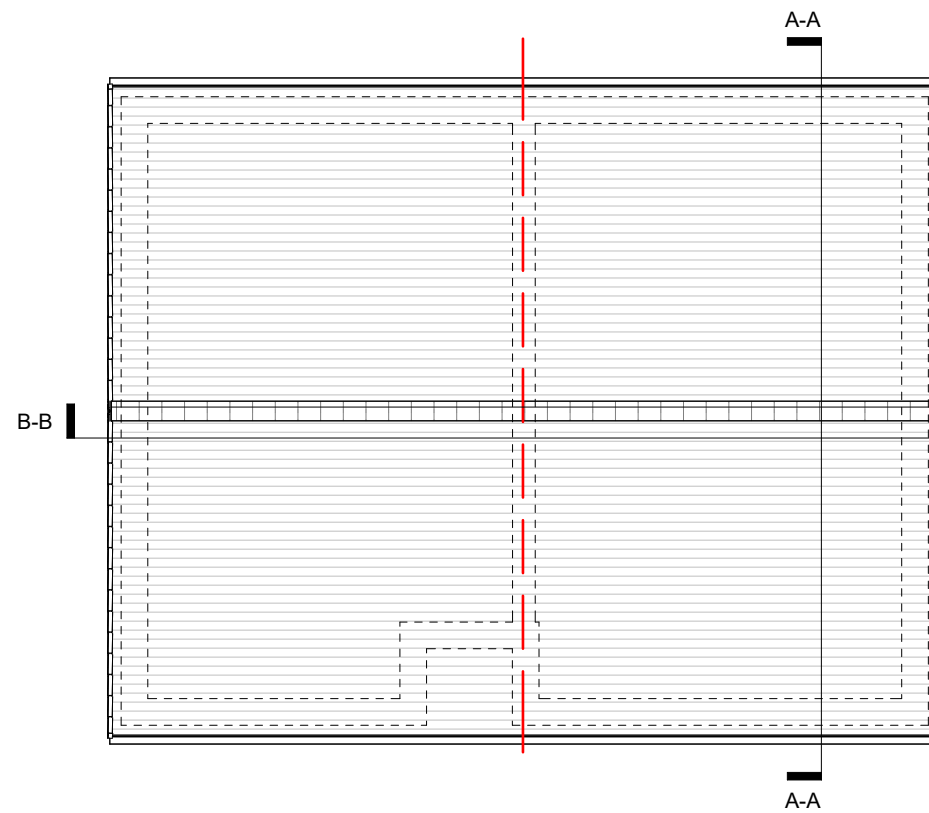

Materials Key	
	Vapour Check Vapour Barrier (Visqueen or Equal Approved) - All joints to be lapped by min 150mm and taped to prevent across migration.
	Single Sided jointing tape (Visqueen or equal approved).
	Double Sided jointing tape (Visqueen or equal approved).
	Visqueen Zedex High Performance CPT DPC
	Visqueen Randon R400 Membrane to be installed above beam and block floor, all joints are to be minimised and taped and lapped (min 150mm) in accordance with manufacturers recommendations and standard details.

NOTE: To be read in conjunction with S.E Drawings provided by SWF CONSULTANTS LTD issued on 16/12/20. Detail subject to S.E. comment / approval

NOTE: To be read in conjunction with SAP Assessment Report provided by Bridgewater Energy issued on 31/03/26.

B Minor Amendments To Partitions To Suit Part M4(2) Standards	JL	Jul '26
A Amended To Suit Eaves Detail	JL	Jun '26
* First Issue	JL	May '26

CONSTRUCTION

condy lofthouse
architects

Client	Built Group Ltd
Project	Lyme Grove, Longview, Huyton

Title		
Proposed GA Section A-A - House Plots 6-7		
Scale	Date	Drawn by
1:25@A1	May '26	J
Drawing No	Revision	
26-023-153		

Unit 17 Connect Business
Village
24 Derby Road
Liverpool L5
9PR

0151 207
4371
info@condyloffhouse.co.uk
www.condyloffhouse.co.uk

PLOT:
6 & 7

