





1 62-ZZ_Fire Water Storage Tank Location
1 : 100

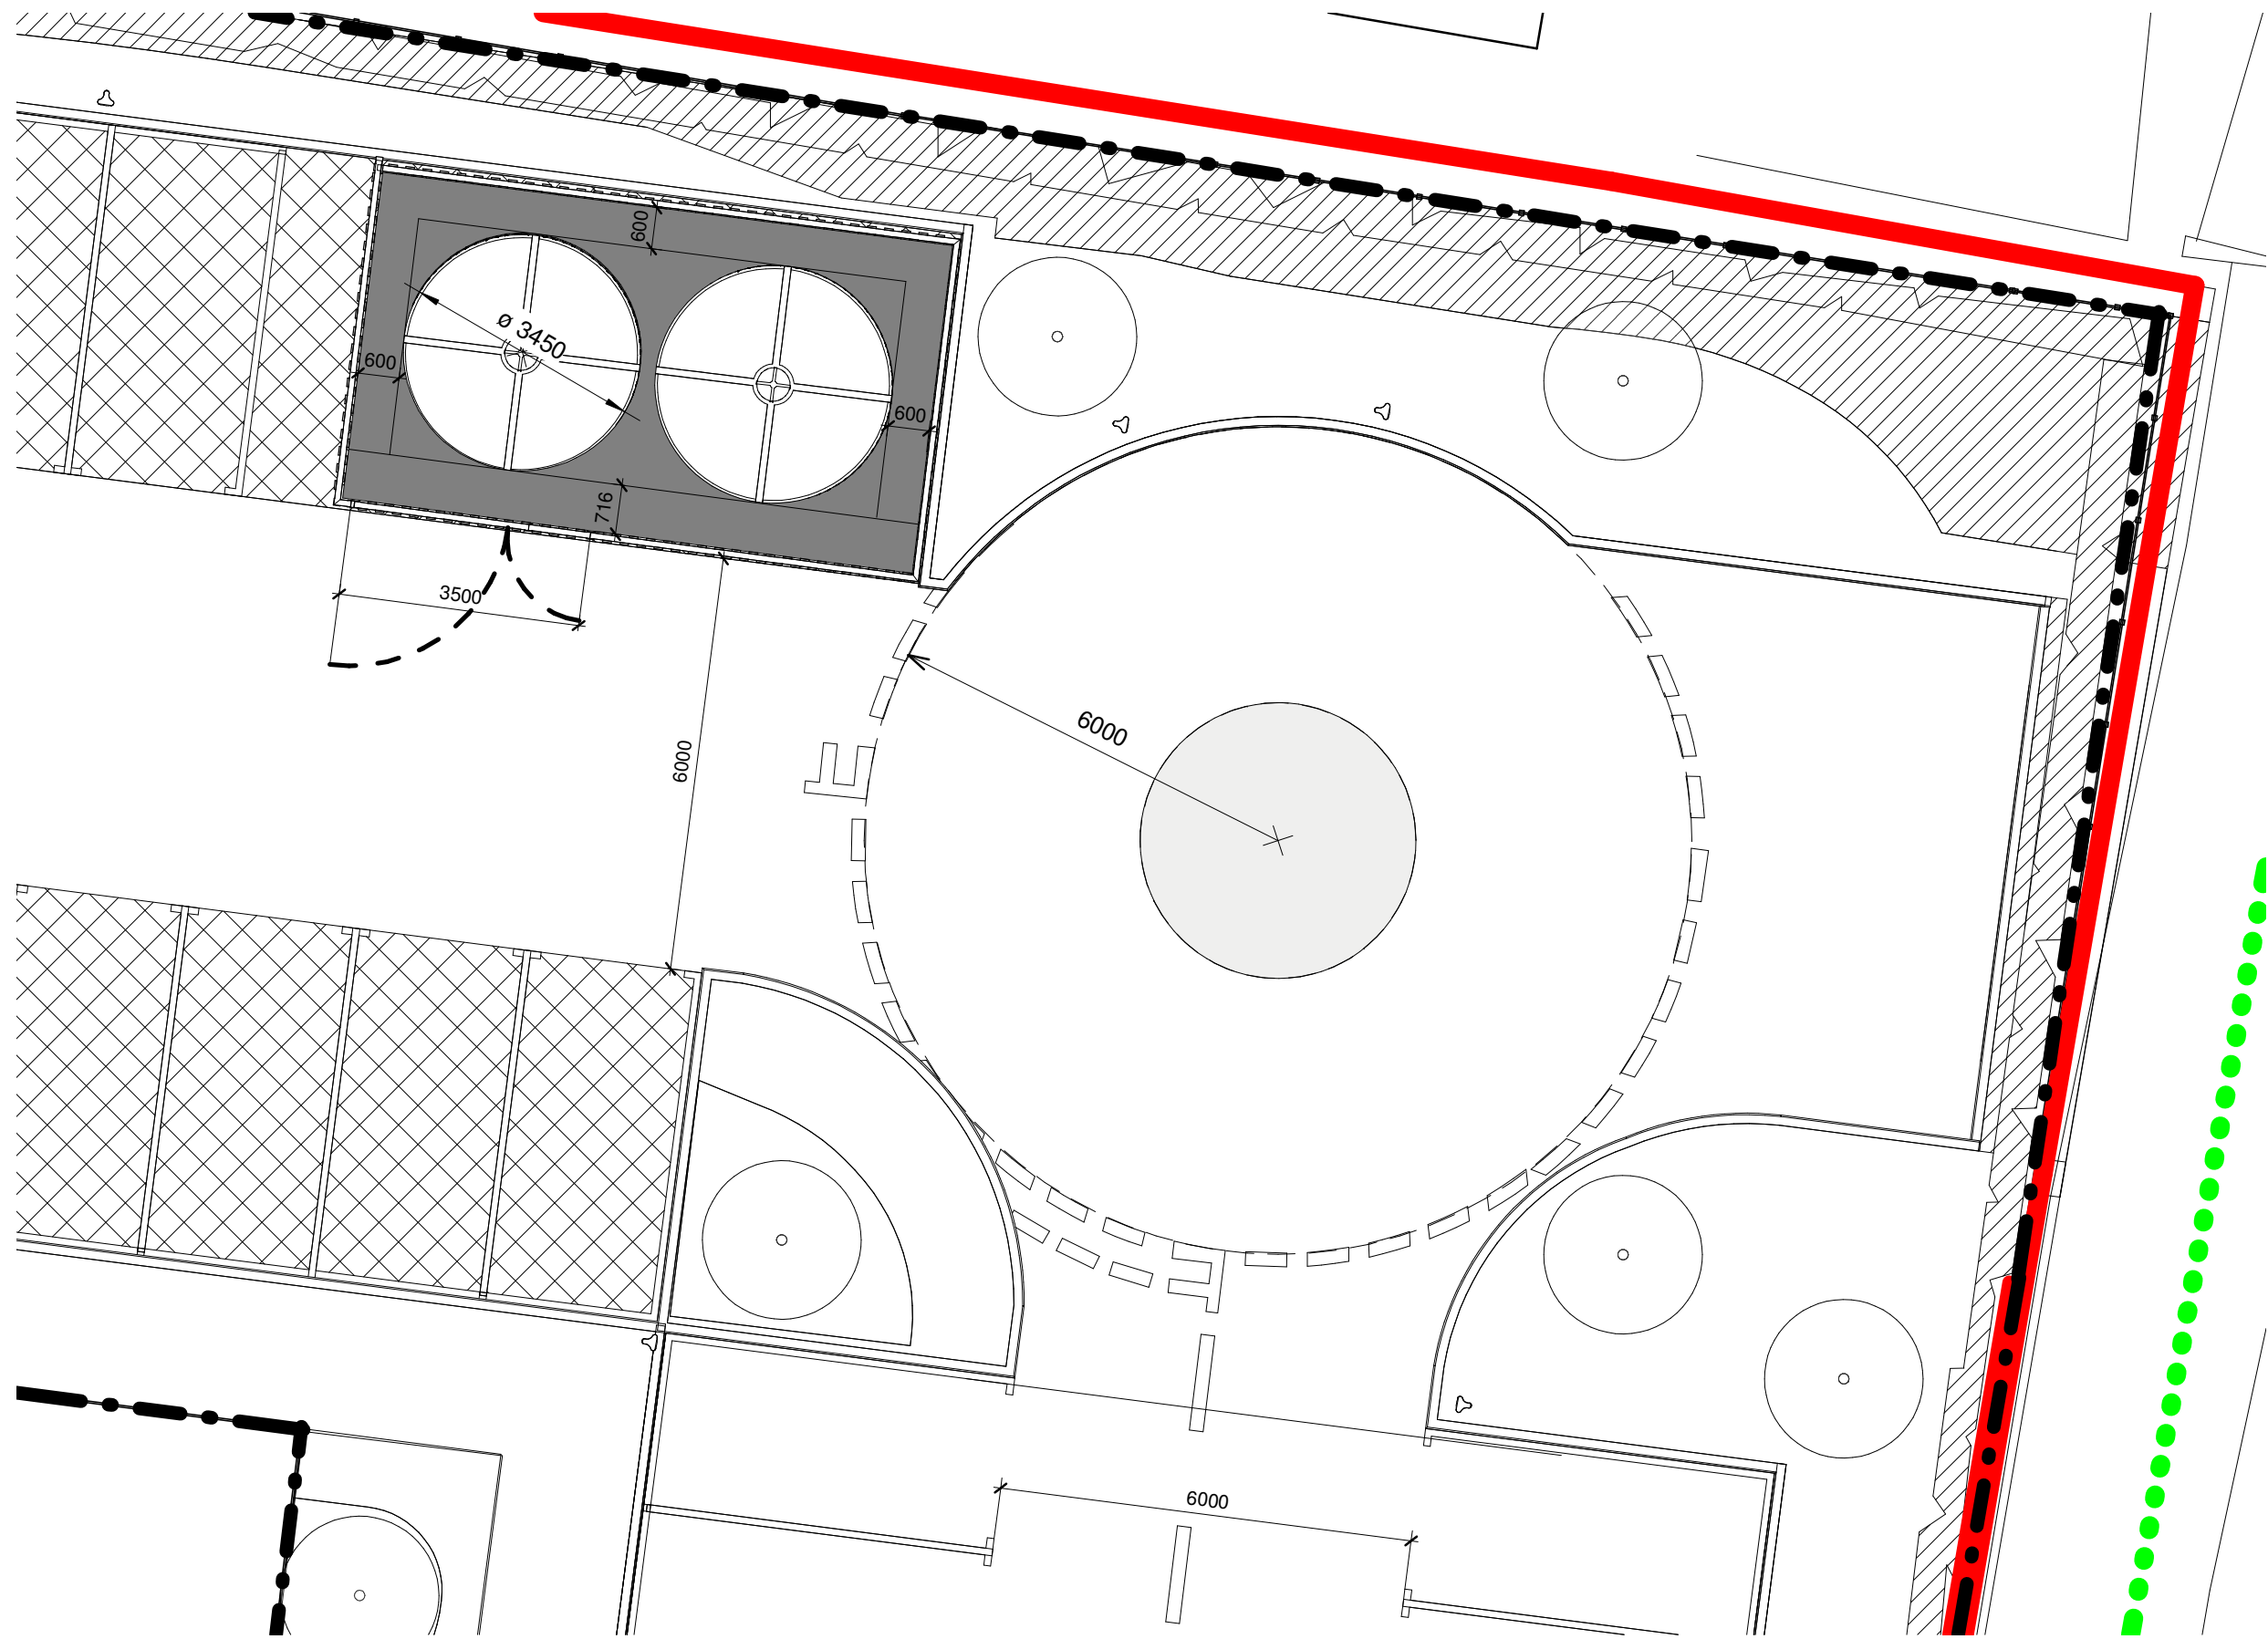


7 62-ZZ_3D View of Proposed Water Tank

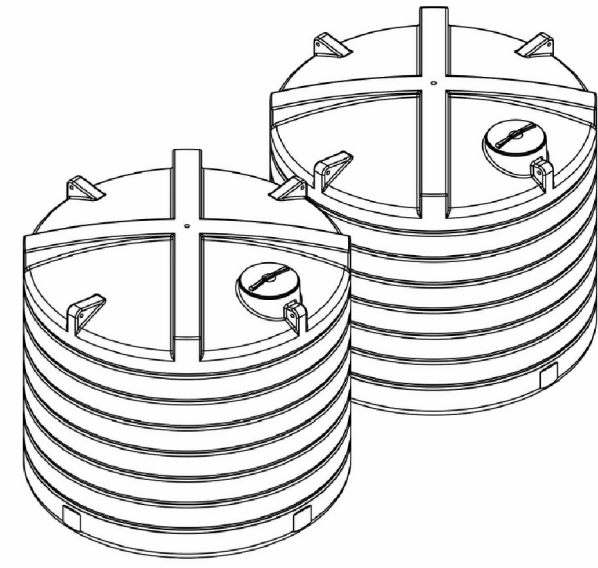


50,000 LITRE WATER TANK COMBINATION TECHNICAL SPECIFICATION

CODE	172180LP	STANDARD OUTLET	2"
CAPACITY (Litres)	50000	CAPACITY (Gallons)	13208

A (mm)	3450	B (mm)	620
C (mm)	3200	D (mm)	7900

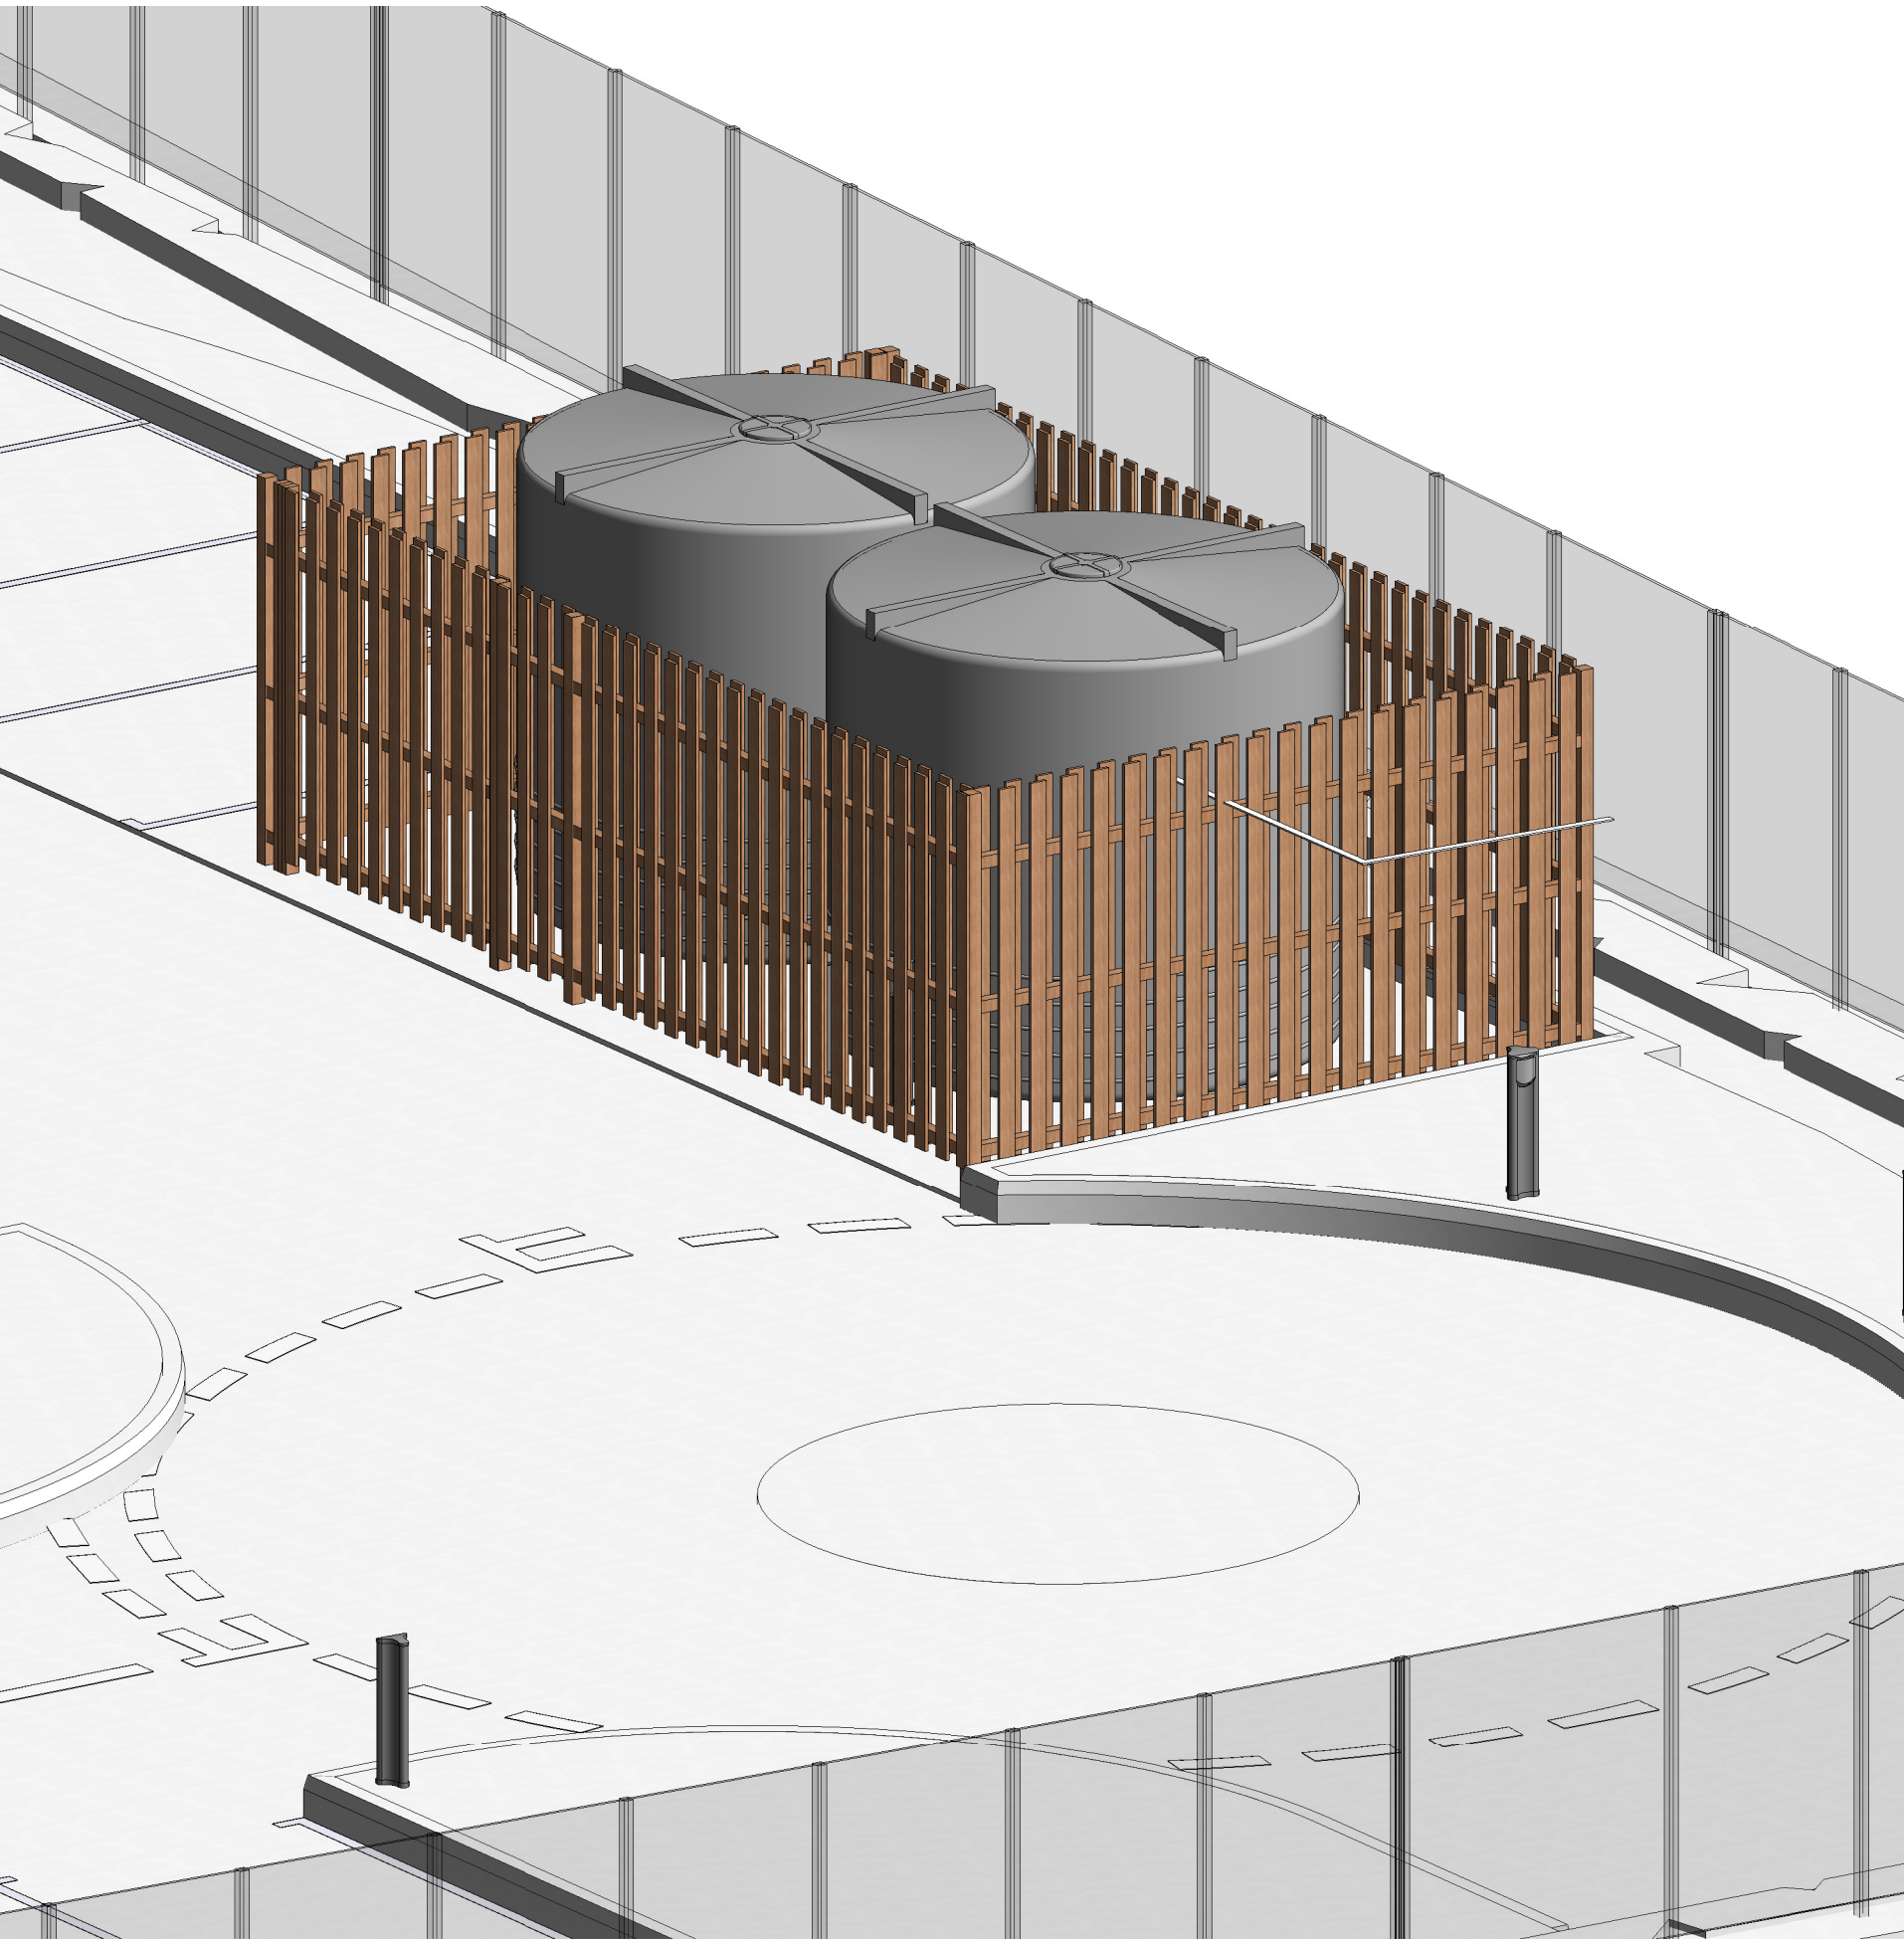


2 62-ZZ_Fire Storage Tank 3D View

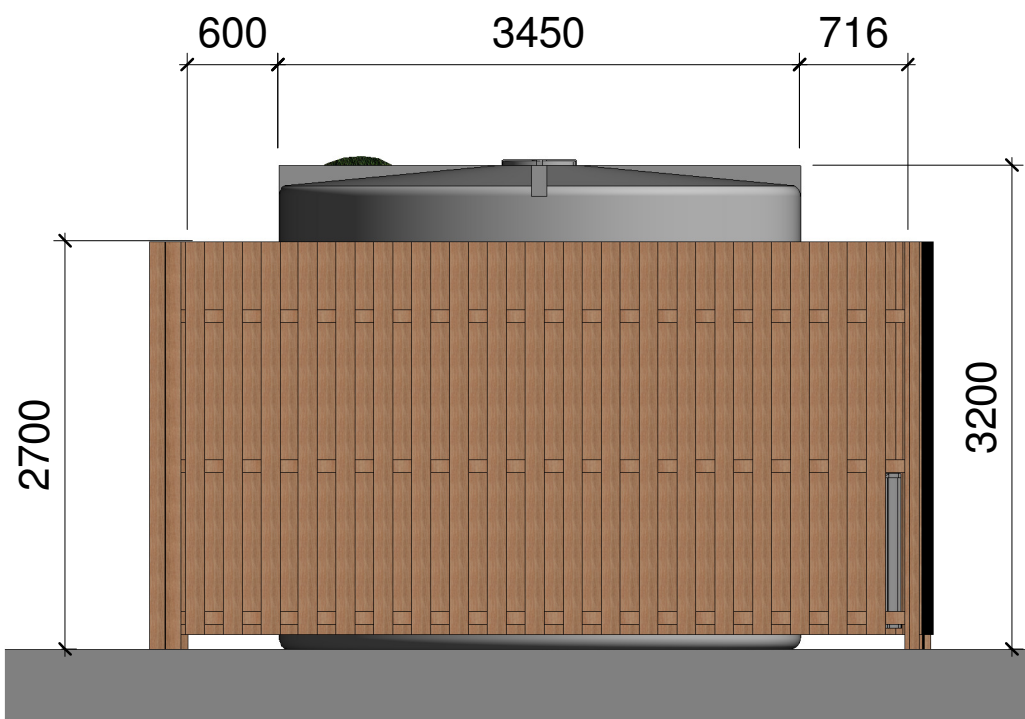


5 62-ZZ_Fire Storage Tank Left Side Elevation
1 : 50


Hit and Miss Timber Fence
Compound to Match Timber
on Proposed School

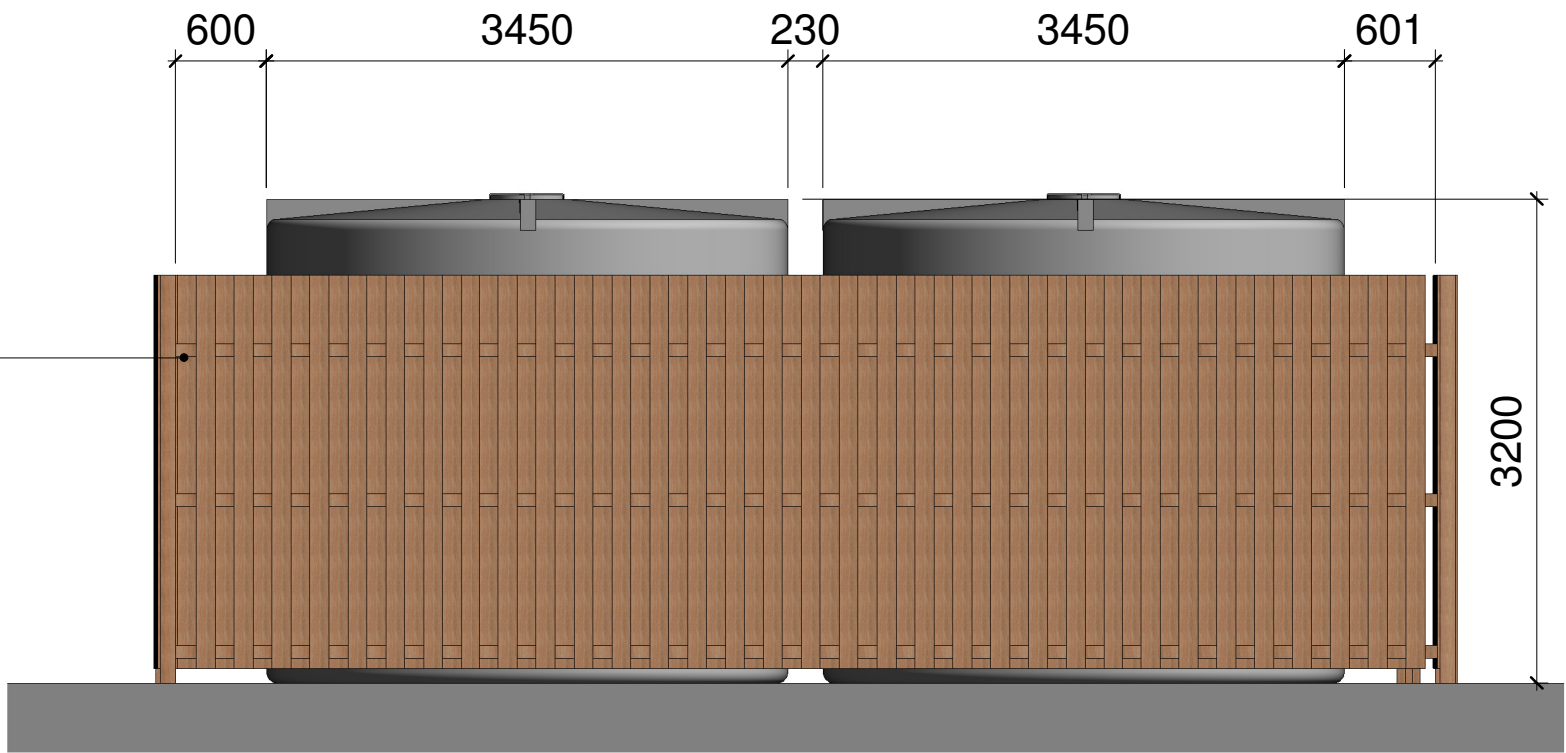

6 62-ZZ_Fire Storage Tank Rear Elevation
1 : 50

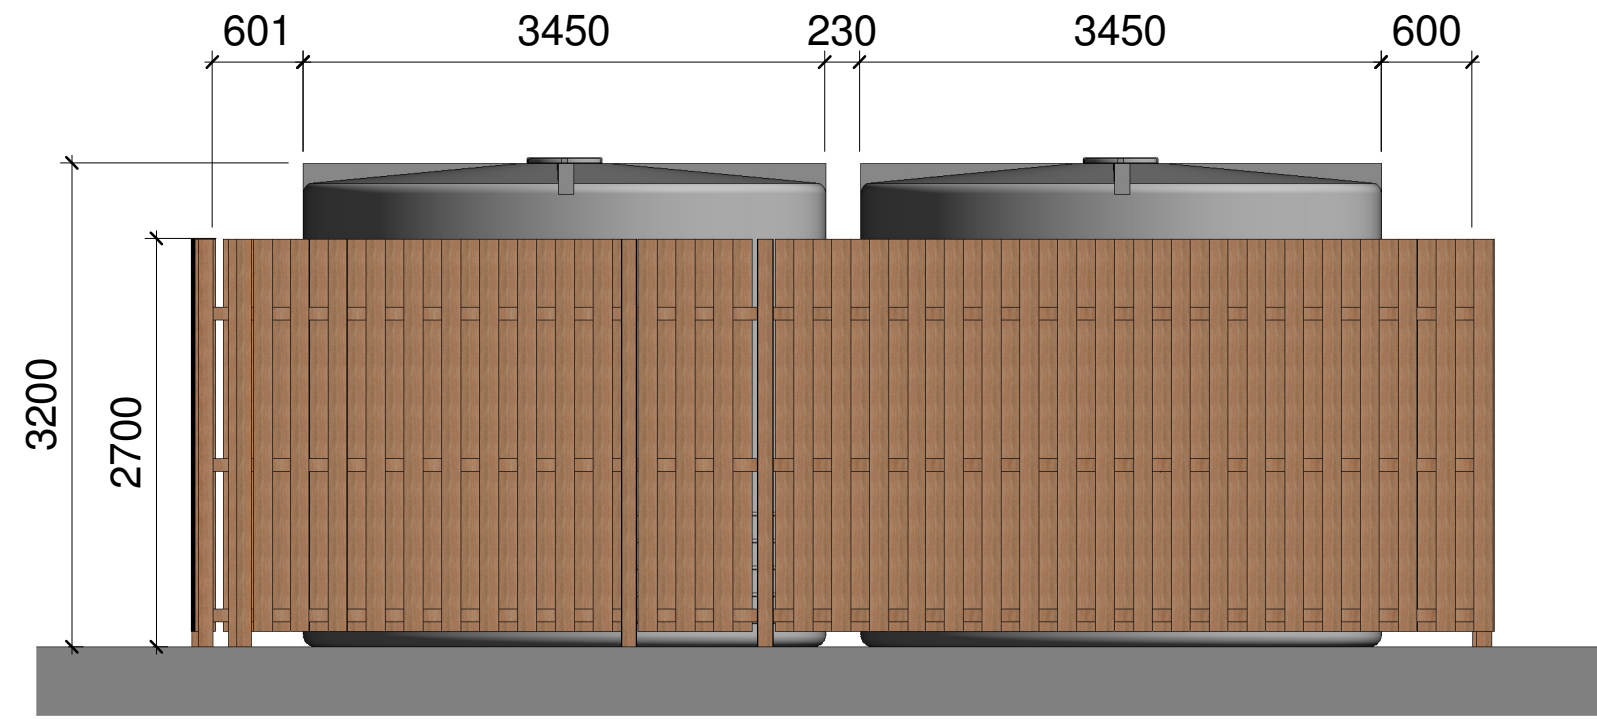

3 62-ZZ_Fire Storage Tank Front Elevation
1 : 50

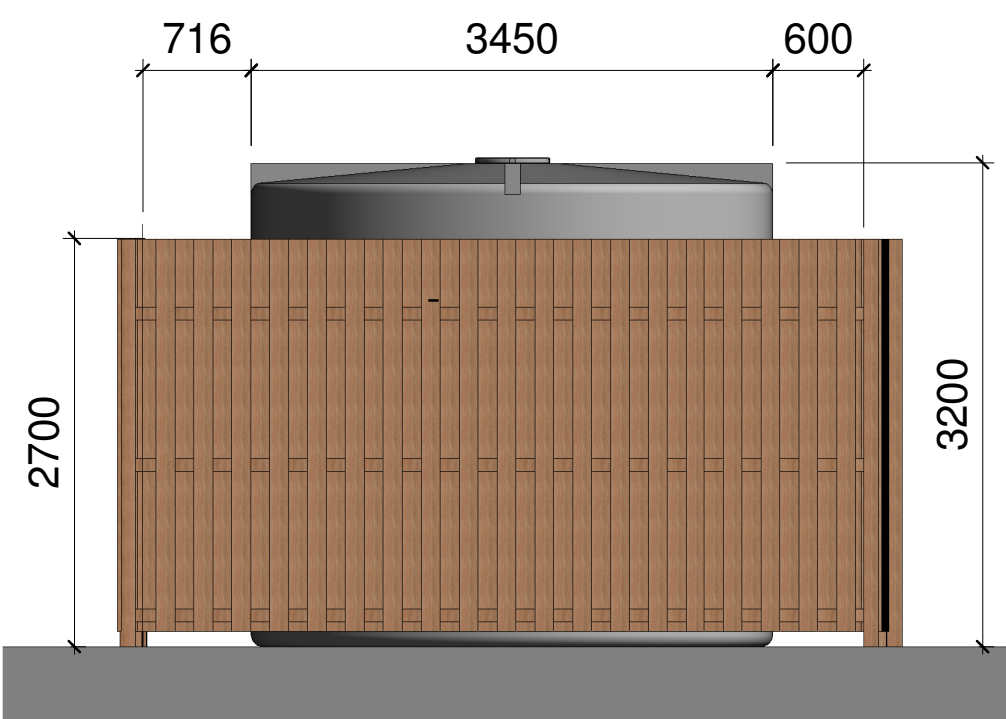

4 62-ZZ_Fire Storage Tank Right Side Elevation
1 : 50

Drawing Status

PLANNING

This drawing is © C4 Projects and is not to be copied, reproduced or re-distributed either in whole or in part without the prior written permission of the originator.

The originator shall have no responsibility for any liability, loss, cost, damage or expense arising from or relating to any use of this document other than for its intended purpose on this project.

This drawing shall be read in conjunction with all other relevant drawings, specifications and associated documentation. Any discrepancies, errors or omissions are to be reported to the originator before proceeding with work.

All dimensions are to be checked on site by the contractor prior to proceeding with any work. This drawing shall not be scaled to ascertain any dimensions, work to figured dimensions only.

DISCLAIMER

When this drawing is issued in CAD, it is an uncontrolled version issued for information only, to enable the recipient to prepare their own documents/ drawings for which they are solely responsible.

SOFTWARE INTEROPERABILITY
C4 Projects prepared this drawing using Autodesk® REVIT® Architecture.

C4 Projects does not accept liability for any loss or degradation of any information held in the drawing resulting from the translation from the original file format to any other file format or from the recipients reading of it in any other programme.

Hazard Identification

ref	hazard	date
-----	--------	------

P2	Planning NMA Issue	AW	19.01.22	JP
P1	First Issue of Drawing	AW	10.01.22	JP

Rev	Revision Details	Drawn	Date	Checked
-----	------------------	-------	------	---------

C4 Projects
Quayside,
Widnespool Business Park,
Stockton Heath,
W44 6HL,
t: 01925 751 852
e: info@c4projects.co.uk
www.c4projects.co.uk
Project Management • Architecture • Building Surveying • Cost Consultancy

Client
Witherslack Group

Project
Lakeside School
Liverpool

Drawing Title

Fire Water Storage Tank as Proposed

Status Purpose of Issue

S2 SUITABLE FOR INFORMATION

Drawn by	AW	Created	19.01.21
----------	----	---------	----------

C4 Job no.	20-034	Scale	As indicated	@ A1
------------	--------	-------	--------------	------

Drg no.	20034-C4P-AV-ZZ-DR-A-6202	Rev	P2
---------	---------------------------	-----	----