




FLOOR CONSTRUCTION

FLOORS 75mm NOMINAL REINFORCEMENT ON 100mm TK CONCRETE ON 1200 GRADE VISQUEEN, 125mm THICK FLOOR GRADE POLYSTYRENE ON 1200 GRADE VISQUEEN ON SAND BINDING ON 150mm WELL CONSOLIDATED HARDCORE. INSULATION UPSTANDS REQUIRED TO EXTERNAL PERIMETER OF PROPOSE FLOOR SLAB.

DRG 6 SECTION A-A
A4 LANDSCAPE

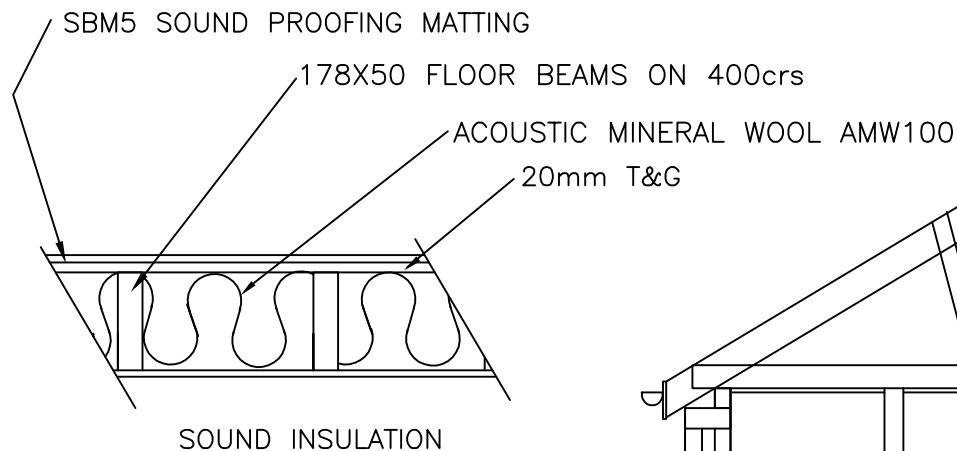