


Schedule						
Symbol	Label	Quantity	Catalog Number	Description	Lumens Per Lamp	Wattage
	A1	15	DSX1.2.LA164.AY	Column Mounted @ 6m 0" Bracket Tilt	16556	131
	C1	23	DSX1.2.LA084.AY	Column Mounted @ 6m 0" Bracket Tilt	8641	68
	E1	9	DSX1.2.LA084.FW	Column Mounted @ 6m 0" Bracket Tilt	8895	68
	E2	7	DSX1.2.LA084.FW	Column Mounted @ 6m 0" Bracket Tilt	8895	136
	H1	6	DSX1.2.LA084.FW	Column Mounted @ 6m	8895	68
	I1	1	DSX1.2.LA054.AY	Column Mounted @ 6m	4621	34
	JW	9	WAP.1.LA054.FW	Mounted @ 6m	5190	42
	exK1	5	DSX1.2.LA114.FW	Column Mounted @ 6m	12574	105
	exK2	3	DSX1.2.LA114.FW	Column Mounted @ 6m	12574	210

Statistics				
Description	Symbol	Avg	Min	Min/Avg
Access Road East	+	26 lux	8 lux	0.31
Filling Station	+	20 lux	8 lux	0.40
Footpath	+	21 lux	10 lux	0.48
Parking	+	12 lux	4 lux	0.33
Spill	+	1 lux	0 lux	0.00
Unit 1A-1C Parking	+	17 lux	10 lux	0.59
Unit 1A-1E Parking	+	23 lux	6 lux	0.26
Unit 1G-6C Service Yard	+	31 lux	13 lux	0.42
Unit 5A Drive Thru	+	52 lux	22 lux	0.42
Unit 5A Car Park	+	28 lux	11 lux	0.43
Unit 6A Car Park	+	29 lux	22 lux	0.76
Unit 6A Drive Thru	+	52 lux	21 lux	0.40
Unit 6A Refuse Area	+	24 lux	13 lux	0.54
Unit 6A Seating Area	+	39 lux	28 lux	0.72
Unit 6B Drive Thru	+	10 lux	22 lux	0.44
Unit 6B Laydown	+	70 lux	44 lux	0.63
Unit 6B Parking	+	29 lux	22 lux	0.76
Unit 6B Seating Area	+	16 lux	9 lux	0.56
Unit 6C-6D Car Park	+	27 lux	9 lux	0.33
Unit 6C-6D Perimeter	+	13 lux	5 lux	0.38
Unit 11/Gate Lodge Yard	+	15 lux	4 lux	0.27
Units 1F-1H Car Park	+	22 lux	7 lux	0.32
Access Road	+	20 lux	5 lux	0.25

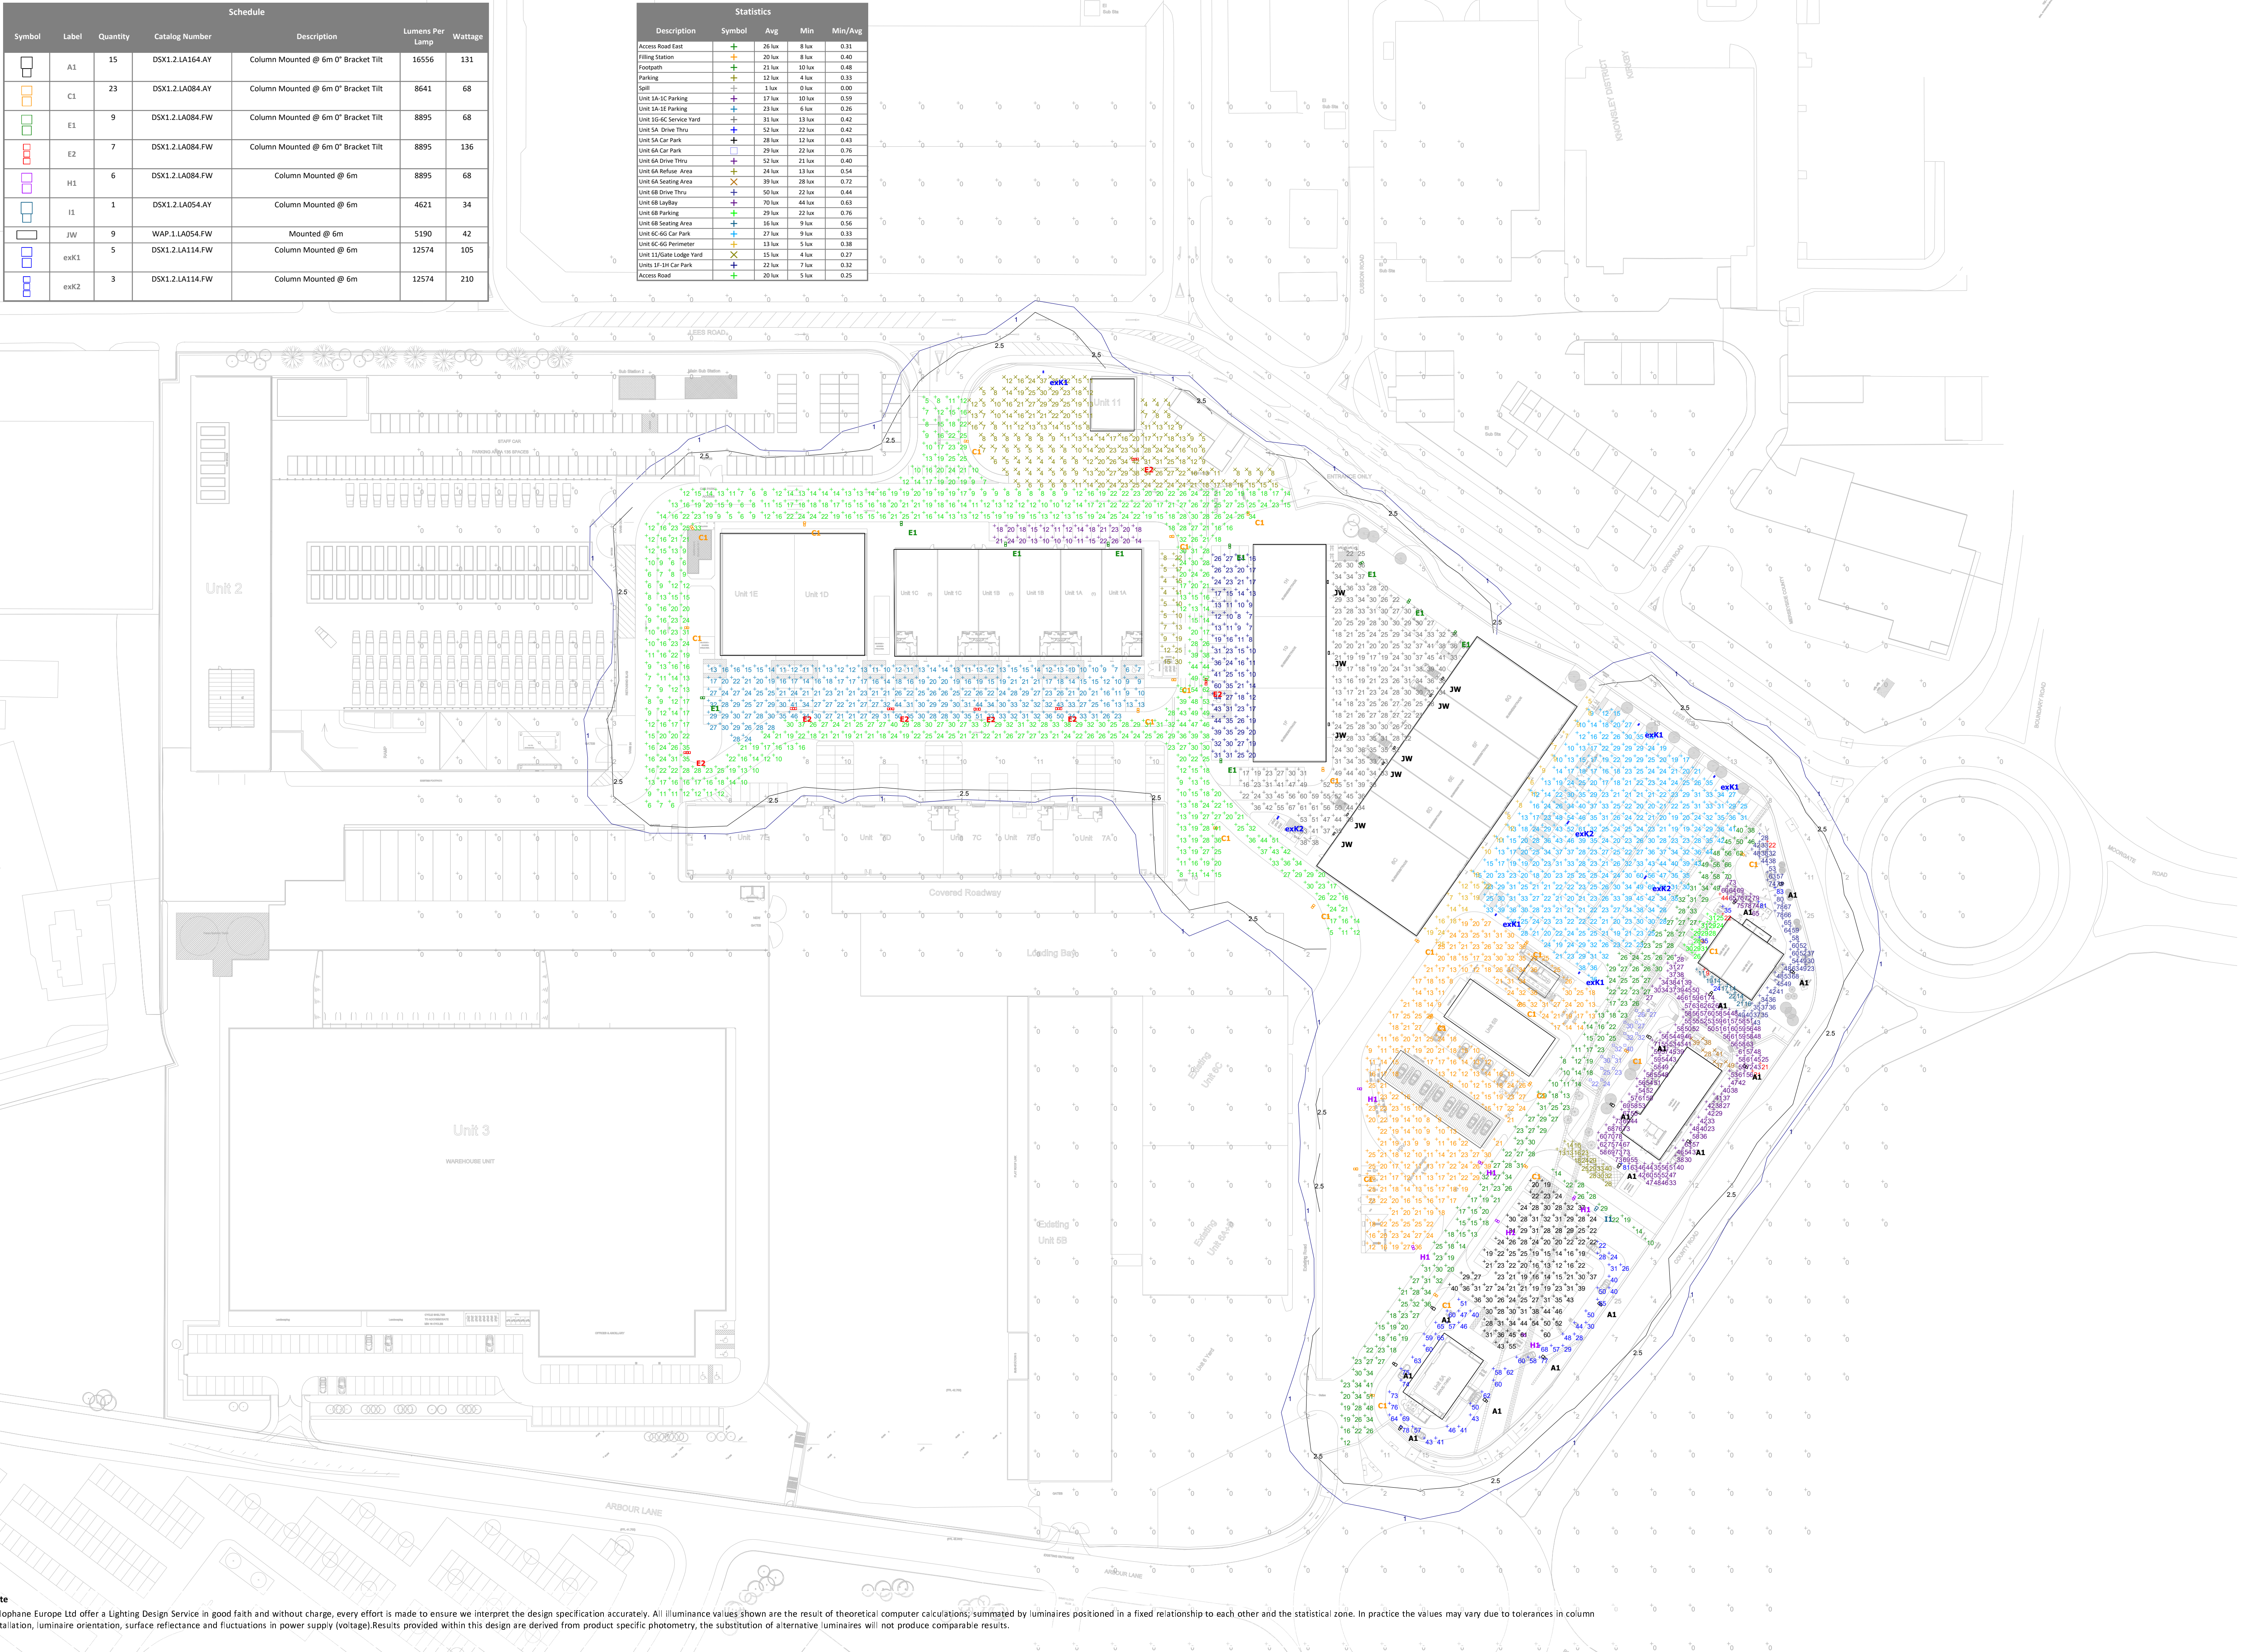

Note
Holophane Europe Ltd offer a Lighting Design Service in good faith and without charge, every effort is made to ensure we interpret the design specification accurately. All illuminance values shown are the result of theoretical computer calculations; summated by luminaires positioned in a fixed relationship to each other and the statistical zone. In practice the values may vary due to tolerances in column installation, luminaire orientation, surface reflectance and fluctuations in power supply (voltage).Results provided within this design are derived from product specific photometry, the substitution of alternative luminaires will not produce comparable results.