


External Lighting - Statistics							
Description	Symbol	Design Criteria			Design Results		
		E _a Average Maintained Illuminance (lx)	E _{min} Minimum Illuminance (lx)	U _o Uniformity (%)	E _a Average Maintained Illuminance (lx)	E _{min} Minimum Illuminance (lx)	U _o Uniformity (%)
Car Park (West)	+	20	5	25	24	12	50
Cycle Store	+	5	1	25	46	21	46
Office Main Entrance	+	50	20	40	100	76	76
HGV Entrance / Gatehouse	+	50	20	40	51	31	61
Loading Bays	+	50	20	40	57	33	58
Pathway	+	5	1	25	22	12	50
Service Road	+	20	5	40	20	13	65
Service Yard	+	20	5	25	37	15	41
Vertical Building (Old Halshead)	+	0			0	0	
Car Park (East)	+	20	5	25	26	12	46
Spill	+	0			1	0	

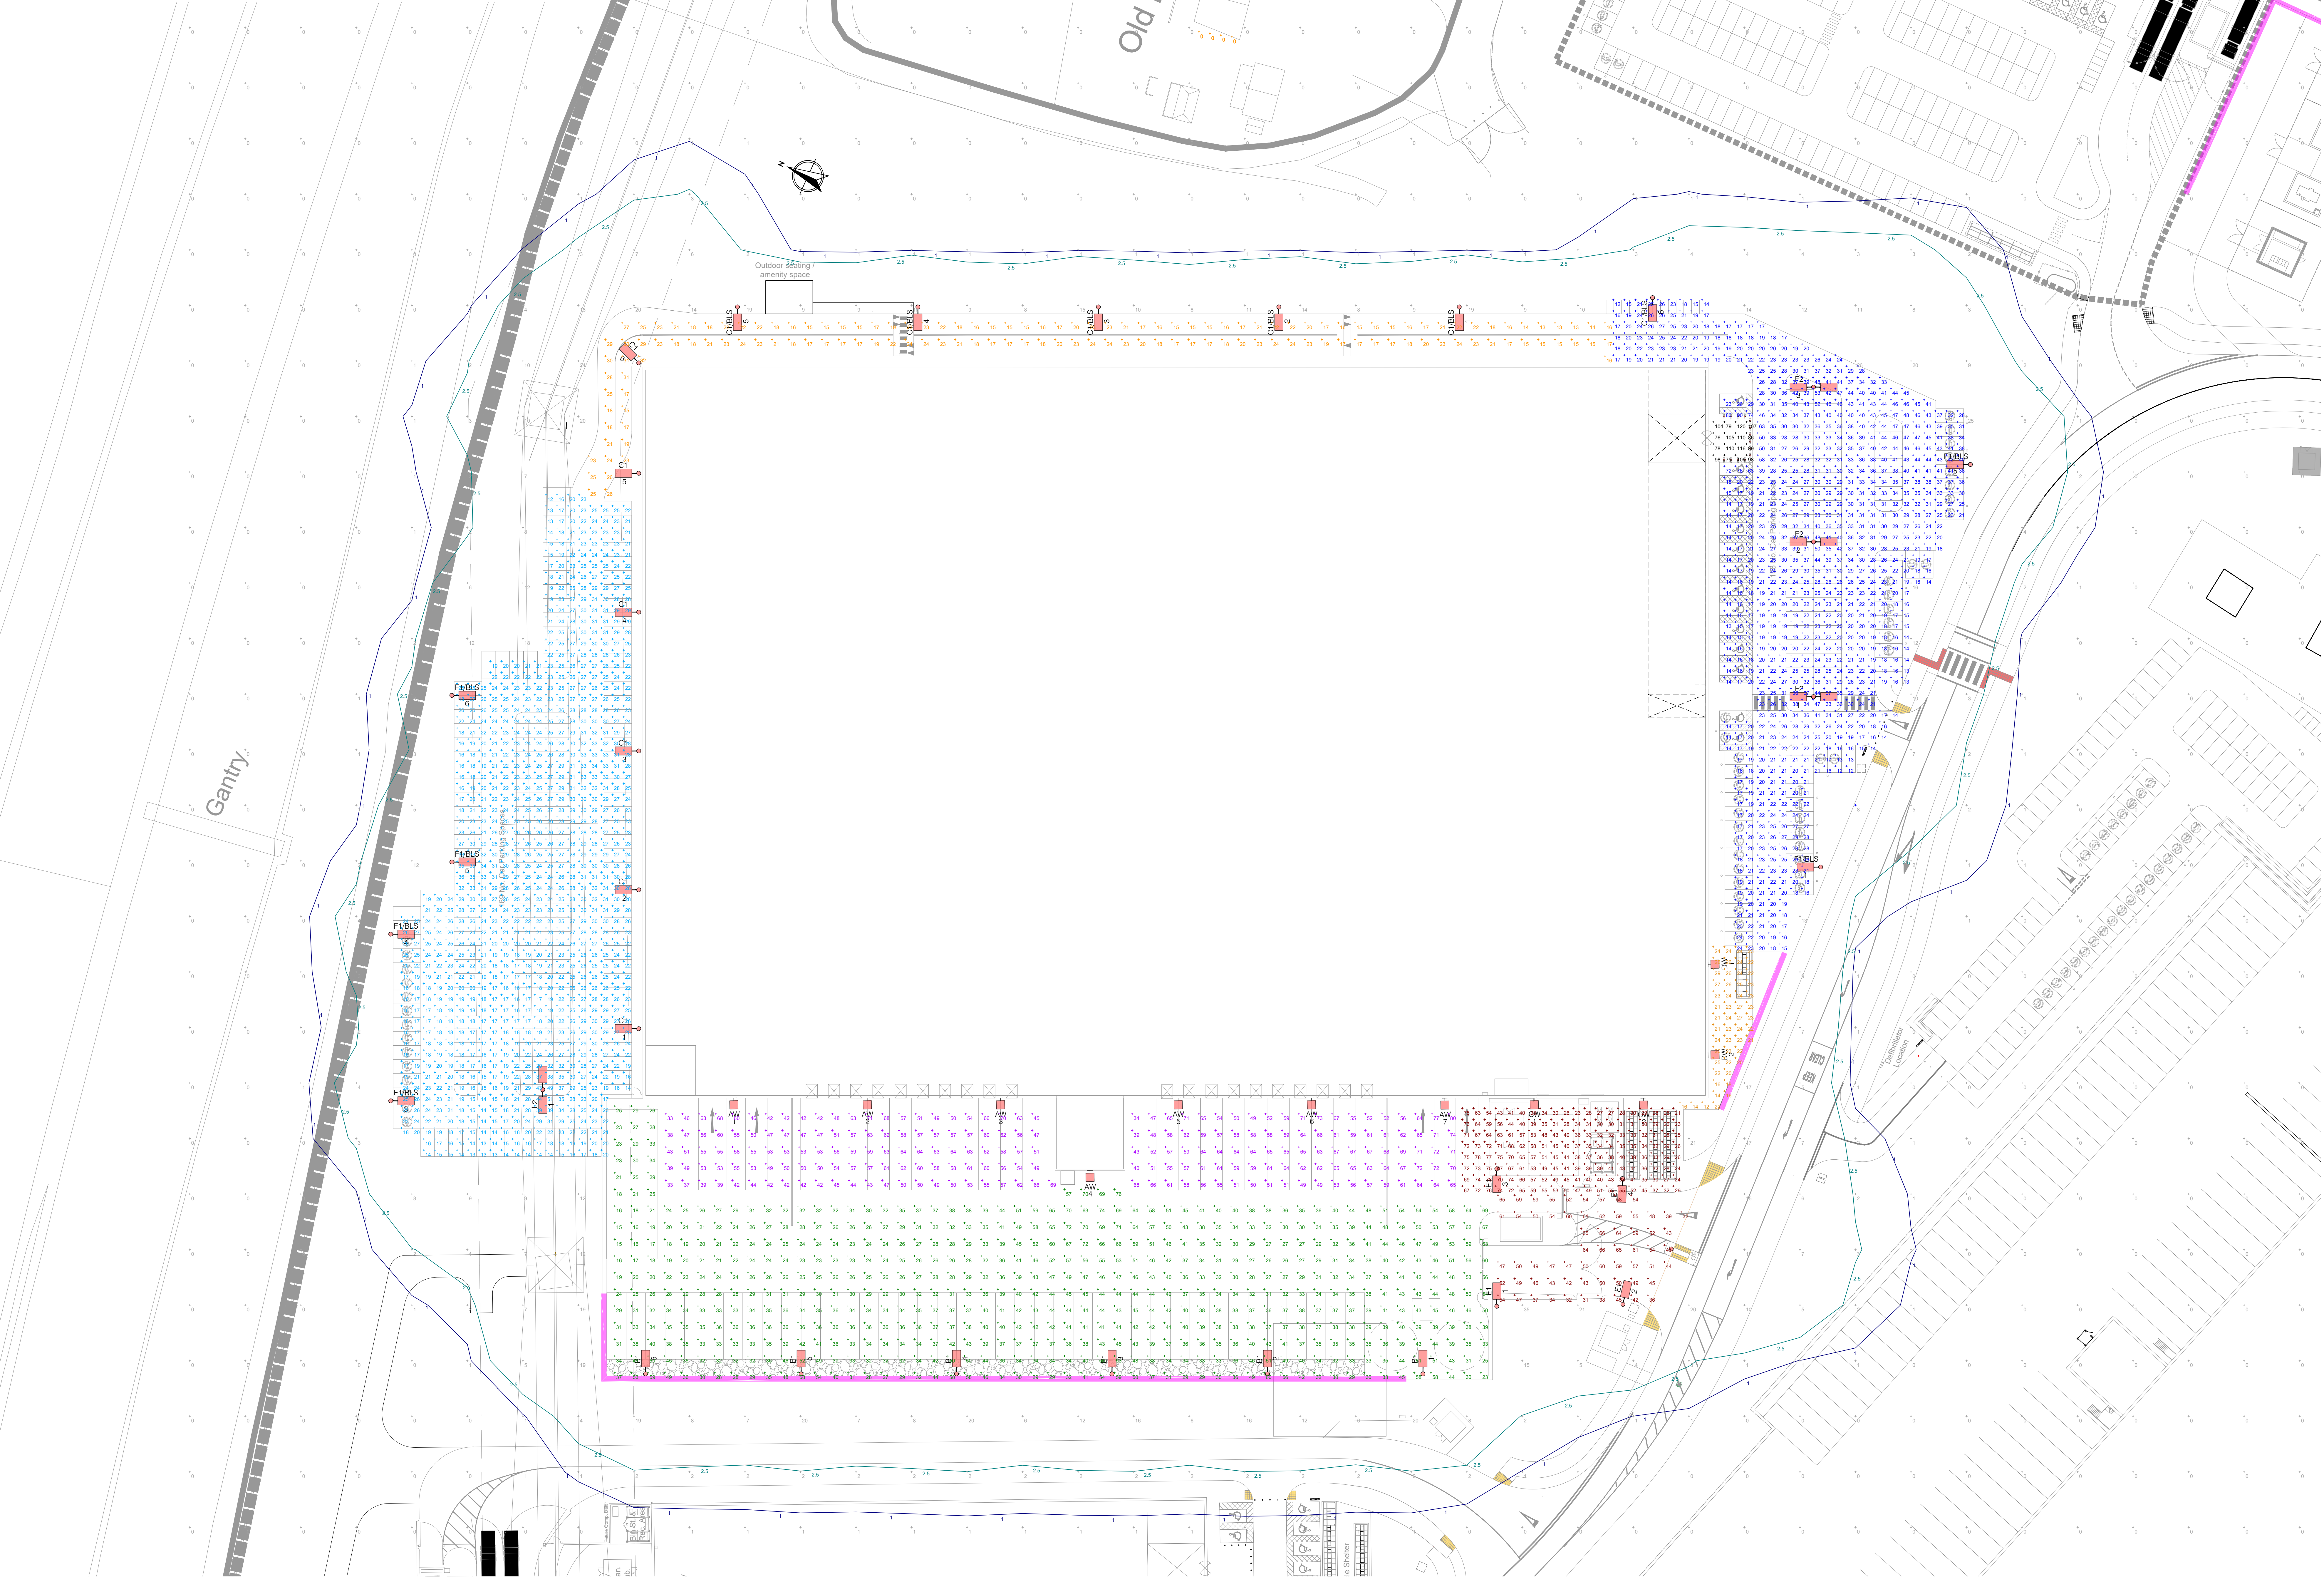

1:50 TITLE BLOCK BORDER

External Lighting

Key

Column Mounted Luminaire

Wall Mounted Luminaire

Lighting Bollard

3	06	Updated To Sul Architects Masterplan Drawing Number 06 25855-LMC-XXXX-SI-DRA-0071 Illustrative Masterplan-P08 FOR APPROVALS	TRF	JW	
2	06	Updated To Sul Architects Masterplan Drawing Number 06 25855-LMC-XXXX-SI-DRA-0071 Illustrative Masterplan-P08 FOR APPROVALS	TRF	JW	
1	11	23	FOR APPROVALS	TRF	JW
Rev	Description	Drawn	Checked		

Hannan Associates

MEP Design Solutions

Hannan Associates Ltd

Beta House

Altrincham Drive

Manchester Road

Denton

M20 5RH

Tel: +44 (0)161 337 2200

Email: info@hannan-uk.com

Web: www.hannan-uk.com

TRITAX SYMMETRY

A TRITAX BIG BOX COMPANY

Symmetry Park

Merseyside

Planning

Site Plan - Unit 03

Electrical Services

External Lighting Design Illumination Plots

4032

1:400

02514 - HAN - PL - 03 - DR - E - 006361

This drawing is the property of Hannan Associates. It must not be copied or sent to any third party without the written consent of Hannan Associates, and must be returned upon request.