


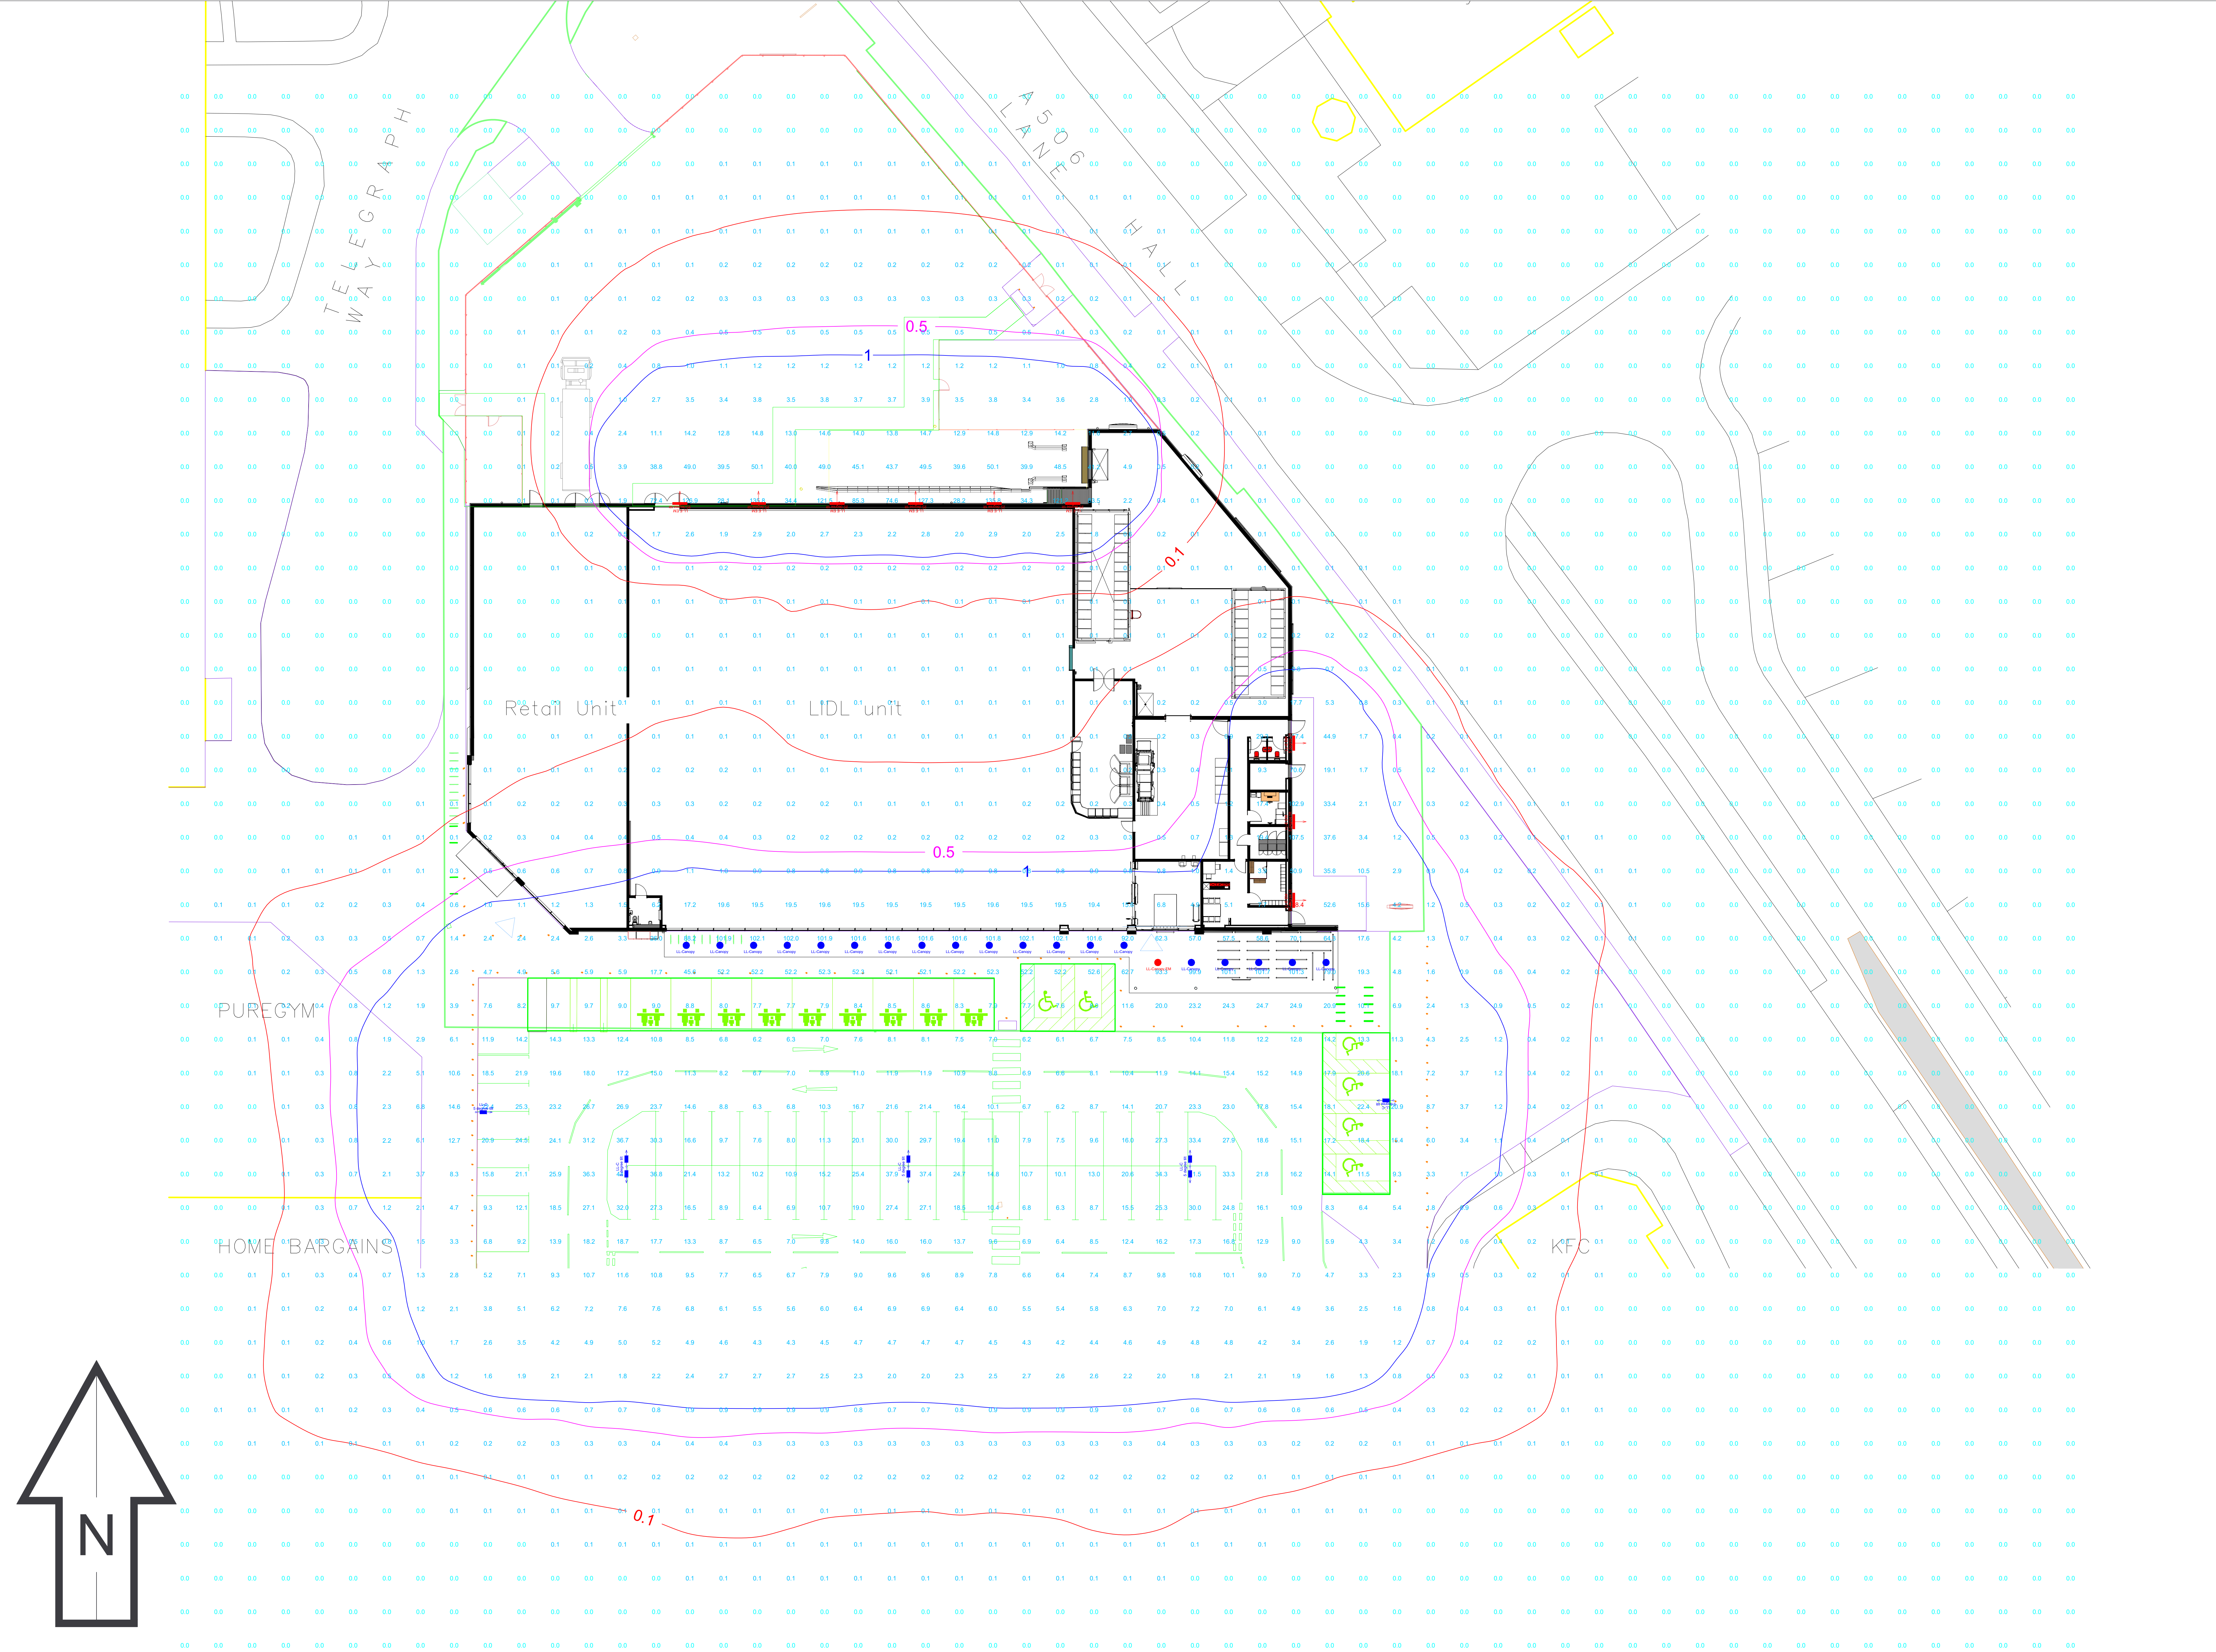

●

LL-Canopy

Qty - 19

Mounting Height - 4.1m

Tilt - 0 Degrees

●

LL-Canopy EM

Qty - 1

Mounting Height - 4.1m

Tilt - 0 Degrees

LL-E EM

tilt = See Symbol

Qty - 9

Mounting Height - 3.25m

Tilt - See Symbol

LL-C

0 degree tilt

Qty - 2

Mounting Height - 6m

Tilt - 5 Degrees

LL-C

0 degree tilt

Qty - 3 (6x Luminaires)

Mounting Height - 6m

Tilt - 5 Degrees

Car Park		Rear Walkway	
903 points at z=0, sp 1.5m by 1.5m		27 points	
HORIZONTAL LUX		HORIZONTAL LUX	
Average	17.7	Average	84.1
Maximum	79.0	Maximum	114.0
Minimum	5.9	Minimum	31.0
Min/Avg(Uo)	0.334	Min/Avg(Uo)	0.368
Min/Max	0.075	Min/Max	0.272
Coef Var	0.751	Coef Var	0.338
UnifGrad	2.89		
Canopy		Side Walkway	
64 points at z=0, sp 1.5m by 1.5m		22 points at z=0, sp 1.5m by 1.5m	
HORIZONTAL LUX		HORIZONTAL LUX	
Average	92.4	Average	72.6
Maximum	107.8	Maximum	123.8
Minimum	54.8	Minimum	21.4
Min/Avg(Uo)	0.593	Min/Avg(Uo)	0.295
Min/Max	0.508	Min/Max	0.173
Coef Var	0.145	Coef Var	0.453
UnifGrad	1.57	UnifGrad	2.36

Notes:

1) Unless agreed otherwise, the lighting proposal produced by the Lighting Application Specialist (LIAS) team of Philips Lighting UK&I is not intended for construction purposes, as it does not take into account the elimination of health and safety risks at this stage. For further details please refer to sheet number **DWG 00**

2) Do not scale for this drawing

PROPOSAL
(NOT FOR CONSTRUCTION)

Rev	DSR no.	Comment	Date	LIAS	KAM	Project Number
0	6502153	Initial proposal.	08/10/25	MD	RF	502427737
Scale & Sheet Size						1:250 @ A0
Sheet No						DWG 01

PHILIPS interact

PHILIPS hue personal wireless lighting

● LIGHT

COLORKINETICS

Project Name

Lidl Kirby

Drawing Name

Spill Light @ 0m