

SURFACE WATER MANHOLE SCHEDULE								
POINTS	APPROX CL	INVERT	DEPTH	SIZE	COVER SIZE	TYPE	COVER TYPE	SPECIAL REQUIREMENTS
SW01	45.975	45.175	800mm	450Ø	430 x 430	TYPE D	B125	-
SW02	45.975	44.820	1155mm	450Ø	430 x 430	TYPE D	B125	-
SW03	45.975	44.755	1220mm	450Ø	300 x 300	TYPE D	B125	RESTRICTED ACCESS
SW04	45.975	44.530	1445mm	450Ø	300 x 300	TYPE D	B125	RESTRICTED ACCESS
SW05	45.950	44.380	1570mm	450Ø	300 x 300	TYPE D	D400	RESTRICTED ACCESS
SW06	45.800	44.150	1650mm	1200Ø	600 x 600	TYPE B	D400	RESTRICTED ACCESS
SW06A	44.850	44.050	800mm	450Ø	430 X 430	TYPE D	D400	-
SW06B	45.700	43.630	2070MM	1200Ø	600 x 600	TYPE B	D400	RESTRICTED ACCESS
SW07	45.720	43.465	2255mm	1200Ø	600 x 600	TYPE B	D400	RESTRICTED ACCESS
SW08	44.900	42.670	2530mm	1200Ø	600 x 600	TYPE B	D400	300MM CATCHPIT CHAMBER RESTRICTED ACCESS
SW09	44.855	42.550	2305mm	1200Ø	600 x 600	TYPE B	D400	RESTRICTED ACCESS
SW10	44.915	42.320	2595mm	1200Ø	600 x 600	TYPE B	D400	FLOW CONTROL CHAMBER LIMIT 5.0L/S RESTRICTED ACCESS
SW11	44.760	43.760	1000mm	1200Ø	600 x 600	TYPE B	D400	RESTRICTED ACCESS
SW12	45.600	43.525	2075mm	1200Ø	600 x 600	TYPE B	D400	RESTRICTED ACCESS
SW13	46.000	45.200	800mm	450Ø	430 x 430	TYPE D	D400	-
SW14	44.000	43.000	1000mm	1200Ø	600 x 600	TYPE B	D400	RESTRICTED ACCESS
SW15	45.950	45.000	950mm	450Ø	430 x 430	TYPE D	D400	-
SW16	45.870	44.560	1310mm	450Ø	300 x 300	TYPE D	D400	RESTRICTED ACCESS
SW17	45.830	44.100	1730mm	1200Ø	600 x 600	TYPE B	D400	RESTRICTED ACCESS
SW18	45.860	43.980	2180mm	1200Ø	600 x 600	TYPE B	D400	300MM CATCHPIT CHAMBER RESTRICTED ACCESS
SW19	46.000	44.900	1100mm	450Ø	430 x 430	TYPE D	B125	-
SW20	44.000	42.050	2250mm	1200Ø	600 x 600	TYPE B	B125	300MM CATCHPIT CHAMBER
SW21	43.750	41.750	2300mm	1200Ø	600 x 600	TYPE B	B125	300MM CATCHPIT CHAMBER

FOUL WATER MANHOLE SCHEDULE								
POINTS	APPROX CL	INVERT	DEPTH	SIZE	COVER SIZE	TYPE	COVER TYPE	SPECIAL REQUIREMENTS
FW01				NOT REQUIRED				
FW02	45.975	44.670	1305mm	450Ø	300 x 300	TYPE D	D400	RESTRICTED ACCESS
FW03	45.675	44.410	1265mm	450Ø	300 x 300	TYPE D	D400	RESTRICTED ACCESS
FW04	45.410	44.265	1145mm	450Ø	430 x 430	TYPE D	D400	-
FW05	45.025	44.130	895mm	450Ø	430 x 430	TYPE D	D400	-
FW05A	45.600	44.800	800mm	450Ø	430 x 430	TYPE D	D400	-
FW06	44.450	43.350	1100mm	1200Ø	600 x 600	TYPE B	D400	-
FW07	44.600	42.415	2185mm	1200Ø	600 x 600	TYPE B	D400	RESTRICTED ACCESS BACKDROP IL: 43.215
FW08	46.000	45.200	800mm	450Ø	430 x430	TYPE D	B125	-
FW09	46.000	45.140	860mm	450Ø	430 x430	TYPE D	B125	-
FW10	46.000	45.090	910mm	450Ø	430 x430	TYPE D	D400	-
FW11	45.900	44.900	1000mm	450Ø	430 x430	TYPE D	D400	-
FW12	45.600	44.800	800mm	450Ø	430 x430	TYPE D	D400	-

HEALTH AND SAFETY - CDM REGULATIONS:

It is the responsibility of the client to fulfill their duties under CDM regulations and ensure all work is carried out by suitably qualified and competent organisations and personnel. HTE are appointed as designers. All other CDM roles must be fulfilled by the others.

Residual hazards specific to the design presented on the drawing are noted below. Anyone carrying out this or associated work must be aware of and manage all the risks, including those typically associated with the type of work being carried out. Hazards should also be taken into account in the maintenance, operation, decommissioning and demolition of the works.

Notes:


- HTE drawings are to be read in conjunction with:
 - NBS specification.
 - Relevant documents, Specifications, Architectural and Services drawings, including approved building work drawings.
 - Building Information Model (BIM)
- All dimensions are in mm except levels which are in metres and relate to [ordnance datum].
- Do not scale from this drawing. Work to figured dimensions only.
- The contractor should notify CA of any discrepancies between the structural drawings and specifications or other drawings before work commences.
- All setting out of new structure to be established from Architects grid. The setting out of the grid to be established by the contractor in coordination with the Architect.
- The contractor is responsible for the stability of the building and adjoining structures duringn construction and shall design, install, adapt and maintain all necessary propping and temporary works. A method statement for the temporary works must be submitted to the contractor administrator for comment before work begins.
- Fire protection to all structural elements to Architect's details.
- All waterproofing to the Architect's details. Reference to be made to waterproofing specialists recommendations. Proposal to be costed as part of the basement works.
- All materials to comply with the relevant British Standard.
- All steelwork S355 unless noted otherwise.

P02	Schedule updated	03.11.25	NH
P01	First Issue	08.08.25	NH

REV	COMMENTS	DATE	CHK
-----	----------	------	-----

STATUS

PRELIMINARY

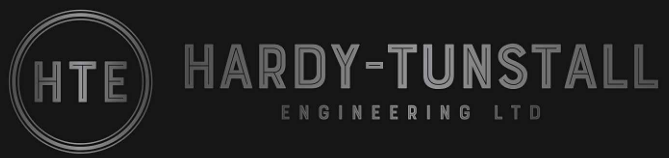

HARDY-TUNSTALL ENGINEERING
Consulting Civil and Structural Engineers
Unit 1 Knowl Place, Hitchin SG4 0TY
01462 516000
info@ht-engineering.co.uk
www.ht-engineering.co.uk

CLIENT

Arnold Clark

PROJECT

Earlsfield Park
Unit D & E

DRAWING TITLE

Drainage Strategy
Manhole Schedule

SCALE @ A1	DRAWN BY	DATE
NTS	TRM	Aug 2025

HTE No:	STATUS CODE	REV
TL224048	S0	P02

Rev No:
TL224048 -HTE-XX-XX-DR-C-902