


DB32 Fire Appliance
Overall Length
Overall Width
Overall Body Height
Min Body Ground Clearance
Max Track Width
Lock to lock time
Kerb to Kerb Turning Radius

8.680m
2.180m
3.452m
0.337m
2.121m
6.00s
7.910m



FIRE TENDER HIGHWAY DESIGN CHECKLIST - BUILDING REGS PART B

DESIGN FEATURE	DESIGN REQUIREMENTS	NOTES
TURNING FACILITIES	FIRE SERVICE VEHICLES SHOULD NOT HAVE TO REVERSE MORE THAN 20m FROM THE END OF AN ACCESS ROAD.	Complies
ACCESS ROUTE	MINIMUM WIDTH OF ROAD BETWEEN KERBS - 3.7m	Complies
ACCESS TO BUILDINGS	THERE SHOULD BE VEHICULAR ACCESS FOR A PUMP APPLIANCE TO SMALL BUILDINGS TO EITHER: A) 15% OF THE PERIMETER; OR B) WITHIN 45m OF EVERY POINT ON THE PROJECTED PLAN AREA (OR FOOTPRINT) OF THE BUILDING	Complies

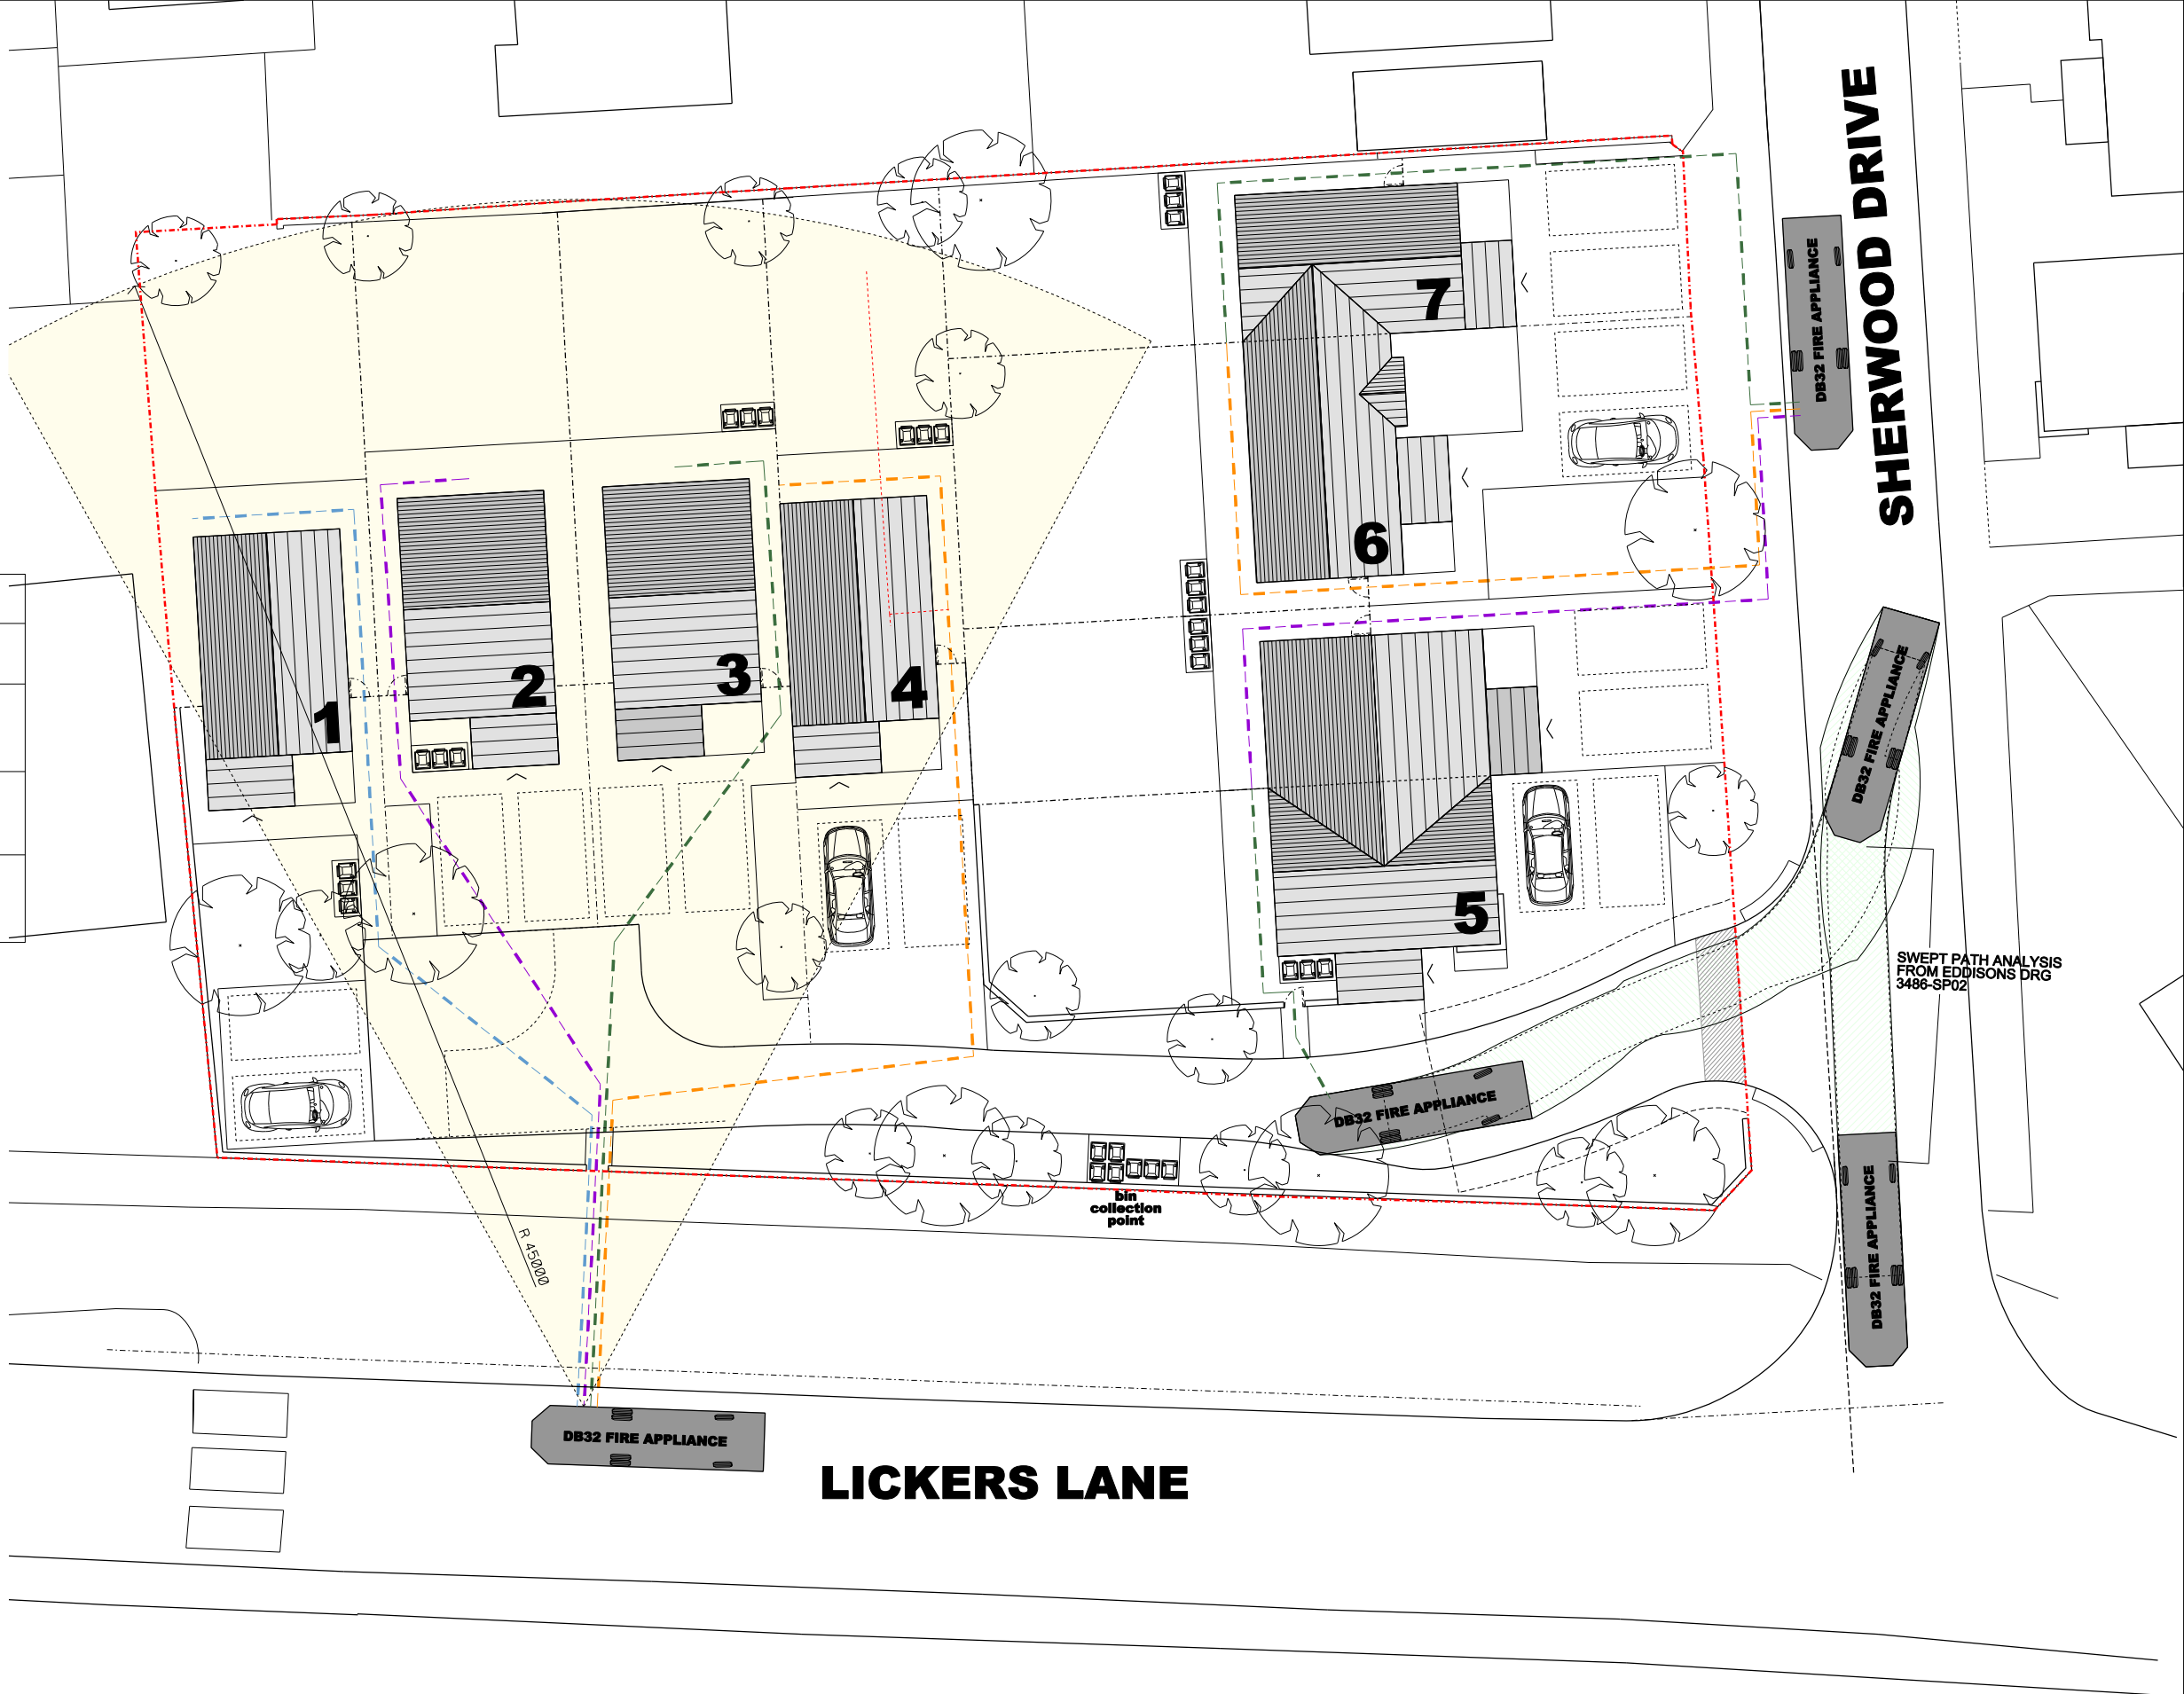

SWEPT PATH ANALYSIS
FROM EDDISONS DRG
3486-SP02

