



MasterDrain
SW

Muir Associates (UK) Limited

www.muir-associates.co.uk

Trinity Chambers,
18 Ivy Street,
Birkenhead CH41 5EF
Tel: 0151 650 1200 Mob: 07813 7770514
email: design@muir-associates.co.uk

Job No. 1132-22		
Sheet no. 1		
Date 21/11/22		
By MJ	Checked	Reviewed

Project

Title **Surcharge calcs (Sized at 30 yrs storm) for SURFACE WATER DESIGN.SW CCF = 40%**

Using in-line restrictors
Return period = 100 yrs
Climate change factor = 40

PEAK hydrograph values printed
Storm duration = 1440 mins
No offline storage

Mean rain intens. 5.00 mm/hr
Storm profile = Winter
Using FSR data

Peak rain intens. 12.50 mm/hr
Sample period = 720.0 secs.

Entry No.	SECT. No.	MANHOLE REF	PIPE CAPACITY l/s	RATE FLOW l/s	PIPE SIZE mm	CHAMBER DIAM/LxW mm	INVERT LEVEL m	WATER LEVEL m	GRND LEVEL m	SURCHARGE fract.	Depth	EXCESS FLOW l/s	FLOODED VOL m³	DRAINED AREA (m²) :x FACTOR	STATUS
1	I	1.01 S-MH-01	42.1	0.7	225	1200	43.85	43.87	44.80	0.02	0.01	0.00	0.000	527	OK
2	I	1.02 S-MH-02	77.8	2.2	300	1200	43.58	43.60	44.80	0.03	0.02	0.00	0.000	1579	OK
3	I	1.03 S-MH-03	78.4	2.9	300	1200	43.43	43.45	44.80	0.04	0.02	0.00	0.000	2106	OK
4	I	1.04 S-MH-04	78.0	2.9	300	1500	43.30	43.32	44.60	0.04	0.02	0.00	0.000	2106	OK
5	B	2.01 S-MH-09	184.0	1.5	450	1500	43.08	43.09	44.35	0.01	0.01	0.00	0.000	1065	OK
6	B	2.02 S-MH-10	184.9	5.0	450	1500	42.99	43.02	44.35	0.03	0.03	0.00	0.000	3560	OK
7	B	2.03 S-MH-12	398.2	5.0	450	1500	42.87	42.88	44.35	0.01	0.02	0.00	0.000	3560	OK
8	I	1.05 S-MH-05	227.8	7.9	450	1500	42.79	42.83	44.42	0.03	0.04	0.00	0.000	5666	OK
9	B	3.01 S-MH-13	42.1	0.7	225	1200	43.90	43.91	44.80	0.02	0.01	0.00	0.000	527	OK
10	B	3.02 S-MH-14	95.8	2.2	300	1200	43.70	43.72	44.80	0.02	0.02	0.00	0.000	1582	OK
11	B	3.03 S-MH-15	298.4	2.9	300	1200	43.47	43.48	44.92	0.01	0.01	0.00	0.000	2109	OK
12	I	1.06 S-MH-06‡	14.6	4.8	150	1500	42.72	42.77	44.75	0.33	0.05	0.00	0.000	7775	OK
13	I	1.07 S-MH-07	14.6	4.8	150	1200	42.65	42.71	44.35	0.33	0.05	0.00	0.000	7775	OK
14	I	1.08 S-MH-08	18.6	4.8	150	1200	42.40	42.45	44.46	0.26	0.05	0.00	0.000	7775	OK



MasterDrain
SW

Muir Associates (UK) Limited

www.muir-associates.co.uk

Trinity Chambers,
18 Ivy Street,
Birkenhead CH41 5EF
Tel: 0151 650 1200 Mob: 07813 7770514
email: design@muir-associates.co.uk

Job No. 1132-22		
Sheet no. 2		
Date 21/11/22		
By MJ	Checked	Reviewed

Project

Title **Surcharge calcs (Sized at 30 yrs storm) for SURFACE WATER DESIGN.SW CCF = 40%**

Notes

Printout headings

- | | | |
|---|---|--|
| 1) Entry no - position in file | 2) Section no - pipe identifier | 3) Manhole ref - Manhole identifier |
| 4) Pipe cap - full bore capacity of that pipe | 5) Rate of flow - calculated flow rate (l/s) ‡ = flow restrictor. | 6) Pipe diam - outlet pipe diameter (mm) |
| 7) Chamber diam - chamber diam. at base of MH | 8) Invert level - invert level of manhole | 9) Water level - calculated peak water level. |
| 10) Grnd level - ground / cover level | 11) Surch. fract - calc.flow/pipe capacity | 12) Surch. depth - surcharge level above soffit |
| 13) Overflow - surcharged flow rate (l/s) | 14) Flooded vol - volume of water above cover | 15) Upstrm Vol - upstream pipe vol to previous manhole(s) |
| 16) Status - OK - outlet not surcharged | 17) Status - Surcharged - outlet surcharged | 18) Status - Warning - water level within 299mm of cover level |
| 19) Status - Flooded - cover over-topped | 20) § against diameter indicates throttle pipe used. | |

Title box

Hydrograph data

- | | | |
|---|--------------------------------------|--|
| 1) Ret. period - that used to calculate profile | 2) Duration - length of storm (mins) | 3) Profile - either Winter (75%) or Summer (50%) |
|---|--------------------------------------|--|

Flow restrictors

Manhole reference - S-MH-06

Restrictor flowrate - 4.83 l/s

Flood volumes

Check that the upstream storage of the manhole is adequate to take the flood volume - see Upstrm Vol above.



MasterDrain
SW

Muir Associates (UK) Limited

www.muir-associates.co.uk

Trinity Chambers,
18 Ivy Street,
Birkenhead CH41 5EF
Tel: 0151 650 1200 Mob: 07813 7770514
email: design@muir-associates.co.uk

Job No. 1132-22		
Sheet no. 3		
Date 21/11/22		
By MJ	Checked	Reviewed


Project

Title **Surcharge calcs (Sized at 30 yrs storm) for SURFACE WATER DESIGN.SW CCF = 40%**

Time mins	Rain mm/hr	Time mins	Rain mm/hr	Time mins	Rain mm/hr
12:00	1.04	492:00	4.95	972:00	5.30
24:00	1.04	504:00	5.26	984:00	5.03
36:00	0.77	516:00	5.53	996:00	4.72
48:00	0.77	528:00	5.88	1008:00	4.33
60:00	0.77	540:00	6.23	1020:00	4.06
72:00	0.77	552:00	6.53	1032:00	3.83
84:00	0.85	564:00	6.81	1044:00	3.60
96:00	0.85	576:00	7.15	1056:00	3.36
108:00	0.89	588:00	7.54	1068:00	3.17
120:00	0.97	600:00	7.81	1080:00	2.94
132:00	1.01	612:00	8.12	1092:00	2.71
144:00	1.04	624:00	8.31	1104:00	2.55
156:00	1.12	636:00	8.55	1116:00	2.44
168:00	1.16	648:00	8.78	1128:00	2.32
180:00	1.20	660:00	8.97	1140:00	2.13
192:00	1.24	672:00	9.20	1152:00	2.01
204:00	1.28	684:00	9.36	1164:00	1.89
216:00	1.31	696:00	9.51	1176:00	1.74
228:00	1.35	708:00	9.59	1188:00	1.62
240:00	1.43	720:00	9.63	1200:00	1.59
252:00	1.47	732:00	9.67	1212:00	1.55
264:00	1.55	744:00	9.67	1224:00	1.51
276:00	1.55	756:00	9.63	1236:00	1.43
288:00	1.62	768:00	9.59	1248:00	1.39
300:00	1.74	780:00	9.51	1260:00	1.35
312:00	1.86	792:00	9.40	1272:00	1.28
324:00	1.97	804:00	9.24	1284:00	1.24
336:00	2.13	816:00	9.05	1296:00	1.24
348:00	2.24	828:00	8.82	1308:00	1.16
360:00	2.40	840:00	8.58	1320:00	1.12
372:00	2.51	852:00	8.39	1332:00	1.04
384:00	2.71	864:00	8.16	1344:00	1.01
396:00	2.90	876:00	7.89	1356:00	0.97
408:00	3.09	888:00	7.58	1368:00	0.93
420:00	3.33	900:00	7.23	1380:00	0.85
432:00	3.56	912:00	6.88	1392:00	0.85
444:00	3.75	924:00	6.57	1404:00	0.81
456:00	4.02	936:00	6.26	1416:00	0.77
468:00	4.29	948:00	5.99	1428:00	0.77
480:00	4.64	960:00	5.61	1440:00	0.77

Hydrograph profile derived from data in the Flood Studies Report

Return period= 100 yrs Duration= 1440 mins Profile - winter

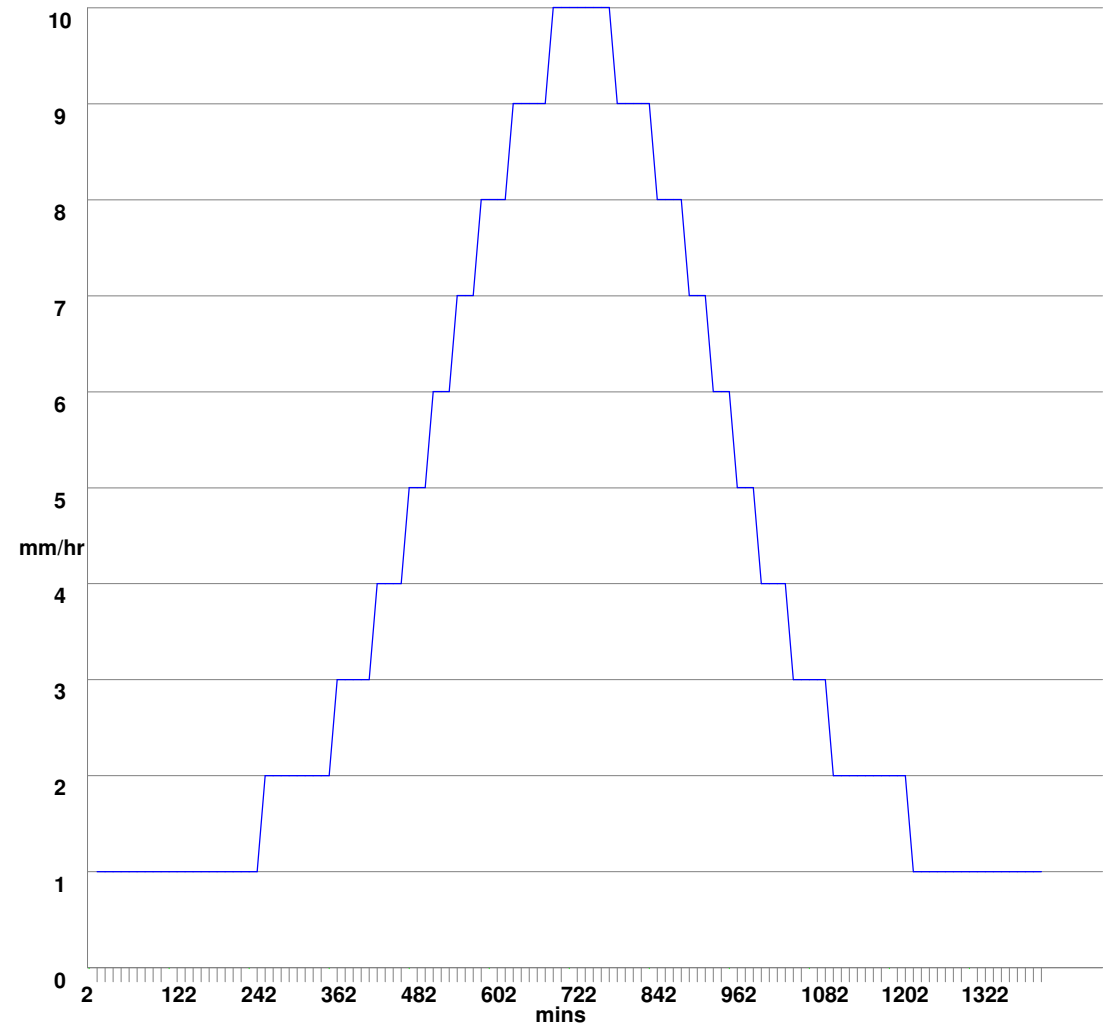



MasterDrain
SW


Muir Associates (UK)
Limited

www.muir-associates.co.uk

Trinity Chambers,
18 Ivy Street,
Birkenhead CH41 5EF
Tel: 0151 650 1200 Mob: 07813 7770514
email: design@muir-associates.co.uk

Job No. 1132-22		
Sheet no. 4		
Date 21/11/22		
By MJ	Checked	Reviewed

Project	
Title	Surcharge calcs (Sized at 30 yrs storm) for SURFACE WATER DESIGN.SW CCF = 40%

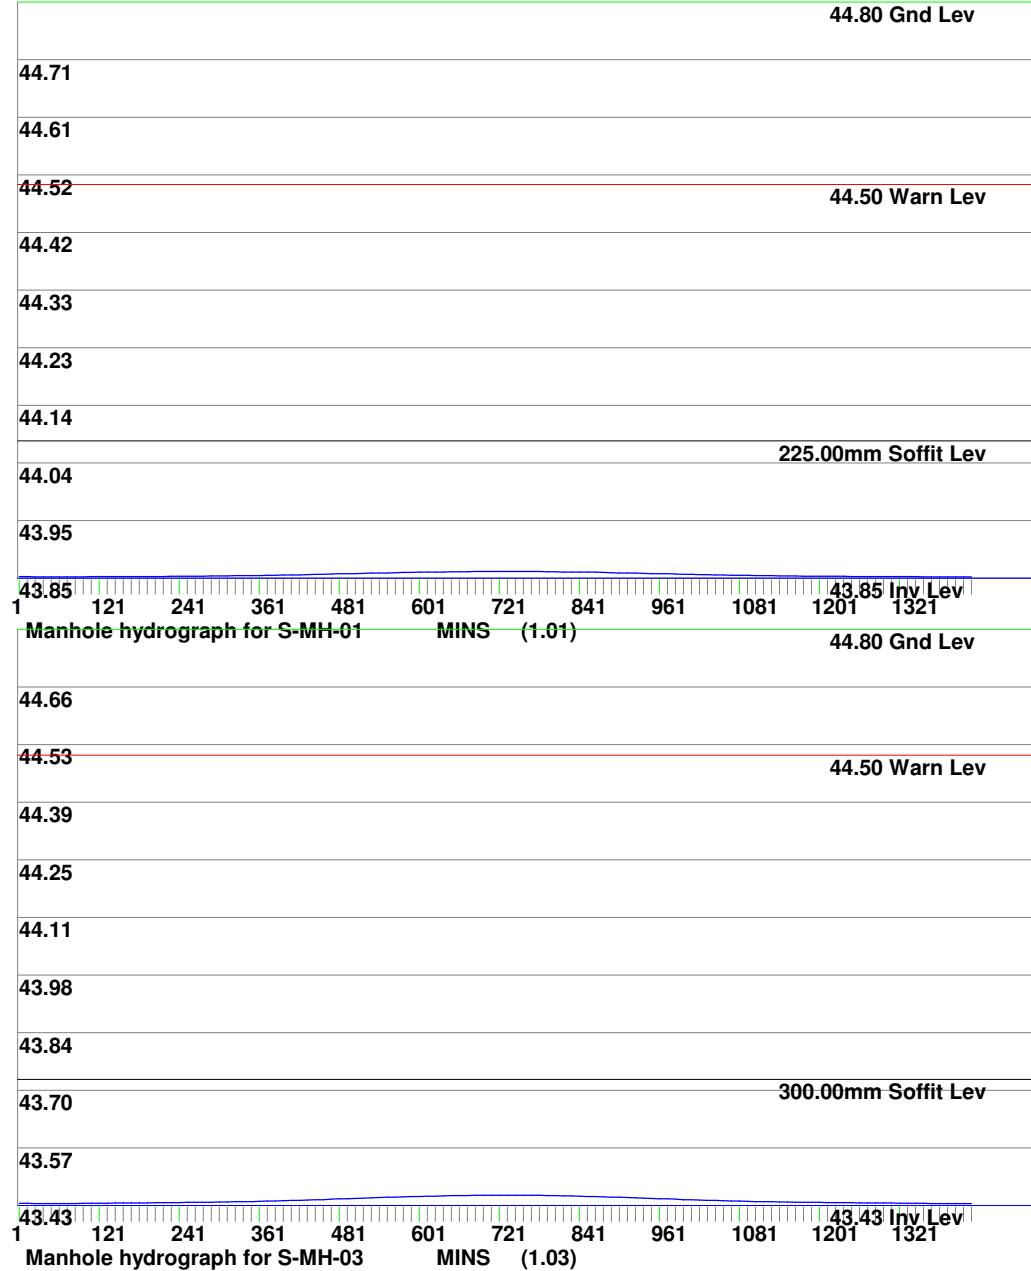



MasterDrain
SW



Muir Associates (UK)
Limited

www.muir-associates.co.uk

Trinity Chambers,
18 Ivy Street,
Birkenhead CH41 5EF
Tel: 0151 650 1200 Mob: 07813 7770514
email: design@muir-associates.co.uk

Job No. 1132-22		
Sheet no. 5		
Date 21/11/22		
By MJ	Checked	Reviewed

Project	
Title	Surcharge calcs (Sized at 30 yrs storm) for SURFACE WATER DESIGN.SW CCF = 40%

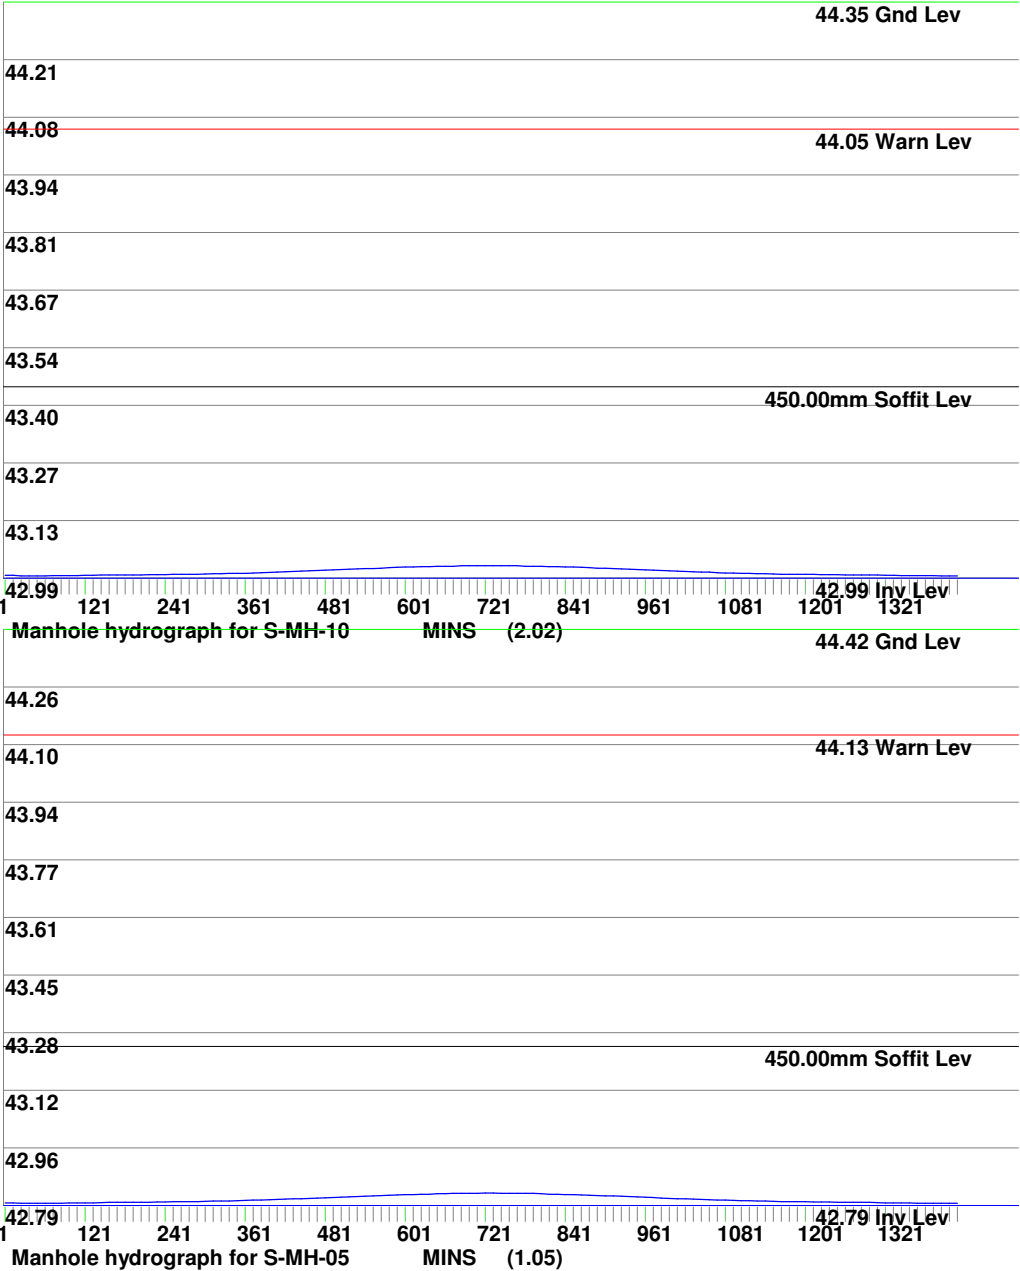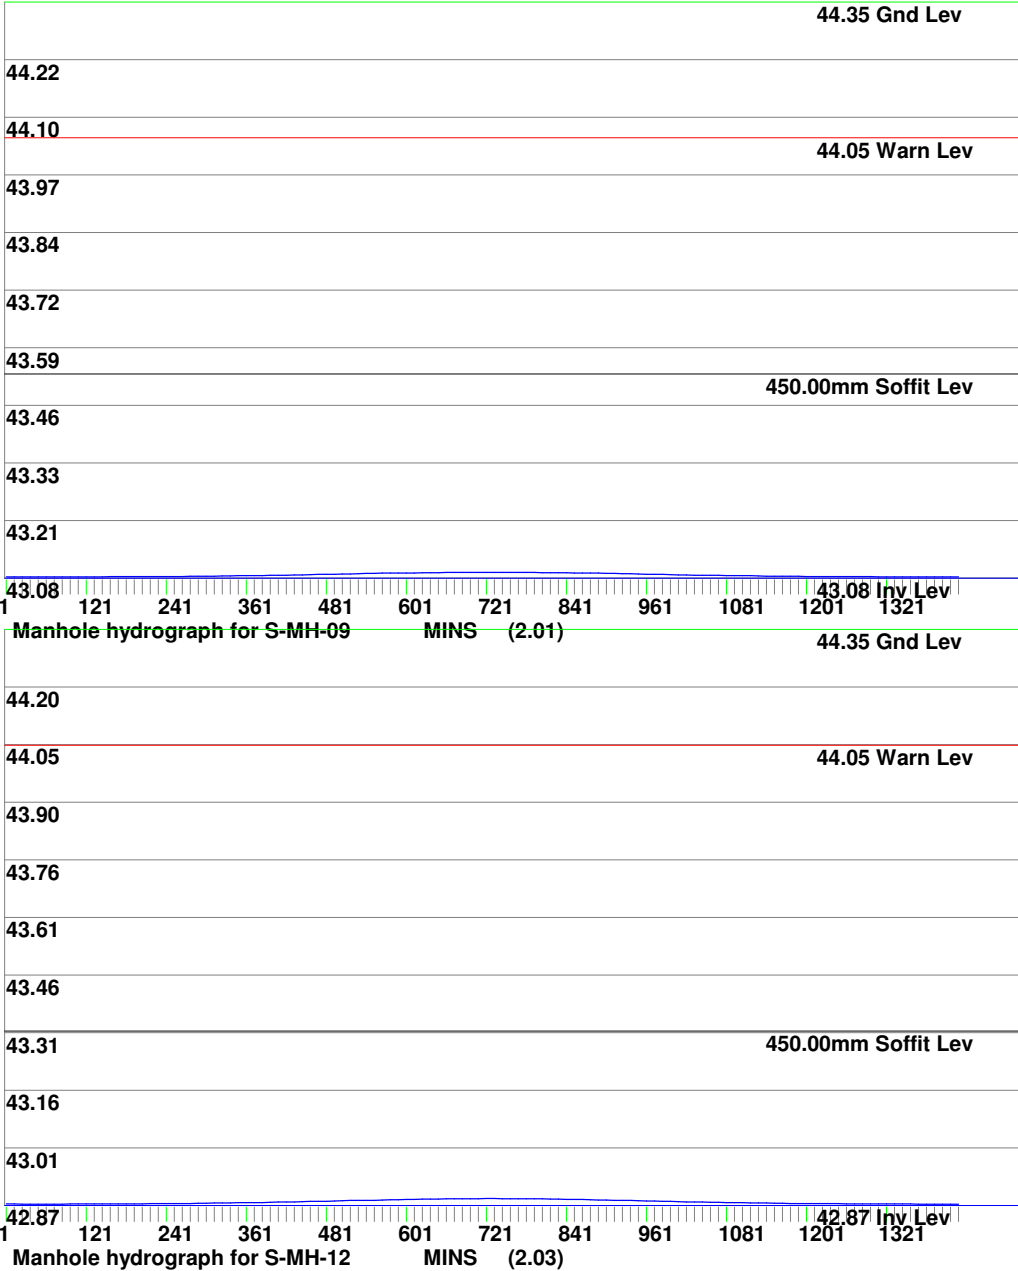



MasterDrain
SW


Muir Associates (UK)
Limited


www.muir-associates.co.uk

Trinity Chambers,
18 Ivy Street,
Birkenhead CH41 5EF
Tel: 0151 650 1200 Mob: 07813 7770514
email: design@muir-associates.co.uk

Job No. 1132-22		
Sheet no. 6		
Date 21/11/22		
By MJ	Checked	Reviewed

Project	
Title	Surcharge calcs (Sized at 30 yrs storm) for SURFACE WATER DESIGN.SW CCF = 40%

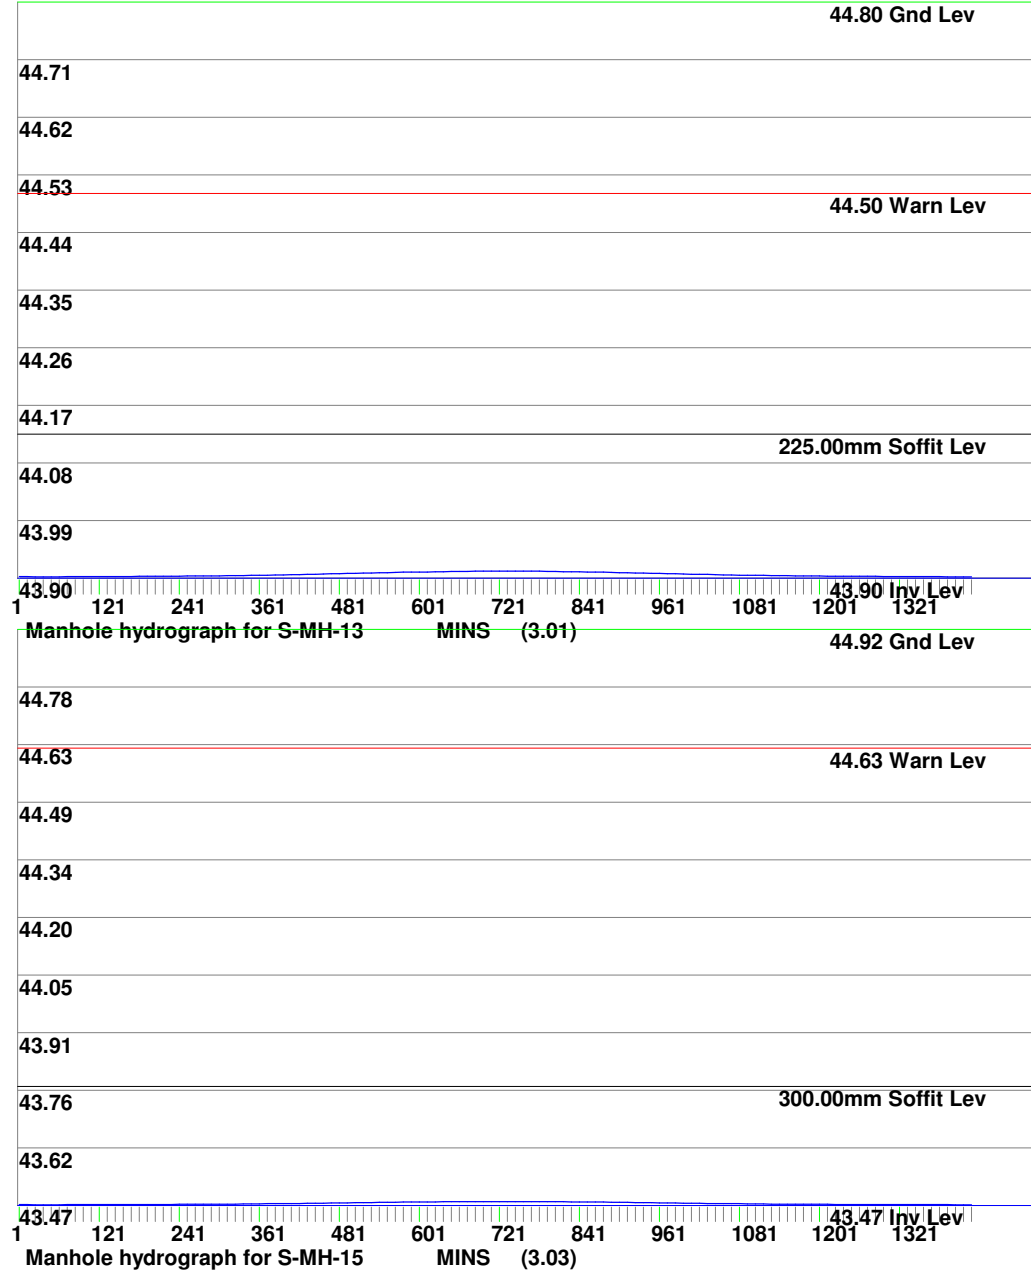



MasterDrain
SW

Muir Associates (UK) Limited



www.muir-associates.co.uk

Trinity Chambers,
18 Ivy Street,
Birkenhead CH41 5EF
Tel: 0151 650 1200 Mob: 07813 7770514
email: design@muir-associates.co.uk

Job No. 1132-22		
Sheet no. 7		
Date 21/11/22		
By MJ	Checked	Reviewed

Project

Title **Surcharge calcs (Sized at 30 yrs storm) for SURFACE WATER DESIGN.SW CCF = 40%**

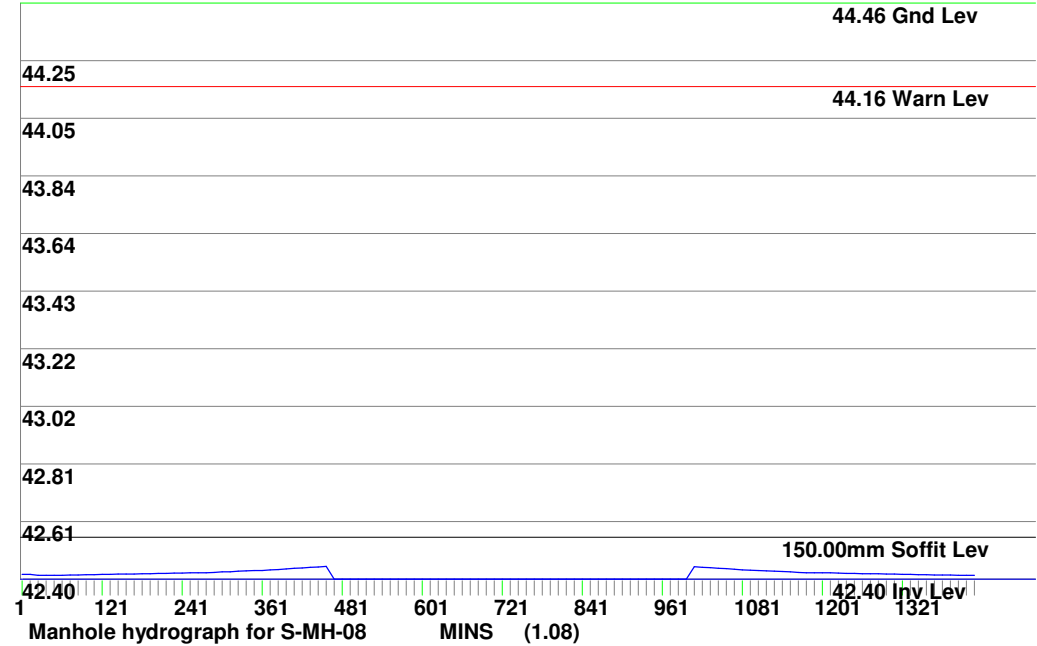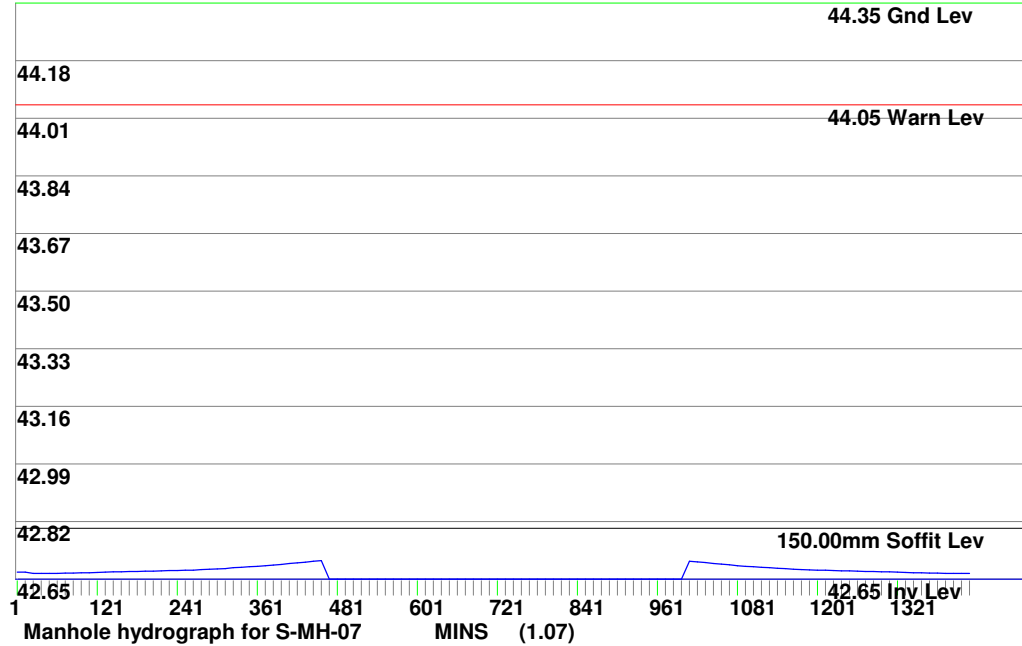



MasterDrain
SW

Muir Associates (UK) Limited


www.muir-associates.co.uk

Trinity Chambers,
18 Ivy Street,
Birkenhead CH41 5EF
Tel: 0151 650 1200 Mob: 07813 7770514
email: design@muir-associates.co.uk

Job No. 1132-22		
Sheet no. 8		
Date 21/11/22		
By MJ	Checked	Reviewed

Project

Title **Surcharge calcs (Sized at 30 yrs storm) for SURFACE WATER DESIGN.SW CCF = 40%**

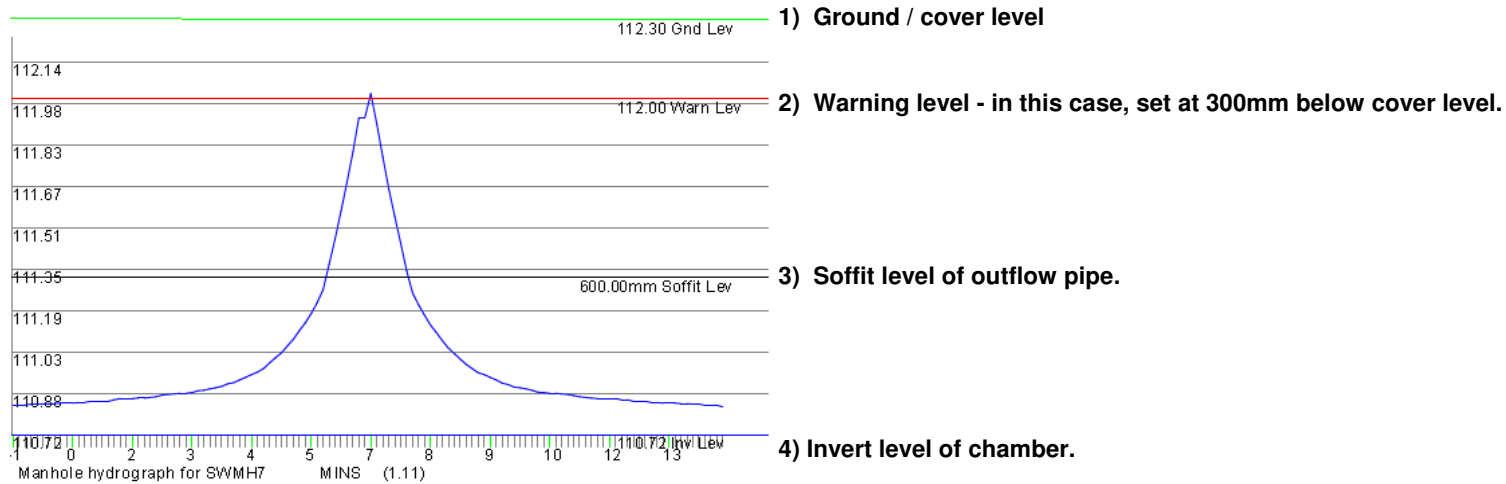

Notes

- Lower section of the graph shows the water depth filling the channel. Channel is assumed to be a full pipe diameter in depth.
- Upper section of the graph shows the water depth filling the chamber. Chamber has a greater width/diameter than the channel, so increases in depth are proportionally less.
- The top of the graph clips the warning level and would be marked thus on the printout.
- In many cases the invert of the offline storage is required to enter at the channel soffit level, meaning that the pipe will still surcharge but flooding risk reduced.
- The diagram above is a general one and is not part of the current calculation.