


COOLING:
THE COOLING REQUIREMENT FOR THIS SITE IS 3.52kW. THEREFORE THE EXISTING COOLING SYSTEM IS SUFFICIENT

NOTE:
H3G U2100 HAS ALSO BEEN SUNSET FOR REMOVING EXISTING FLEXI CABINET TO ALLOW SPACE FOR PROPOSED AIRI CABINET



CABIN 1 H3G & BTEE EQUIPMENT PLAN

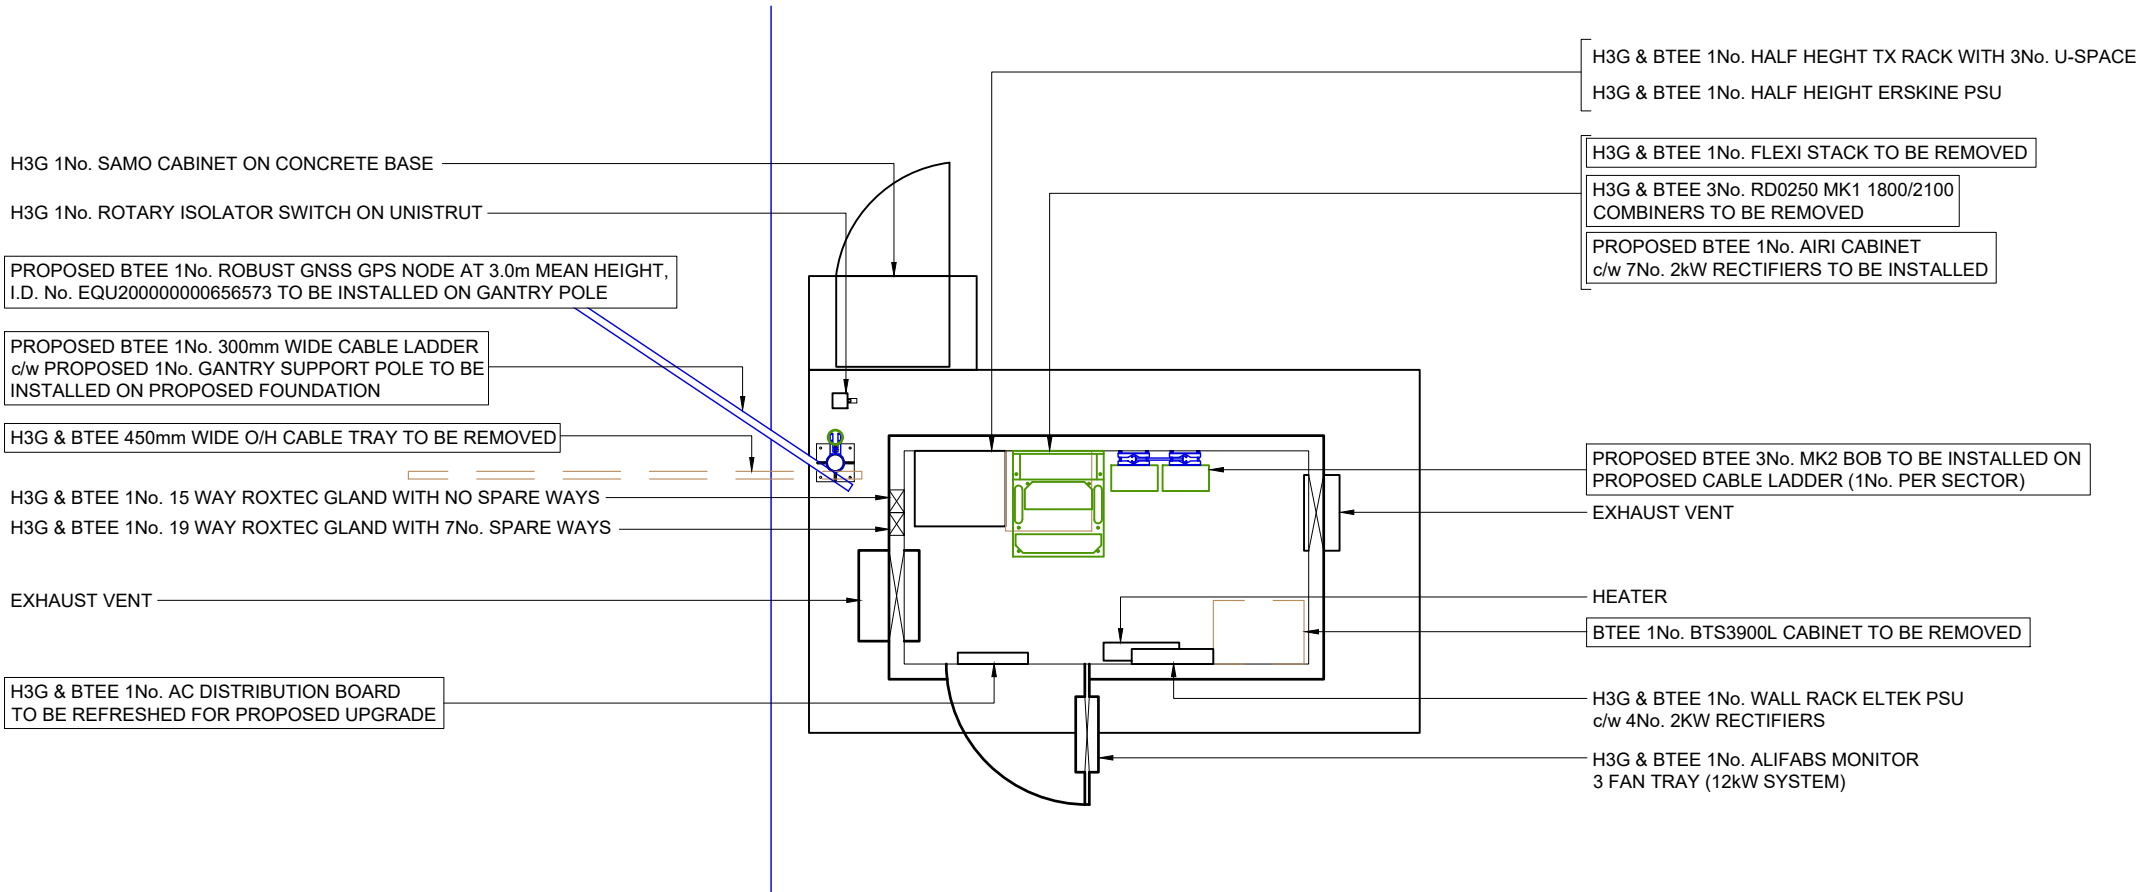

©2020 Cellnex
All rights reserved. No part of this publication may be reproduced, stored in a retrieval system or transmitted in any form or by any means (Electronic, Mechanical, Photocopying, Recording or otherwise), without the prior written consent of the Company.

NOTES

PROJECT No. COL.MOD.UK.0003509

CELL No. 95555

3	COL.MOD.UK.0003509 MINOR AMEND	03/10/25	HFC	HFC
2	COL.MOD.UK.0003509 PLANNING ISSUE	23/09/25	HFC	HFC
1	181684 CONVERSION	12/05/16	PS	PS
0	0 O DRIVE MIGRATION	28/05/11	IM	IM

ISS	REVISION	DATE	DRN	APP
-----	----------	------	-----	-----



CELLNEX UK
R+, 4TH FLOOR, 2 BLA GRAVE STREET, READING, RG1 1AZ
Tel. 020 4526 8553

SITE No **UK-MY-005554**
J & L SUPPLIES
J & L SUPPLIES
11A CADDICK ROAD
SOUTH KNOWSLEY
MERSEYSIDE
L34 9HP

NGR SJ 43066 96089

OS GRID 343066, 396089

TITLE
EQUIPMENT PLAN
PROPOSED
BTEE LTD

SCALE 1:50

DRAWN IM 28/05/11

APPROVED HFC 03/10/25

DRG No. Sheet 1 of 1 Rev

UKMY005554-02-101-MD003 3

FEINT DETAILS INDICATE LOCATIONS RESERVED FOR OTHER PROPOSALS WHICH MAY BE THE SUBJECT OF SEPARATE APPLICATIONS