


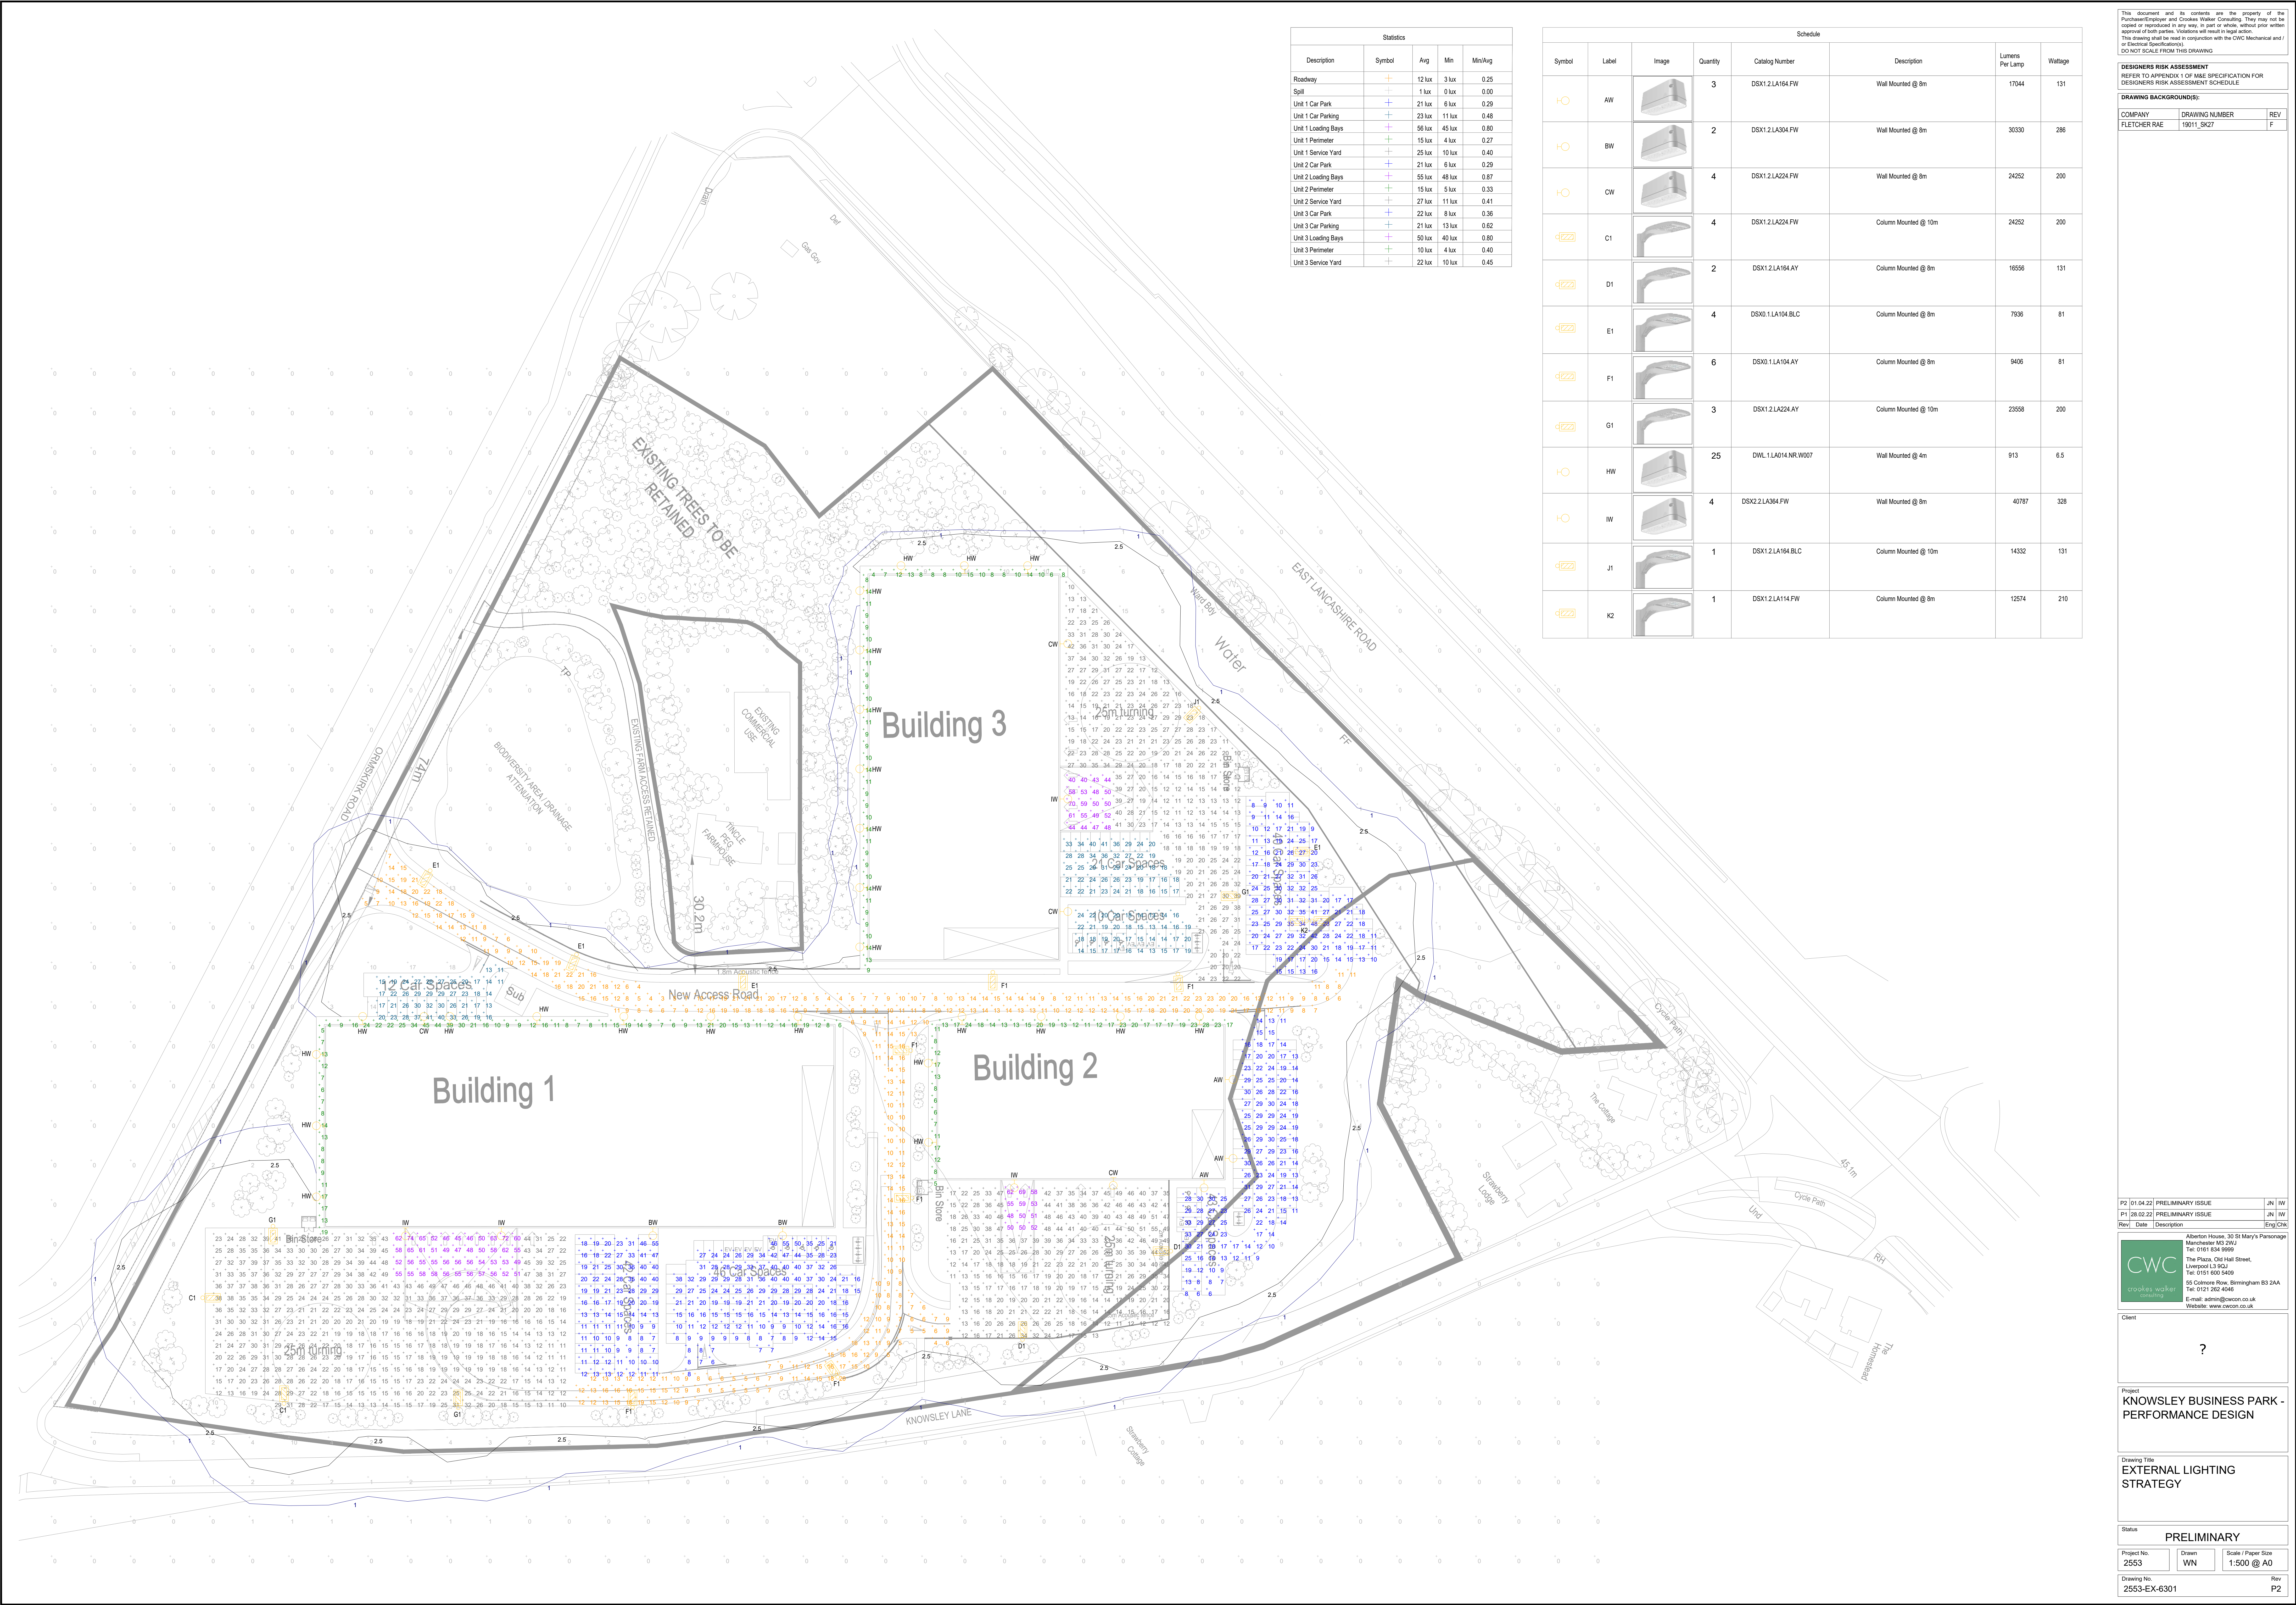

Statistics				
Description	Symbol	Avg	Mn	Min/Avg
Roadway	+	12 lux	3 lux	0.25
Spill	+	1 lux	0 lux	0.00
Unit 1 Car Park	+	21 lux	6 lux	0.29
Unit 1 Car Parking	+	23 lux	11 lux	0.48
Unit 1 Loading Bays	+	56 lux	45 lux	0.80
Unit 1 Perimeter	+	15 lux	4 lux	0.27
Unit 1 Service Yard	+	25 lux	10 lux	0.40
Unit 2 Car Park	+	21 lux	6 lux	0.29
Unit 2 Loading Bays	+	55 lux	48 lux	0.87
Unit 2 Perimeter	+	15 lux	5 lux	0.33
Unit 2 Service Yard	+	27 lux	11 lux	0.41
Unit 3 Car Park	+	22 lux	8 lux	0.36
Unit 3 Car Parking	+	21 lux	13 lux	0.82
Unit 3 Loading Bays	+	50 lux	40 lux	0.80
Unit 3 Perimeter	+	10 lux	4 lux	0.40
Unit 3 Service Yard	+	22 lux	10 lux	0.45

Schedule							
Symbol	Label	Image	Quantity	Catalog Number	Description	Lumens Per Lamp	Wattage
	AW		3	DSX1.2.LA164.FW	Wall Mounted @ 8m	17044	131
	BW		2	DSX1.2.LA304.FW	Wall Mounted @ 8m	30330	286
	CW		4	DSX1.2.LA224.FW	Wall Mounted @ 8m	24252	200
	C1		4	DSX1.2.LA224.FW	Column Mounted @ 10m	24252	200
	D1		2	DSX1.2.LA164.AY	Column Mounted @ 8m	16556	131
	E1		4	DSX0.1.LA104.BLC	Column Mounted @ 8m	7936	81
	F1		6	DSX0.1.LA104.AY	Column Mounted @ 8m	9406	81
	G1		3	DSX1.2.LA224.AY	Column Mounted @ 10m	23558	200
	HW		25	DWL.1.LA014.NR.W007	Wall Mounted @ 4m	913	6.5
	IW		4	DSX2.2.LA364.FW	Wall Mounted @ 8m	40787	328
	J1		1	DSX1.2.LA164.BLC	Column Mounted @ 10m	14332	131
	K2		1	DSX1.2.LA114.FW	Column Mounted @ 8m	12574	210

This document and its contents are the property of the Purchaser/Client and are not to be copied or reproduced in any way, in part or whole, without prior written approval of both parties. Violations will result in legal action. This drawing shall be used in conjunction with the CWC Mechanical and / or Electrical Specifications. DO NOT SCALE FROM THIS DRAWING.

DESIGNERS RISK ASSESSMENT
REFER TO APPENDIX 1 OF M&E SPECIFICATION FOR DESIGNERS RISK ASSESSMENT SCHEDULE

DRAWING BACKGROUND(S):

COMPANY	DRAWING NUMBER	REV
FLETCHER RAE	19011_SK27	F

P2 01.04.22 PRELIMINARY ISSUE JN IW
P1 28.02.22 PRELIMINARY ISSUE JN IW
Rev Date Description Eng/CW

CWC
crookes walker
engineering

Alberton House, 30 St Mary's Parsonage
Manchester M13 2PL
Tel: 0161 834 9999
The Plaza, Old Hall Street,
Liverpool L3 9JL
Tel: 0151 600 5409
55 Colmore Row, Birmingham B3 2AA
E-mail: admin@cwcon.co.uk
Website: www.cwcon.co.uk

Client

?

Project
**KNOWSLEY BUSINESS PARK -
PERFORMANCE DESIGN**

Drawing Title:
**EXTERNAL LIGHTING
STRATEGY**

Status
PRELIMINARY

Project No. 2553	Drawn WN	Scale / Paper Size 1:500 @ A0
Drawing No. 2553-EX-6301	Rev P2	