


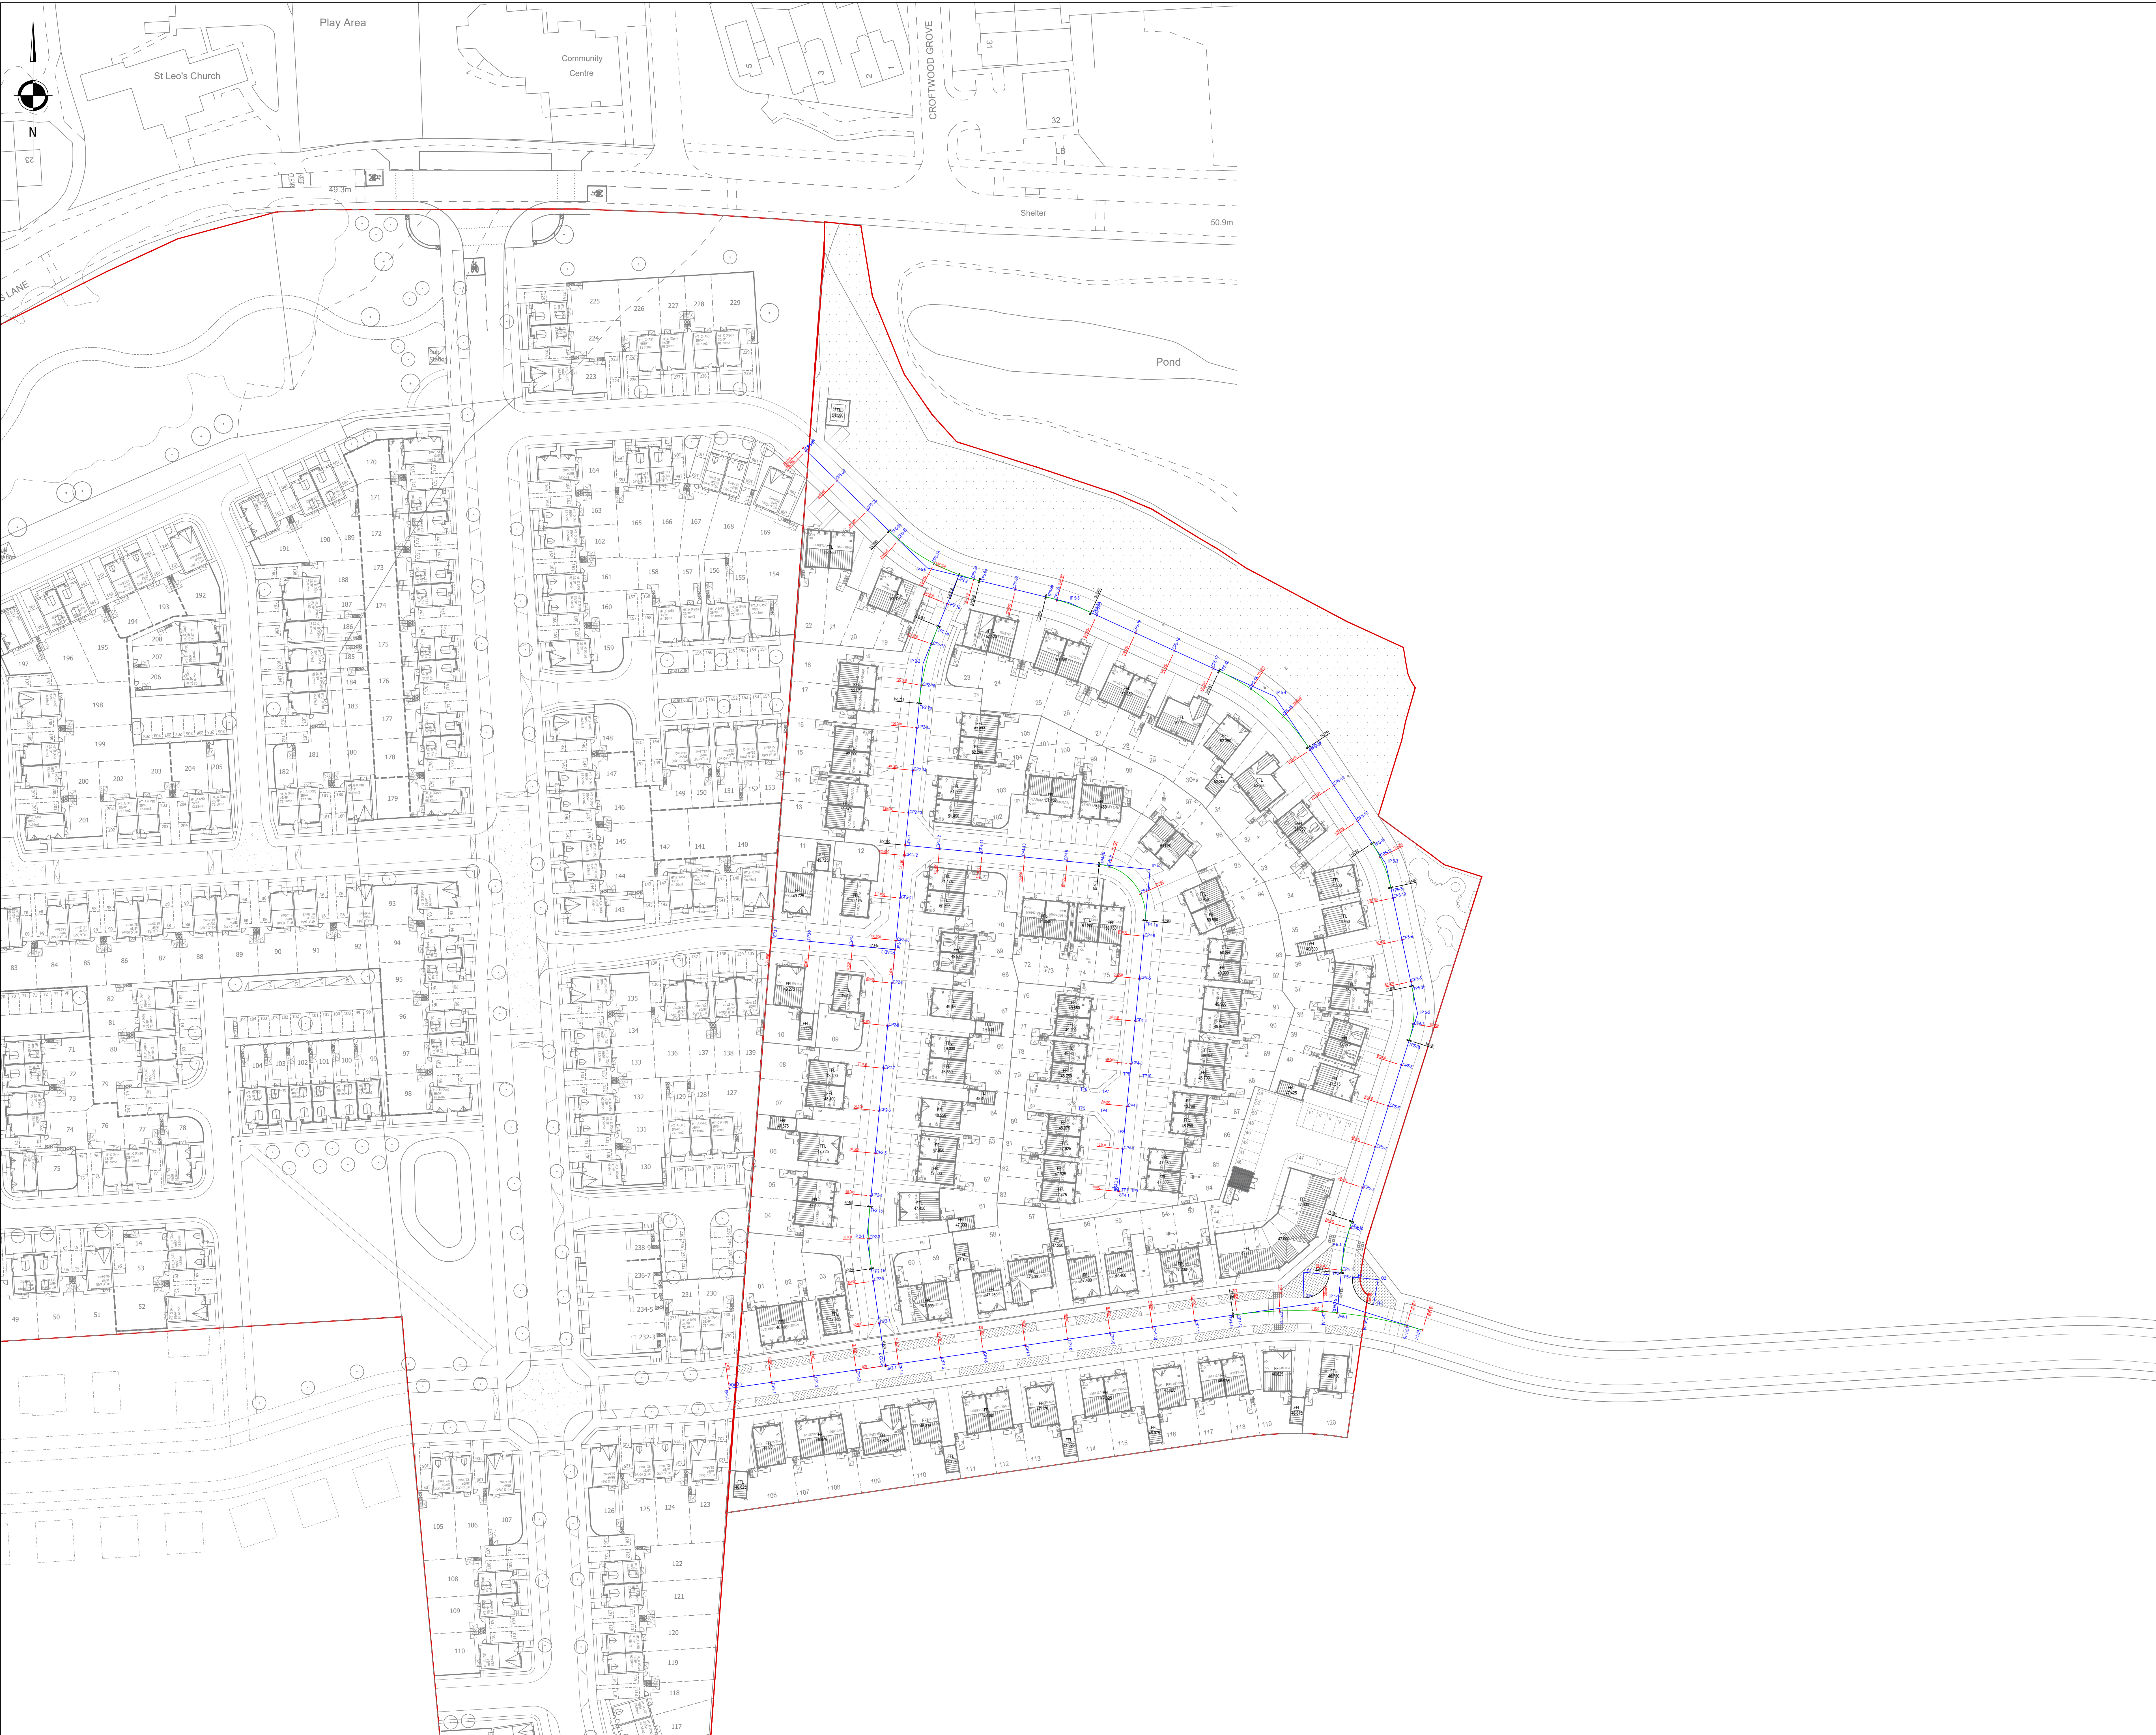

GENERAL NOTES

- THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS, ENGINEERS AND SPECIALISTS DRAWINGS AND SPECIFICATIONS.
- ALL PROPRIETARY BUILDING SYSTEMS (e.g. LIFELINE, P.C. FLOORS, DECKING Etc.) TO BE INSTALLED / ERECTED IN ACCORDANCE WITH MANUFACTURERS' SPECIFICATIONS / DETAILS. CONTRACTOR TO REFER TO AGREEMENT CERTIFICATE / SPECIFICATIONS / RECOMMENDATIONS.
- FOR ALL SETTING OUT REFER TO ARCHITECTS DRAWINGS.
- MORTAR BELOW AND ABOVE GROUND TO BE 1:2:4.
- CONCRETE STRENGTHS TO BE:
MASS CONCRETE TRENCH FILL GRADE 30
MAX AGGREGATE 20mm
MINIMUM CEMENT 300 Kg/m³
FREE WATER / CEMENT 0.60
NOTE: CONCRETE DESIGN MIXES ARE TO RESIST CLASS D51 / A21 COVER TO REINFORCEMENT TO BE 40mm.
- SUPERSTRUCTURE DESIGN DETAIL AND SPECIFICATION TO BE IN ACCORDANCE WITH SPECIALIST DRAWINGS AND SPECIFICATIONS.
- ALL FOUNDATIONS ARE TO BE TAKEN DOWN ONTO STIFF CLAY WITH BEARING CAPACITY OF 100 KN per Sq M. ALL FOUNDATIONS ARE TO BE TO APPROVAL OF LOCAL AUTHORITY BUILDING INSPECTOR AND A/P CONTRACTOR IS TO MAKE REFERENCE TO SUBSILF SITE INVESTIGATION REPORT FOR SITE GROUND CONDITIONS, STRATA LEVELS AND CONTAMINATION RECOMMENDATIONS AND REQUIREMENTS.
- ALL DPMs & DPCS AND WATERPROOFING / HEATHERING DETAILS TO BE IN ACCORDANCE WITH ARCHITECTS AND SPECIALISTS DETAILS.
- THE CONTRACTOR IS RESPONSIBLE FOR THE LOCATION OF ALL UNDERGROUND SERVICES THAT MAY EXIST AND TO DIVERT THEM IF NECESSARY PRIOR TO COMMENCEMENT OF THE WORKS.
- ALL STRUCTURAL WORKS TO BE CARRIED OUT STRICTLY IN ACCORDANCE WITH THE DETAILS GIVEN BY THE ALAN JOHNSON PARTNERSHIP. THE ENGINEER IS TO BE ADVISED OF ANY SIGNIFICANT VARIATIONS PRIOR TO IMPLEMENTATION.

A SUMMARY OF CAPPING LAYER THICKNESS AND OR INCREASED SUB-BASE THAT WILL BE REQUIRED IS DETAILED IN THE TABLE BELOW:

SUBGRADE CBR (%)	CAPPING LAYER THICKNESS (mm)	SUB-BASE LAYER THICKNESS (mm)	KMBC STANDARD MINIMUM SUB-BASE THICKNESS (mm)
<2	600	150	-
2 - 2.5	450	150	-
>2.5 - 3	-	-	350
>3 - 4	-	-	300
>4 - 5	-	-	250
>5	-	-	230

ALL WORKS TO BE IN ACCORDANCE WITH THE HALSNEAD DESIGN GUIDE AND KNOWSLEY COUNCIL STANDARD DETAILS.

ALL DRAINAGE IS TO BE DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH UNITED UTILITIES PLC 'A DEVELOPERS GUIDE TO WASTEWATER ADOPTIONS' AND 'SEWERS FOR ADOPTION 6TH EDITION' - (MARCH 2006)

ALL ADOPTABLE MAIN DRAINAGE IS TO BE SUBJECT TO A SECTION 104 AGREEMENT BETWEEN THE DEVELOPER AND UNITED UTILITIES

KEY

- CHAINAGE
- INTERSECTION POINT INFORMATION
- HORIZONTAL CURVE

PRELIMINARY SUBJECT TO S38 APPROVAL

PM	24.09.2024	UPDATED TO SUB LATEST LEVEL DESIGN AND H/M/C COMMENTS	LS	KOB	KOB
PD	07.06.2024	UPDATED TO SUB LATEST DESIGN GUIDE	LS	KOB	KOB
PD	22.07.2022	UPDATED TO SUB LATEST ARCHITECTS LAYOUT	KOB	KOB	KOB
PD	24.11.2021	PRELIMINARY ISSUE	LS	KOB	KOB
REV	DATE	DESCRIPTION	BY	CHK	APP

DRAWING STATUS:	PRELIMINARY
-----------------	-------------

CLIENT:	VISTRY PARTNERSHIPS
---------	---------------------

ARCHITECT:	MPSL
------------	------

PROJECT:	HALSNEAD GARDEN VILLAGE LICKERS LANE WHISTON
----------	--

TITLE:	S38 HIGHWAY SETTING OUT MASTERPLAN
--------	---------------------------------------

STATUS	PROJECT No.	PROJECT	ORIGINATOR	DESIGNER	TYPE	SCALE	DRAWING No.	REV
S2	221-130	HLL - AJP - XX - 00 - DR - C - 1500	P04					
SCALE @ A4	DESIGNED	DRAWN	CHECKED	APPROVED	DATE			
1:500	LS	LS	KOB	KOB	NOV 2021			