




A SUMMARY OF CAPPING LAYER THICKNESS AND OR INCREASED

SUBGRADE CBR (%)	CAPPING LAYER THICKNESS (mm)	SUB-BASE LAYER THICKNESS (mm)	KMBC STANDARD MINIMUM SUB-BASE THICKNESS (mm)
<2	800	150	-
2-2.5	400	150	-
>2.5-3	-	-	350
>3-4	-	-	300
>4-5	-	-	250
>5	-	-	230

ALL DRAINAGE IS TO BE DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH UNITED UTILITIES PLC 'A DEVELOPERS GUIDE TO WASTEWATER ADOPTIONS' AND 'SEWERS FOR ADOPTION 6TH EDITION' - (MARCH 2006)

ALL ADOPTABLE MAIN DRAINAGE IS TO BE SUBJECT TO A SECTION 104 AGREEMENT BETWEEN THE DEVELOPER AND UNITED UTILITIES

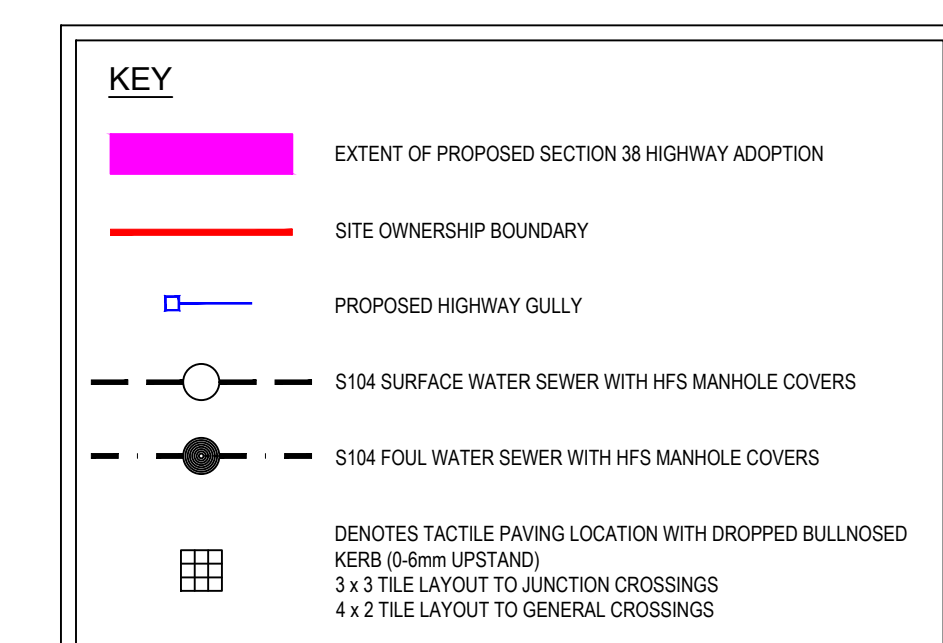

PRELIMINARY SUBJECT TO
S38 APPROVAL

P2	02.08.2022	UPDATED TO SUIT LATEST ARCHITECTS LAYOUT	LS	KOB	K
P1	22.07.2022	PRELIMINARY ISSUE	LS	AMC	K
REV	DATE	DESCRIPTION	BY	CHK	A

DRAWING STATUS: **PRELIMINARY**

CLIENT:	VISTRY PARTNERSHIPS
ARCHITECT:	MPSL

PROJECT: HALSNEAD GARDEN VILLAGE
LICKERS LANE
WHISTON

TITLE: S38 HIGHWAY ADOPTION LAYOUT

SHEET 1

STATUS:	PROJECT No.	PROJECT	ORIGINATOR	VOL/SYS	LEVEL	TYPE	ROLE	DRAWING No.	REV.
S2	221-130	HLL - AJP - XX - 00 - DR - C - 1591						P02	

SCALE @ A1:	DESIGNED:	DRAWN:	CHECKED:	APPROVED:	DATE:
1:250	LS	KB	LS	KOB	JULY 2022