





Depth from cover level to soffit of pipe less than 1.5m. maximum pipe size 450mm diameter rigid material construction

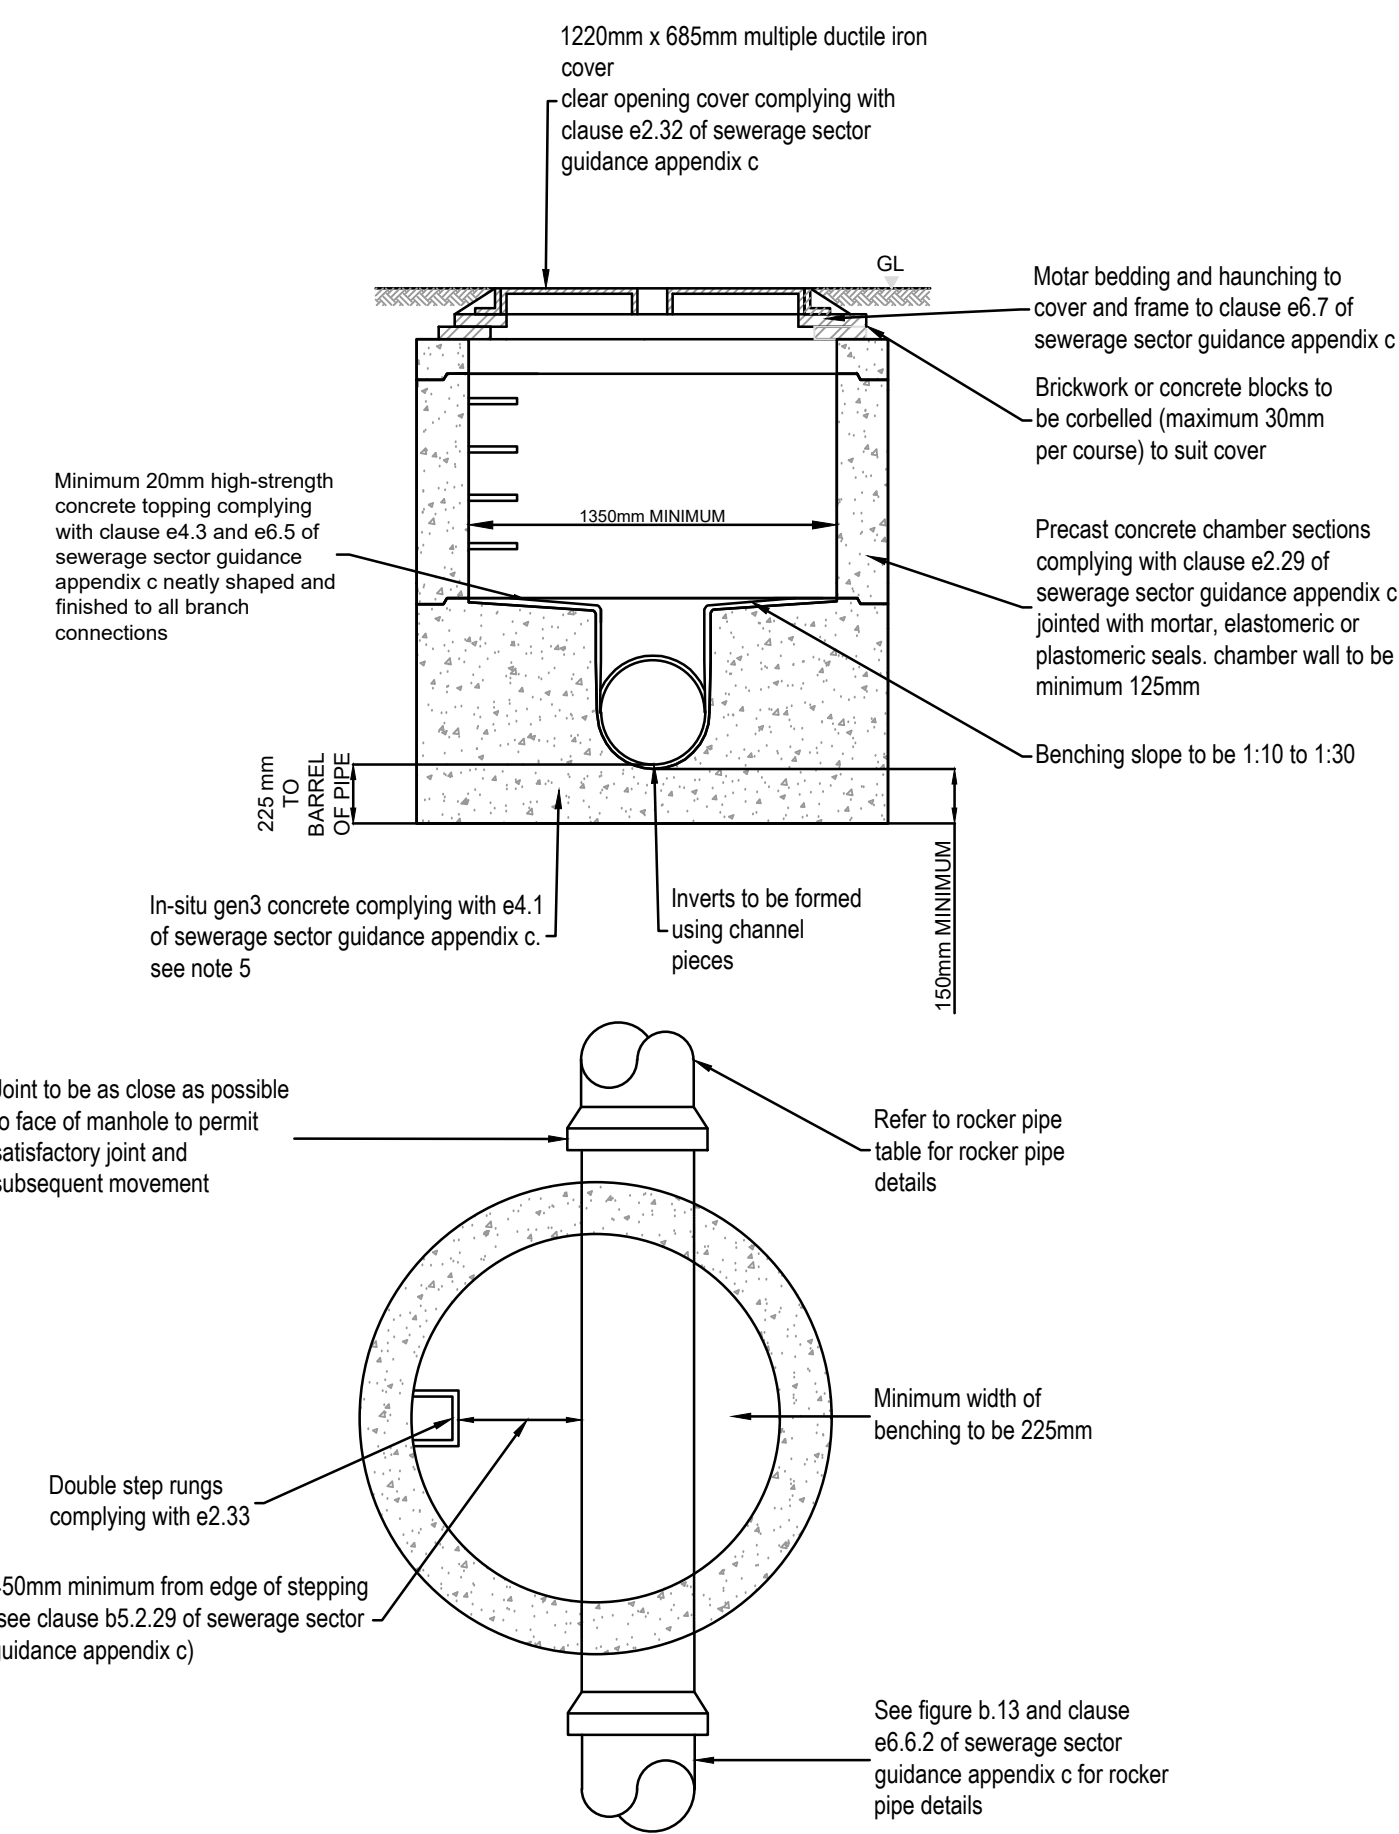


Depth from cover level to soffit of pipe up to 3.0m

| ROCKER PIPE TABLE |                    |
|-------------------|--------------------|
| PIPE DIA.         | ROCKER PIPE LENGTH |
| ≤600mm            | 0.6m               |
| 675-750mm         | 1.0m               |
| >825mm            | 1.25m              |

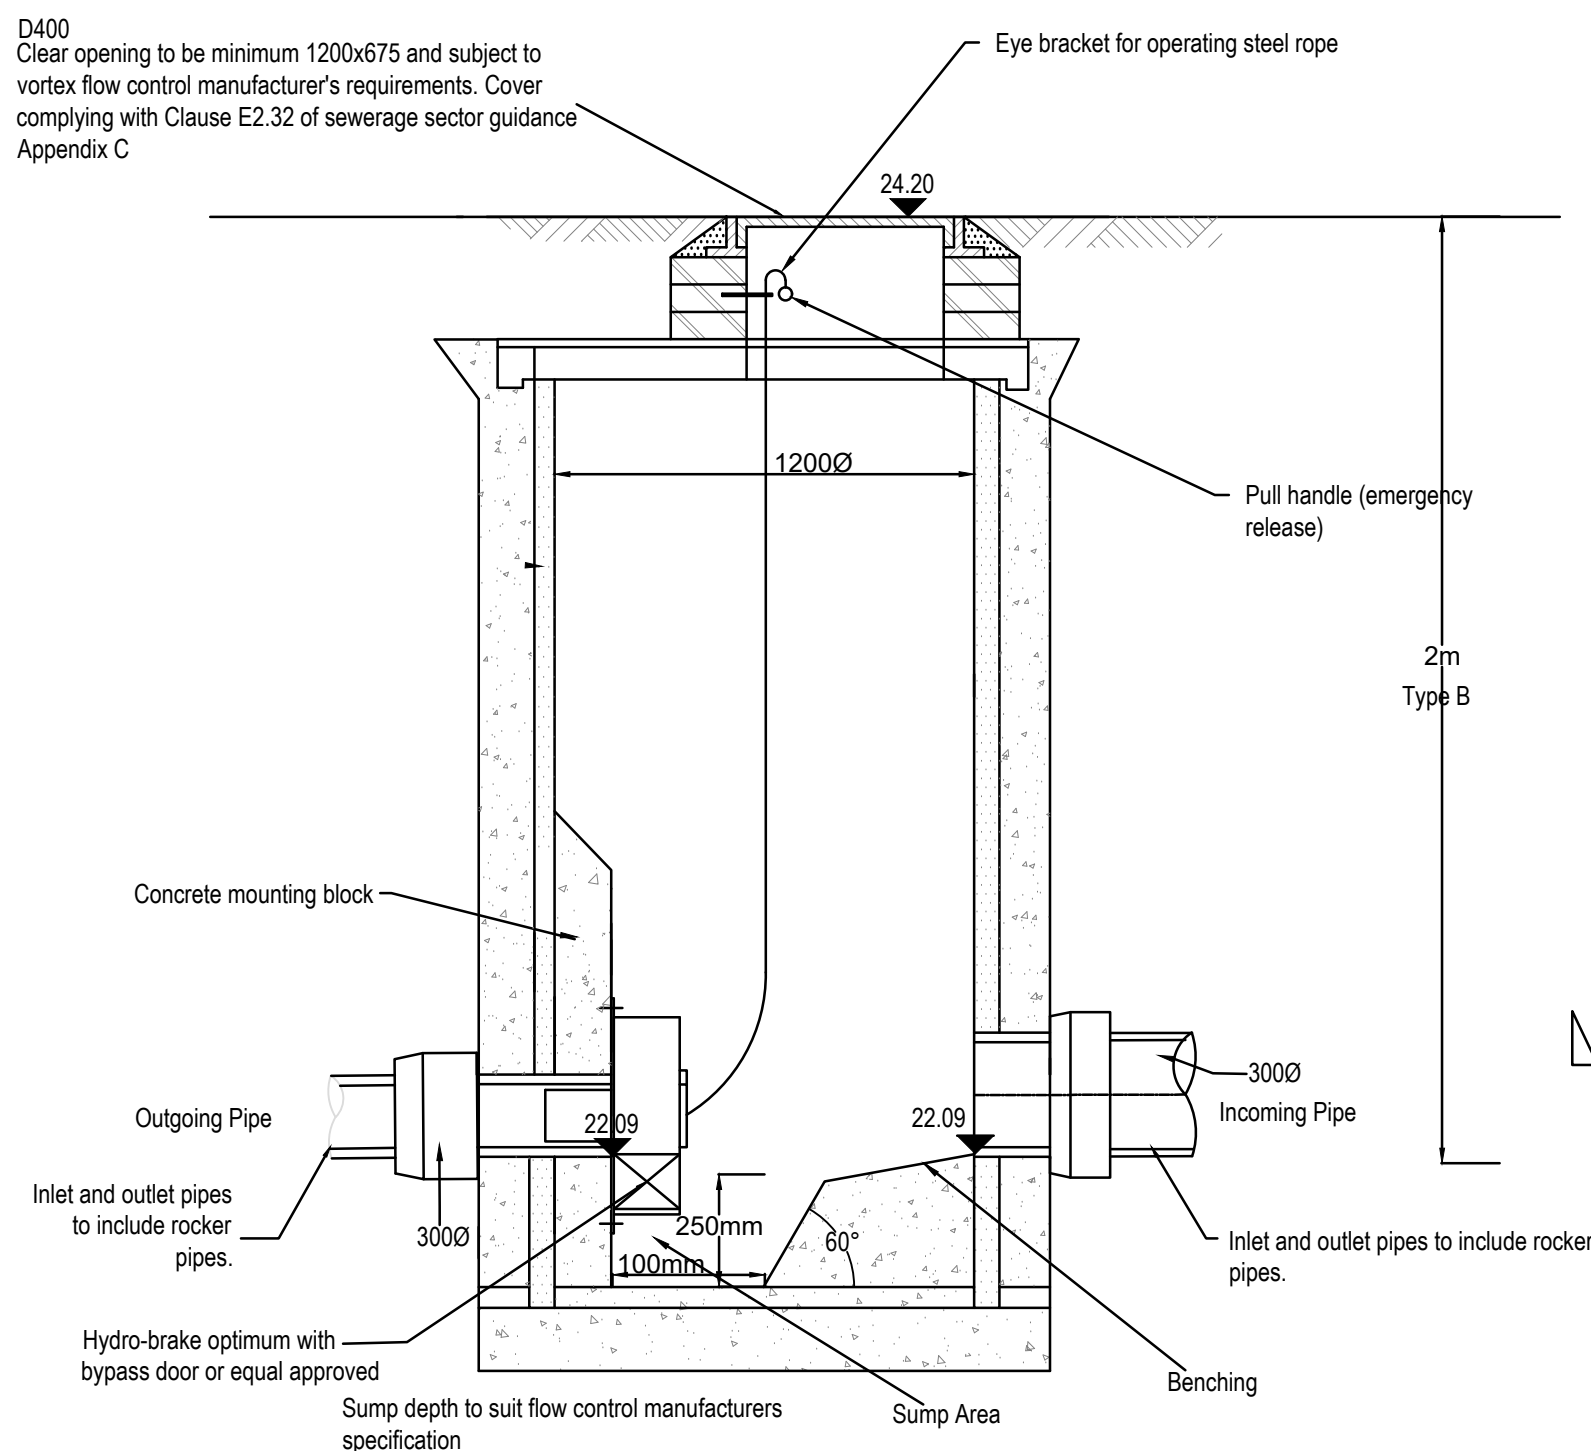

Flow Control Manhole  
Section A-A  
SW08

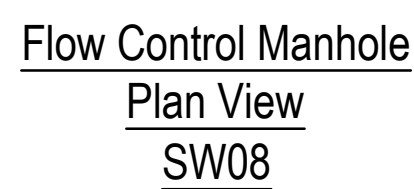

- All sewer trenches and branch connections to be backfilled with suitable material in layers not exceeding 225mm unconsolidated thickness then fully compacted.

|                      |              |
|----------------------|--------------|
| Date: 01.06.2026     | Drawn By: AF |
| Scale: NTS @ A1      | Checked: JC  |
| Status: For Approval | Approved: TW |