




- | Legend                                                                                |                                                           |
|---------------------------------------------------------------------------------------|-----------------------------------------------------------|
|    | EXISTING SURFACE WATER PUBLIC SEWER                       |
|    | PROPOSED SURFACE WATER DRAINAGE (TYPICALLY 1500 UNO.)     |
|    | PROPOSED SURFACE WATER PRECAST CONCRETE MANHOLE.          |
|    | PROPOSED SURFACE WATER POLYPROPYLENE INSPECTION CHAMBERS. |
|    | PROPOSED RAINWATER DOWNSPOUT                              |
|    | PROPOSED SURFACE WATER GEOCELLULAR ATTENUATION TANK       |
|    | PROPOSED PRIVATE 'ACO' LINEAR DRAINAGE CHANNEL            |
|    | PROPOSED FOUL DRAINAGE (TYPICALLY 1000 UNO.)              |
|   | PROPOSED FOUL PRECAST CONCRETE MANHOLE.                   |
|  | PROPOSED FOUL POLYPROPYLENE INSPECTION CHAMBERS.          |
|  | PROPOSED SOIL VENT PIPE                                   |
|  | PROPOSED STUB STACK                                       |

Status INFORMATION

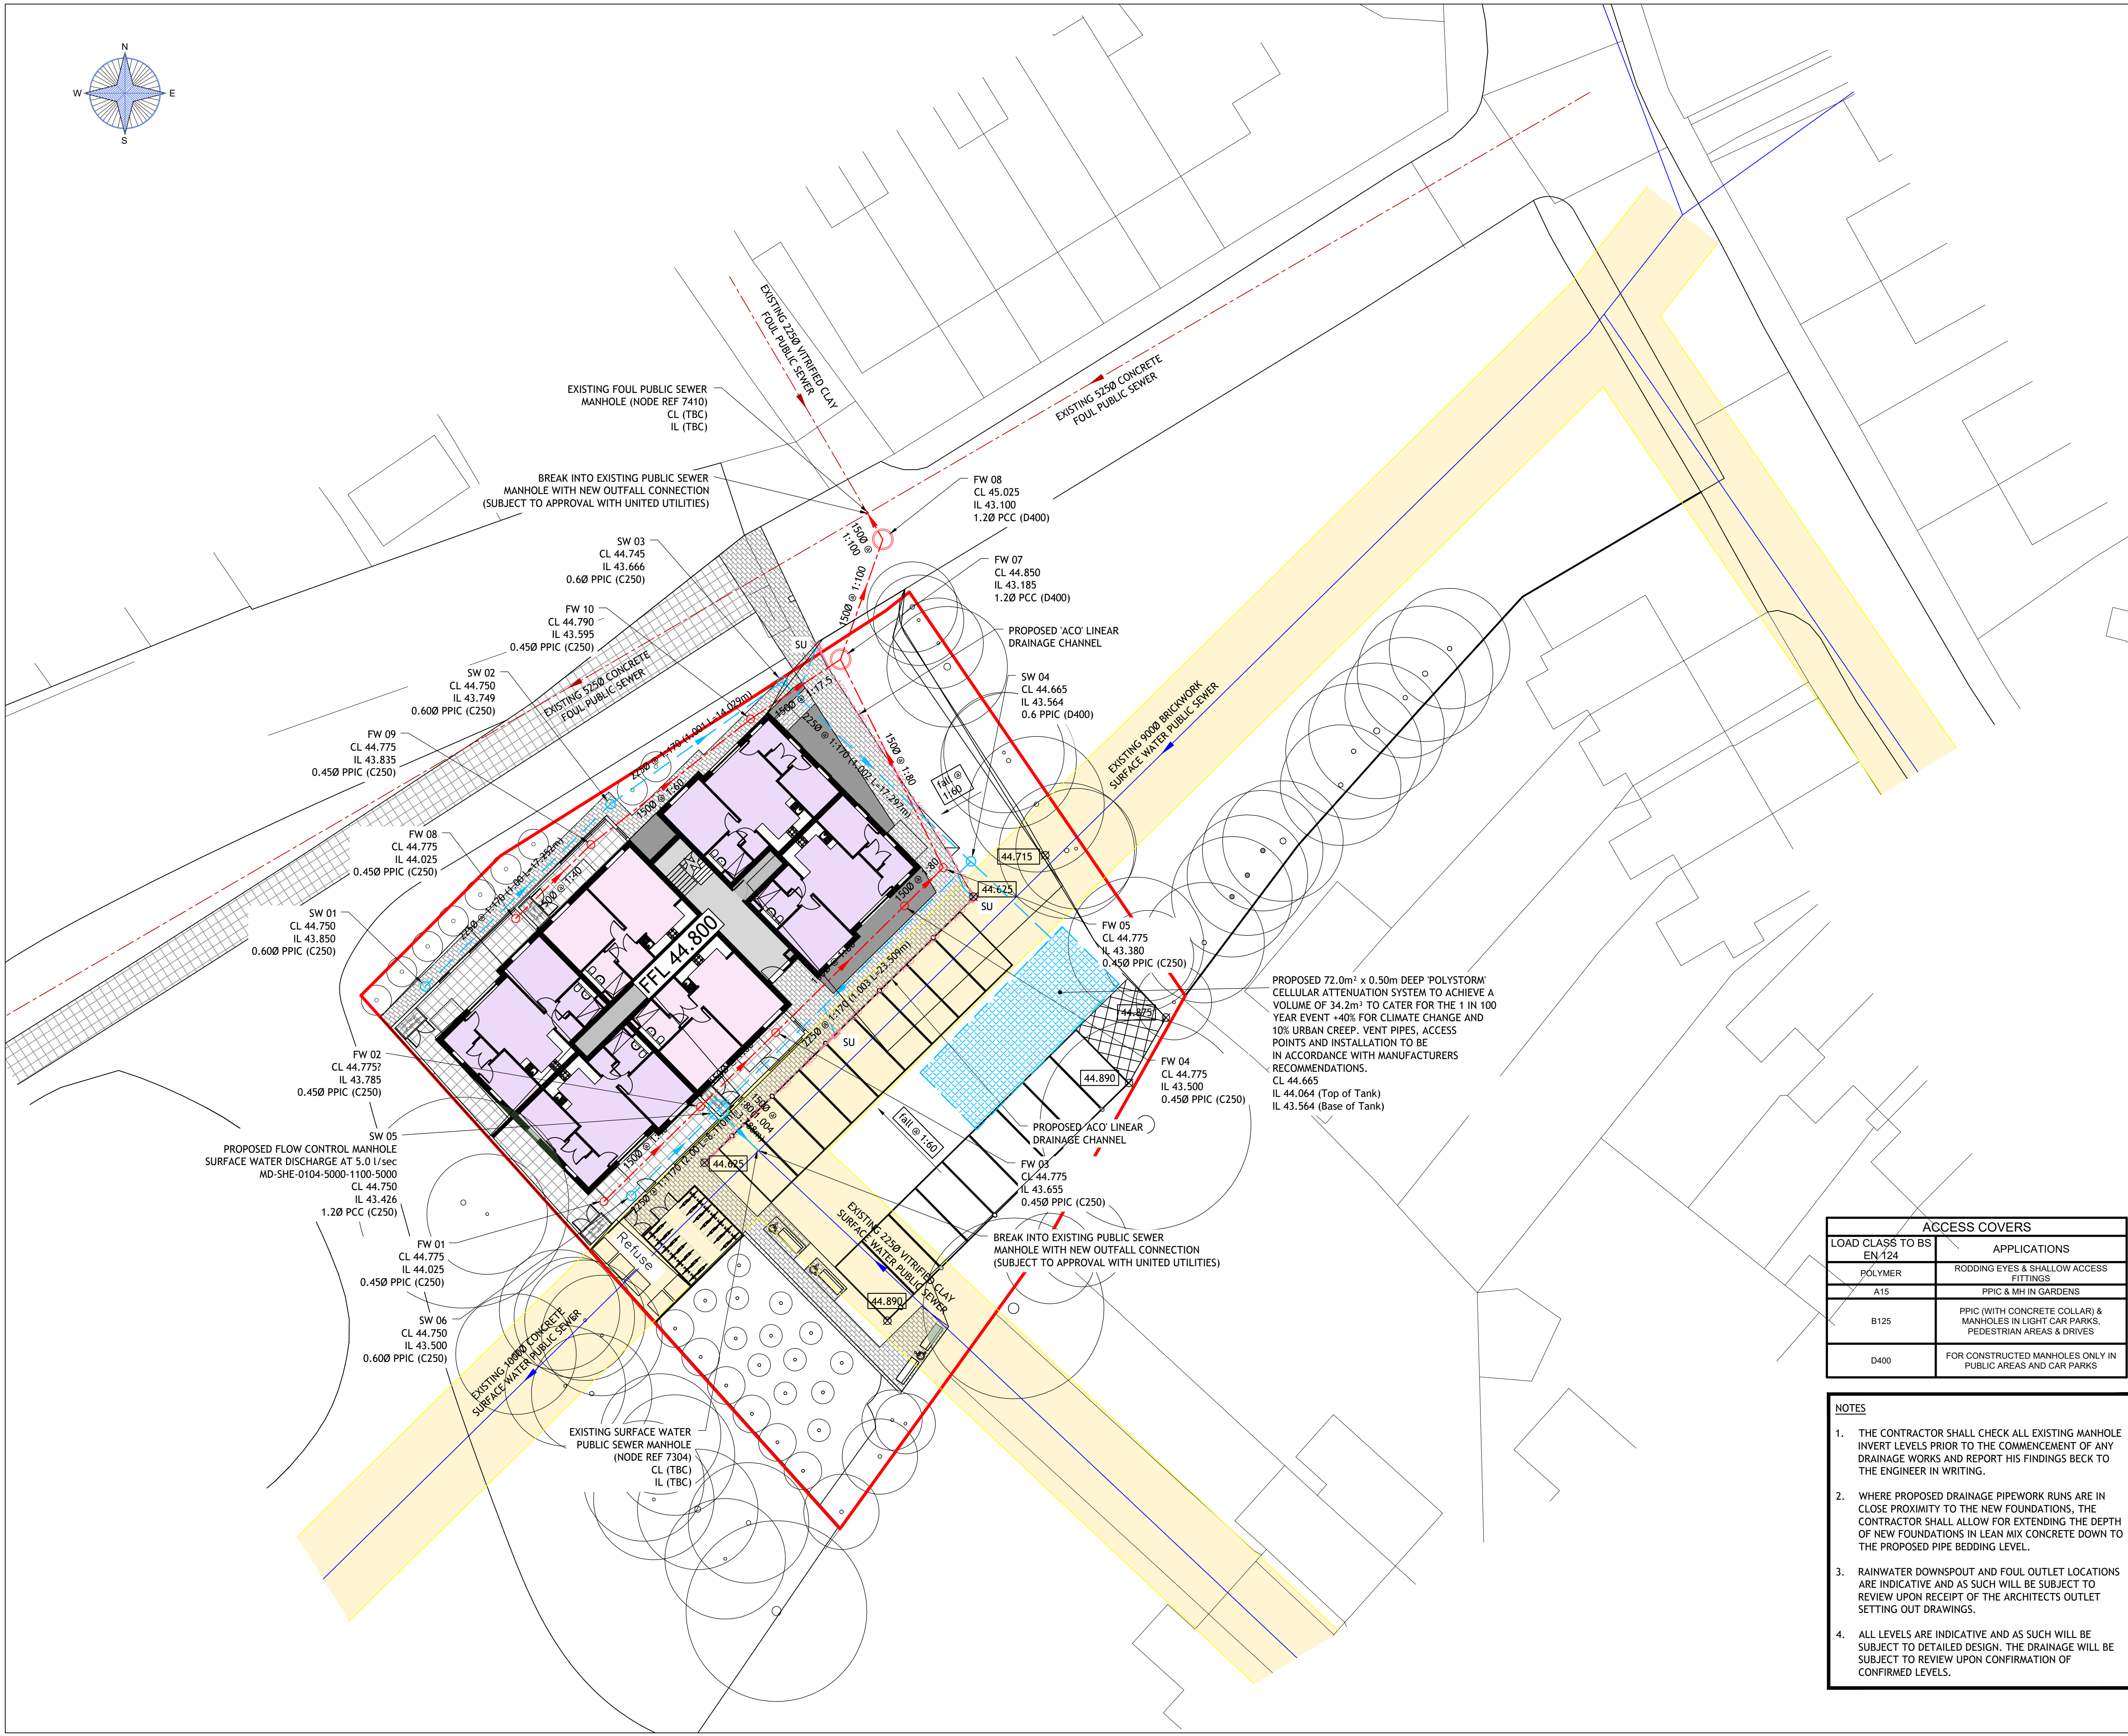

**JH Drainage Design**  
JOURNAL@JACKFITZHENRY.COM

|          |     |
|----------|-----|
| YH 04/01 | P01 |
|----------|-----|

## NOTES

1. THE CONTRACTOR SHALL CHECK ALL EXISTING MANHOLE INVERT LEVELS PRIOR TO THE COMMENCEMENT OF ANY DRAINAGE WORKS AND REPORT HIS FINDINGS BACK TO THE ENGINEER IN WRITING.
2. WHERE PROPOSED DRAINAGE PIPEWORK RUNS ARE IN CLOSE PROXIMITY TO THE NEW FOUNDATIONS, THE CONTRACTOR SHALL ALLOW FOR EXTENDING THE DEPTH OF NEW FOUNDATIONS IN LEAN MIX CONCRETE DOWN TO THE PROPOSED PIPE BEDDING LEVEL.
3. RAINWATER DOWNSPOUT AND FOUL OUTLET LOCATIONS ARE INDICATIVE AND AS SUCH WILL BE SUBJECT TO REVIEW UPON RECEIPT OF THE ARCHITECTS OUTLET SETTING OUT DRAWINGS.
4. ALL LEVELS ARE INDICATIVE AND AS SUCH WILL BE SUBJECT TO DETAILED DESIGN. THE DRAINAGE WILL BE SUBJECT TO REVIEW UPON CONFIRMATION OF CONFIRMED LEVELS.